

Guide to Ship Sanitation

Third Edition

Geneva
Working Draft for Comment
Updated after Informal Consultation March 2010
Version: 15th March 2010. Revision Coordinator D
Deere dan@waterfutures.net.au



WHO Library Cataloguing-in-Publication Data

[to be inserted by WHO]

© World Health Organization 2009

All rights reserved. Publications of the World Health Organization can be obtained from WHO Press, World Health Organization, 20 Avenue Appia, 1211 Geneva 27, Switzerland (tel.: +41 22 791 2476; fax: +41 22 791 4857; e-mail: bookorders@who.int). Requests for permission to reproduce or translate WHO publications—whether for sale or for non-commercial distribution—should be addressed to WHO Press at the above address (fax: +41 22 791 4806; e-mail: permissions@who.int).

The designations employed and the presentation of the material in this publication do not imply the expression of any opinion whatsoever on the part of the World Health Organization concerning the legal status of any country, territory, city or area or of its authorities, or concerning the delimitation of its frontiers or boundaries. Dotted lines on maps represent approximate border lines for which there may not yet be full agreement.

The mention of specific companies or of certain manufacturers' products does not imply that they are endorsed or recommended by the World Health Organization in preference to others of a similar nature that are not mentioned. Errors and omissions excepted, the names of proprietary products are distinguished by initial capital letters.

All reasonable precautions have been taken by the World Health Organization to verify the information contained in this publication. However, the published material is being distributed without warranty of any kind, either express or implied. The responsibility for the interpretation and use of the material lies with the reader. In no event shall the World Health Organization be liable for damages arising from its use.

Table of contents

FOREWORD	5
ACKNOWLEDGEMENTS	6
GLOSSARY	9
ACRONYMS	12
1 INTRODUCTION	13
1.1 GENERAL ISSUE AND CONCERN.....	ERROR! BOOKMARK NOT DEFINED.
1.2 SCOPE, PURPOSE AND OBJECTIVE.....	13
1.3 HARMONIZATION WITH OTHER INTERNATIONAL REGULATIONS.....	14
1.3.1 <i>International Health Regulations</i>	14
1.3.2 <i>Standards of the International Labour Organization (ILO)</i>	15
1.4 ROLES AND RESPONSIBILITIES.....	16
1.4.1 <i>Designer/constructor</i>	16
1.4.2 <i>Owner/operator</i>	17
1.4.3 <i>Master/crew</i>	17
1.4.4 <i>Port authorities</i>	17
1.5 STRUCTURE OF THE GUIDE TO SHIP SANITATION.....	17
2 WATER	19
2.1 BACKGROUND.....	19
2.1.1 <i>Standards related to potable water</i>	19
2.1.2 <i>Role of the International Health Regulations (2005)</i>	20
2.1.3 <i>Potable water sources from ashore and uses on board ships</i>	21
2.1.4 <i>Health risks associated with potable water on ships</i>	21
2.1.5 <i>Bottled water and ice</i>	23
2.1.6 <i>Definitions, overview and objectives of water safety plans</i>	23
2.2 GUIDELINES.....	25
2.2.1 <i>Guideline 2.1 Water Safety Plan for shore supplies and bunker boats or barges</i>	25
2.2.2 <i>Guideline 2.2 Water quantity</i>	27
2.2.3 <i>Guideline 2.3 Water Safety Plan for ship water supply</i>	28
2.2.4 <i>Guideline 2.4: Independent surveillance</i>	39
3 FOOD	44
3.1 BACKGROUND.....	44
3.1.1 <i>Food supply and transfer chain</i>	44
3.1.2 <i>Health risks associated with food on ships</i>	44
3.1.3 <i>International Health Regulations (2005)</i>	46
3.1.4 <i>Overview of Food Safety Plans and HACCP</i>	46
3.2 GUIDELINES.....	48
3.2.1 <i>Guideline 3.1: Food safety plans</i>	48
3.2.2 <i>Guideline 3.2: Food receival</i>	49
3.2.3 <i>Guideline 3.3: Equipment and utensils</i>	50
3.2.4 <i>Guideline 3.4: Materials</i>	51
3.2.5 <i>Guideline 3.5: Facilities</i>	53
3.2.6 <i>Guideline 3.6: Storage, preparation and service spaces</i>	55
3.2.7 <i>Guideline 3.7: Toilet and personal hygiene facilities</i>	57
3.2.8 <i>Guideline 3.8: Dishwashing</i>	58
3.2.9 <i>Guideline 3.9: Safe food storage</i>	59
3.2.10 <i>Guideline 3.10: Maintenance and cleaning</i>	60
3.2.11 <i>Guideline 3.11: Personnel hygiene</i>	61
3.2.12 <i>Guideline 3.12: Training</i>	62
3.2.13 <i>Guideline 3.13: Food wastes</i>	63
4 RECREATIONAL WATER ENVIRONMENTS	64
4.1 BACKGROUND.....	64

4.1.1	<i>Health risks associated with recreational water environments on ships</i>	64
4.1.2	<i>Recreational water environment guidelines</i>	65
4.2	GUIDELINES.....	65
4.2.1	<i>Guideline 4.1: Design and operation</i>	65
4.2.2	<i>Guideline 4.2: Pool hygiene</i>	72
4.2.3	<i>Guideline 4.3: Monitoring</i>	75
5	BALLAST WATER	77
5.1	BACKGROUND.....	77
5.1.1	<i>Health risks associated with ballast water on ships</i>	77
5.1.2	<i>Standards</i>	77
5.2	GUIDELINES.....	77
5.2.1	<i>Guideline 5.1: Ballast water management</i>	78
6	WASTE MANAGEMENT AND DISPOSAL	81
6.1	BACKGROUND.....	81
6.1.1	<i>Health risks associated with wastes on ships</i>	81
6.1.2	<i>Standards</i>	81
6.2	GUIDELINES.....	82
6.2.1	<i>Guideline 5.1: Sewage and grey water management</i>	82
6.2.2	<i>Guideline 5.2: Garbage waste management</i>	83
6.2.3	<i>Guideline 5.3: Healthcare and pharmaceutical waste management</i>	84
7	VECTOR AND RESERVOIR CONTROL	86
7.1	BACKGROUND.....	86
7.1.1	<i>Health risks associated with vectors on ship</i>	86
7.1.2	<i>Standards</i>	86
7.2	GUIDELINES.....	86
7.2.1	<i>Guideline 6.1: Insect vector control</i>	87
7.2.2	<i>Guideline 6.2: Rodent vector control</i>	88
8	CONTROLLING INFECTIOUS DISEASE AGENTS IN THE ENVIRONMENT	90
8.1	BACKGROUND.....	90
8.1.1	<i>Health risks associated with persistent infectious agents on ship</i>	90
8.2	GUIDELINES.....	91
8.2.1	<i>Guideline 7.1: Transmission routes</i>	92
8.2.2	<i>Guideline 7.2: Air quality</i>	93
8.2.3	<i>Guideline 7.3: Cases and outbreaks</i>	94
9	REFERENCES	96
10	ANNEX A: EXAMPLES OF HAZARDS, CONTROL MEASURES, MONITORING PROCEDURES AND CORRECTIVE ACTIONS FOR THE SHIP WATER SUPPLY SYSTEM	99
10.1	SOURCE WATER.....	99
10.2	STORAGE.....	99
10.3	DISTRIBUTION SYSTEM.....	100
11	ANNEX B. EXAMPLE OF A TRAINING CHECKLIST FROM THE UK INDUSTRY GUIDE TO GOOD HYGIENE PRACTICE: CATERING GUIDE – SHIPS:	101
12	ANNEX C: EXAMPLE OF RECOMMENDED PROCEDURES FOR INSPECTION AND ISSUANCE OF SHIP SANITATION CERTIFICATE (FROM PEOPLES REPUBLIC OF CHINA)	103
13	ANNEX D: EXAMPLE OF RECORDING FORM FOR PORT HEALTH OFFICER TO INSPECT THE AREAS ACCORDING TO THE IHR (2005) (FROM PEOPLES REPUBLIC OF CHINA)	104
14	ANNEX E: EXAMPLE OF EVIDENCE RECORDING FORM FOR CAPTURING DETAILED INFORMATION DURING INSPECTION AND ISSUANCE OF SHIP SANITATION CERTIFICATE (FROM PEOPLES REPUBLIC OF CHINA)	108

FOREWORD

Historically, ships have played a significant role in the global transmission of infectious disease. Some of the earliest recorded evidence of attempts to control human disease transmission via ships date to the 14th century, when ports denied access to ships suspected of carrying the plague. In the 19th century, the spread of cholera pandemics was thought to be facilitated by merchant shipping. A World Health Organization (WHO) review identified over 100 disease outbreaks associated with ships between 1970 and 2003 (Rooney et al, 2004).

Today's world fleet of propelled sea-going merchant ships of no less than 100 GT comprises 99 741 ships with an average age of 22 years which are registered in over 150 nations and manned by over a million seafarers of virtually every nationality (Lloyds Register, 2009). World seaborne trade figures estimate that the amount of goods loaded aboard ships has increased considerably since the 1970's and in 2007, reached 8.02 billion tons, a volume increase of 4.8% over the previous year. The shipping industry also supports tourism and recreation with 13.1 million people travelling on cruise ships in 2008 for an average period of seven days. Naval ships also carry considerable numbers of crew, sometimes over 5 000 per ship. Ferries are ubiquitous around the world in port cities and at some river crossings and are used by many people on a daily basis.

Because of the international nature of ship transport, international regulations relating to sanitary aspects of ship transport have been in place for over half a century. The International Sanitary Regulations of 1951 were replaced by the International Health Regulations (IHR) adopted by WHO in 1969. The IHR were revised at the Fifty-eighth World Health Assembly in 2005.

The WHO Guide to Ship Sanitation has become the official WHO global reference on health requirements for ship construction and operation. Its original purpose was to standardize the sanitary measures taken in ships, to safeguard the health of travellers and workers and to prevent the spread of infection from one country to another. Today, however, given the number of specific guidance documents, conventions and regulations that have evolved that provide full accounts of the design and operational detail relating to ships, the primary aim of the Guide is to present the public health significance of ships in terms of disease and to highlight the importance of applying appropriate control measures.

The Guide was first published in 1967 and amended in 1987. This revised 3rd edition of the Guide has been prepared to reflect the changes in construction, design and size of ships since the 1960s and the existence of new diseases (e.g. legionellosis) that were not foreseen when the 1967 Guide was published.

The Guide has been developed through an iterative series of drafting and peer review steps. In revising the Guide, expert meetings were held in Miami, United States of America (USA), on 3–4 October 2001 and in Vancouver, Canada, on 8–10 October 2002 to discuss and recommend the proposed contents. Expert meetings to review the draft Guide were held on 25 October 2007 in Montreal, Canada and 12–13 October 2009 in Lyon, France. Participants represented cruise ship operators, seafarer associations, collaborating member states for the IHR, port state control, port health authorities and other regulatory agencies. Experts from Australia, Brazil, Canada, Egypt, Finland, India, Morocco, the Netherlands, Norway, Russia, South Africa, Thailand, the United Kingdom and the USA were involved in the revision project. A complete list of contributors to the Guide can be found in the Acknowledgements section.

The Guide to Ship Sanitation and the International Medical Guide for Ships (WHO, 2007a) are companion volumes oriented towards preventive and curative health on board ships.

ACKNOWLEDGEMENTS

The preparation of this third edition of the Guide to Ship Sanitation involved the participation of many experts from diverse developing and developed countries.

The work was facilitated greatly by the existence of prior editions and by a systematic review of outbreaks on board ships prepared by Dr Roisin Rooney, WHO, Geneva, which was previously published as WHO/SDE/WSH/01.4 (WHO, 2001).

The work of the following individuals was crucial to the development of this edition of the Guide to Ship Sanitation and is gratefully acknowledged [please check against the list of those that attended the October 2009 meeting]:

- J. Adams, Fisheries and Oceans Canada, Ottawa, Canada
- J. Ames, Centers for Disease Control and Prevention, Atlanta, USA
- K.B. Andrus, Air Transport Association of America, Inc., Washington, USA
- J. Bainbridge, International Transport Workers' Federation, London, UK
- J. Bartram, WHO, Geneva, Switzerland
- D. Bennitz, Health Canada, Ottawa, Canada
- R. Bos, WHO, Geneva, Switzerland
- G. Branston, Port Health Services, East London, South Africa
- B. Brockway, Southampton City Council, Southampton, UK
- C. Browne, Ministry of Health, St Michael, Barbados, West Indies
- R. Bryant, Chamber of Shipping of British Columbia, Vancouver, Canada
- Y. Chartier, WHO, Geneva, Switzerland
- L. Chauham, Ministry of Health, New Delhi, India
- S. Cocksedge, WHO, Geneva, Switzerland
- J. Colligan, Maritime and Coastguard Agency, Edinburgh, UK
- J. Cotruvo, Joseph Cotruvo & Associates LLC, Washington, USA
- E. Cramer, Centers for Disease Control and Prevention, Atlanta, USA
- D. Davidson, Food and Drug Administration, College Park, USA
- D. Dearsley, International Shipping Federation, London, UK
- T. Degerman, Kvaerner Masa-Yards, Turku, Finland
- S. Deno, International Council of Cruise Lines, Arlington, USA
- X. Donglu, Ministry of Health, Beijing, China
- B. Elliott, Transport Canada, Ottawa, Canada
- A. Evans, International Civil Aviation Organization, Montreal, Canada
- M. Ferson, South Eastern Sydney Public Health Unit, Randwick, Australia
- D. Forney, Centers for Disease Control and Prevention, Atlanta, USA
- D. Gamper, Airports Council International, Geneva, Switzerland
- J. Grace, Association of Flight Attendants-CWA, Washington, USA
- R. Griffin, Food Standards Agency, UK
- J. Harb, Health Canada, Vancouver, Canada
- D. Hardy, Navy Environmental Health Center, Norfolk, USA
- J. Hansen, North West Cruiseship Association, Vancouver, Canada
- D. Harper, Centers for Disease Control and Prevention, Atlanta, USA

C. Hollister, Air Transport Association of Canada, Mississauga, Canada
L. Hope, WHO, Geneva, Switzerland
D. Kurnaev, Health Ministry, Centre of State Sanitary Epidemiological Survey on Water, and Air Transport for the North-Western Region of Russia, St Petersburg, Russian Federation
I. Lantz, Shipping Federation of Canada, Montreal, Canada
M. Libel, Pan American Health Organization, WHO Regional Office, Washington, USA
J. Maniram, Port Health Manager, Kwazulu, South Africa
D.L. Menucci, WHO, Lyon, France
J. Michalowski, United States Coast Guard, Washington, USA
S. Minchang, State Administration for Entry-Exit Inspection and Quarantine of People's Republic of China, Beijing, China
D. Mokadam, Association of Flight Attendants-CWA, Washington, USA
K. Montonen, Kvaerner Masa-Yards, Turku, Finland
E. Mourab, Ministry of Health and Population, Cairo, Egypt
J. Nadeau, Health Canada, Ottawa, Canada
M. O'Mahony, Department of Health, London, UK
B. Patterson, Health Canada, Vancouver, Canada
B. Pilon, International Air Transport Association, Geneva, Switzerland
T. Pohle, Air Transport Association, Washington, USA
K. Porter, Environmental Protection Agency, Washington, USA
T. Pule, Ministry of Health, Pretoria, South Africa
R. Rooney, WHO, Geneva, Switzerland
P. Rotheram, Association of Port Health Authorities, Runcorn, UK
S. Ruitai, Ministry of Health, Beijing, China
G. Sam, Department of Health and Aged Care, Canberra, Australia
J. Sarubbi, United States Coast Guard, Washington, USA
T. Sasso, Florida, USA
R. Schiferli, Secretariat of the Paris Memorandum of Understanding on Port State Control, The Hague, Netherlands
E. Sheward, University of Central Lancashire, West Sussex, United Kingdom
R. Suraj, Navy Environmental Health Center, Norfolk, USA
H. Thakore, Health Canada, Vancouver, Canada
C. Thibeault, International Air Transport Association, Montreal, Canada
T. Thompson, International Council of Cruise Lines, Arlington, USA
D.M. Trindade, Centre for Disease Control and Prevention, Macau Special Administrative Region
V. Vuttivrojana, Ministry of Public Health, Nonthaburi, Thailand
B. Wagner, International Labour Organization, Geneva, Switzerland
M. Wahab, Ministry of Health and Population, Cairo, Egypt
R. Wahabi, Ministry of Health, Rabat-Mechquar, Morocco
T. Whitehouse, Canadian Coast Guard, Ontario, Canada
A. Winbow, International Maritime Organization, London, UK
C. Witkowski, Association of Flight Attendants-CWA, Washington, DC, USA

P. Ward provided secretarial and administrative support throughout the meetings during the development of the Guide. D. Deere (Water Futures, Sydney, Australia, and Water Quality Research Australia) and M. Sheffer (Ottawa, Canada) undertook the technical writing and editing roles, respectively, in developing the Guide. The preparation of this third edition of the Guide would not have been possible without the generous financial support of the United States Department of Health and Human Services and the Swedish International Development Cooperation Agency.

GLOSSARY

Acceptable non-rat-proof material	A material whose surface is resistant to gnawing by rats when exposed edges are flashed, but which can be subject to penetration by rats if the gnawing-edges are not so protected.
Accessible	Capable of being exposed for cleaning and inspection with the use of simple tools such as a screwdriver, pliers, or an open-end wrench.
Air gap	The unobstructed vertical distance through the free atmosphere between the lowest opening from any pipe or faucet supplying water to a tank, plumbing fixture, or other device and the flood-level rim of the receptacle or receiving fixture. The air gap must be at least twice the diameter of the supply pipe or faucet or at least 2.5 cm (1 in).
Backflow	The flow of water or other liquids, mixtures, or substances into the distribution pipes of a potable supply of water from any source or sources other than the potable water supply. Back-siphonage is one form of backflow.
Backflow preventer	An approved backflow prevention plumbing device that must be used on potable water distribution lines where there is a direct connection or a potential connection between the potable water distribution system and other liquids, mixtures, or substances from any source other than the potable water supply. Some devices are designed for use under continuous water pressure, whereas others are non-pressure types.
Corrosion-resistant	Resistant to corrosion so that the surface maintains its original surface characteristics even under prolonged influence of the intended use environment.
Coved	A concave surface, moulding, or other design that eliminates the usual angles of ninety degrees or less so as to prevent the accumulation of dirt and debris and facilitate cleaning.
Crew	Persons on board a conveyance that are not passengers.
Cross-connection	Any unprotected actual or potential connection or structural arrangement between a public or a consumer's potable water system and any other source or system through which it is possible to introduce into any part of the potable system any used water, industrial fluid, gas, or substance other than the intended potable water with which the system is supplied. Bypass arrangements, jumper connection, removable section, swivel or change-over devices and other temporary or permanent devices which or because of which backflow can occur are considered to be cross-connections.
Deck sink	A sink recessed into the deck, usually located at tilting kettles and pans.
Easily cleanable	Fabricated with a material, finish, and design that allows for easy and thorough cleaning with normal cleaning methods and materials.
Flashing	The capping or covering of corners, boundaries and other exposed edges of acceptable non-rat-proof material in rat-proof areas. The flashing strip must be of rat-proof material, wide enough to cover the gnawing-edges adequately and firmly fastened.
Floor sink	See deck sink.
Food contact surfaces	Surfaces of equipment and utensils with which food normally comes in contact and surfaces from which food may drain, drip, or splash back onto surfaces normally in contact with food, this includes the areas of ice machines over the ice chute to the ice bins. (See also non-food contact surfaces).
Food handling areas	Any area where food is stored, processed, prepared, or served.

Food preparation areas	Any area where food is processed, cooked, or prepared for service.
Food service areas	Any area where food is presented to passengers or crew members (excluding individual cabin service).
Food storage areas	Any area where food or food products are stored.
Grey-water	All water including drainage from galleys, dishwashers, showers, laundries, and bath and washbasin drains. It does not include sewage, medical wastewater or bilge water from the machinery spaces.
Health-based target	A benchmark to guide progress towards a predetermined health or water safety goal. There are four types of health-based targets: health outcome targets, water quality targets, performance targets and specified technology targets.
Maximum opening	The largest opening through which a rat cannot pass, applicable to both rat-proof and rat-tight areas. Regardless of the shape of the opening, it would normally be 1.25 cm (0.5 in) or less in the minimum dimension.
Non-absorbent materials	Those whose surface is resistant to the absorption of moisture.
Non-food contact surfaces	All exposed surfaces, other than food contact or splash contact surfaces, of equipment located in food storage, preparation and service areas.
Portable	A description of equipment that is readily removable or mounted on casters, gliders, or rollers; provided with a mechanical means so that it can be tilted safely for cleaning; or readily movable by one person.
Potable water	Fresh water that is intended for human consumption like drinking, washing teeth brushing, bathing, or showering; for use in fresh water recreational water environments; for use in the ship's hospital; for handling, preparing, or cooking food; and for cleaning food storage and preparation areas, utensils, and equipment. Potable water, as defined by the WHO Guidelines for Drinking-water Quality 2004 does not represent any significant risk to health over a lifetime of consumption, including different sensitivities that may occur between life stages.
Potable water tanks	All tanks in which potable water is stored from bunkering and production for distribution and use as potable water.
Rat-proof material	A material the surface and edges of which are resistant to the gnawing of rats.
Rat-proof area	An area that is completely isolated from other areas by means of rat-proof material or by design.
Readily removable	Capable of being detached from the main unit without the use of tools.
Removable	Capable of being detached from the main unit with the use of simple tools such as a screwdriver, pliers, or an open end wrench.
Scupper	A conduit or collection basin that channels water runoff to a drain.
Sealant	Material used to fill seams to prevent the entry or leakage of liquid or moisture.
Seam	An open juncture between two similar or dissimilar materials. Continuously welded junctures, ground and polished smooth, are not considered seams.
Sewage	Any liquid waste that contains human, animal or vegetable matter in suspension or solution, including liquids that contain chemicals in solution.

Ship	A seagoing or inland navigation vessel on an international or national voyage
Utility sink	Any sink located in a food service area not used for hand washing and/or dishwashing.

ACRONYMS

FSP	Food Safety Plan or Programme
GDWQ	Guidelines for Drinking-water Quality
HACCP	hazard analysis and critical control point
HPC	heterotrophic plate count
IHR	International Health Regulations
ILO	International Labour Organization
NTU	nephelometric turbidity unit
WHO	World Health Organization
WSP	Water Safety Plan

1 INTRODUCTION

1.1 Significance of ships to health

Over 100 outbreaks of infectious diseases associated with ships were reported between 1970 and 2003 (Rooney et al, 2004). Reported outbreaks included legionellosis, typhoid fever, salmonellosis, viral gastroenteritis (e.g. Norovirus), enterotoxigenic *Escherichia coli* infection, shigellosis, cryptosporidiosis and trichinosis. Naval, cargo, ferries and cruise ships were all affected, often with serious operational and financial consequences. In addition, outbreaks of influenza have been reported on board.

These reported outbreaks represent just a small proportion of the total disease burden attributable to ship-acquired disease. For every notified and reported case listed in outbreak reports, there are likely to be many more cases that go unreported.

If proper control measures are not in place, ships are particularly prone to disease outbreaks. Ships contain isolated communities with close accommodations, shared sanitary facilities and common food and water supplies. Such conditions can be favourable to the spread of infectious diseases. The inevitable publicity that comes along with a disease outbreak on board can have a serious financial impact on the ship owners and those relying on use of the ship for transport or leisure.

Ships can have significance to public health beyond their role in ship-acquired infection. For example, ships can transport infected humans and other vectors, such as mosquitoes and rats, between ports and can therefore act as a means of national and international dissemination of disease and disease agents.

It is estimated that 1.2 million seafarers are employed on ships around the world¹. As many spend months at sea, sometimes in remote regions of the world, cargo ships on long voyages contain particularly isolated communities. Good sanitary conditions on ships are crucial both to the health and welfare of seafarers.

Historically, ships have played an important role in transmitting infectious diseases around the world. The spread of cholera pandemics in the 19th century was thought to be linked to trade routes and facilitated by merchant shipping. Efforts to control the movement of human disease on ships can be traced back to the Middle Ages, when, in 1377, Venice and Rhodes denied access to ships carrying passengers infected with the plague, giving rise to the term “quarantine”. On arrival, travellers were detained in isolation for 40 days before they were allowed to proceed to their final destination. Overcrowding on ships, filth and lack of personal hygiene were often associated with epidemics of rickettsial typhus fever. Preventive measures, such as quarantine, delousing and maintaining personal cleanliness by use of soap, were gradually adopted, and the incidence of typhus decreased.

By taking sensible preventive control measures, it is possible to protect passengers, crew and the public at large from disease transmission related to ships. To the extent possible, control strategies should be targeted to minimizing contamination at source. From a public health perspective, the focus should be proactive and preventive measures rather than reactive and curative. For example:

- The design and construction of the ship should be as failsafe as possible with respect to maintaining a sanitary environment.
- The food, water and materials taken on board should be as safe as possible.
- Crew should be well trained in ship sanitation and have all the required equipment, facilities, materials and capacity to readily maintain a sanitary environment on board.
- A risk management system should be put in place and maintained to ensure the identification, reporting and mitigation of public health risks.

1.2 Scope, purpose and objective

The primary aim of the revised *Guide to Ship Sanitation* is to present the public health significance of ships in terms of disease and to highlight the importance of applying appropriate control measures. The Guide is intended to be used as a basis for the development of national approaches to controlling the hazards

¹ International Maritime Organization, Maritime Knowledge Centre, International Shipping and World Trade, Facts and Figures, October 2009

that may be encountered on ships, as well as providing a framework for policy-making and local decision-making. The Guide may also be used as reference material for regulators, ship operators and ship builders, as well as a checklist for understanding and assessing the potential health impacts of projects involving the design of ships.

In 1967, the World Health Organization (WHO) published the *Guide to Ship Sanitation*, which was subjected to minor amendments in 1987. In the past, the Guide was directly referenced in the International Health Regulations (IHR) (Article 14), and its purpose was to standardize the sanitary measures taken in relation to ships to safeguard the health of travellers and to prevent the spread of infection from one country to another.

The 1967 Guide was based on the results of a survey of 103 countries and represented a synthesis of best national practices at the time. It covered potable water supply, swimming pool safety, waste disposal, food safety and vermin control. Before publication, it was circulated to the International Labour Organization (ILO) and a number of other international agencies for comment. The Guide supplemented the requirements of the IHR 1981 and was the official global reference for health requirements for ship construction and operation.

Since 1967, a number of specific guidance documents, conventions and regulations have evolved that provide full accounts of the design and operational detail relating to ships, and many take sanitation into consideration. To some extent, these have made the purpose of the original Guide outdated, and the purpose of this revised Guide is different. The Guide is no longer explicitly referenced in the current draft of the revised IHR, hereafter referred to as IHR 2005 (WHO, 2005) (see section 1.5.1).

This document is intended to provide examples of accepted good practices. However, it is acknowledged that there may be equally effective alternative solutions that should be deployed to achieve the desired objectives. If alternative solutions are adopted, there is a need to provide objective evidence of the effectiveness of these alternatives. The primary consideration is that the results are effective.

1.3 Harmonization with other international regulations

1.3.1 International Health Regulations

The International Sanitary Regulations were developed in 1951 to prevent the spread of six infectious diseases—cholera, plague, yellow fever, smallpox, typhus and relapsing fever. These regulations were revised and renamed the International Health Regulations (IHR) in 1969.

The purpose of the IHR is “to provide security against the international spread of disease while avoiding unnecessary interference with international traffic”.

The IHR were amended in 1973 and 1981. The diseases subject to these regulations were reduced to three: plague, yellow fever and cholera. In 1995, the World Health Assembly called for the regulations to be revised. The IHR were revised and presented to the Fifty-eighth World Health Assembly on 23 May 2005 (WHO, 2005).

The IHR 2005 apply to world traffic: ships, aircraft, other conveyances, travellers and cargoes, and their primary considerations are for arrivals. Ships and aircraft are discussed specifically in the *Guide to Ship Sanitation* and *Guide to Hygiene and Sanitation in Aviation*, respectively. The Guides provide a summary of the health basis behind the IHR 2005 and help to bridge the gap between the regulation, as a legal document, and the practical aspects of implementation of appropriate practices.

International Health Regulations Articles 22 (b) and 24 (c) require State Parties to take all practicable measures to ensure that international operators keep their conveyances free from sources of contamination and infection, and that facilities at international ports are kept in sanitary condition (e.g. potable water, eating establishments, public washrooms, appropriate solid and liquid waste disposal services).

The competent authority in each State Party is responsible for the supervised removal and safe disposal of any contaminated water or food, human or animal dejecta, wastewater and any other contaminated matter from a conveyance.

International Health Regulations Annex 4 requires each ship operator to ensure that no sources of infection and contamination are found on board, including in the water system.

For this purpose, it is important that these measures be upheld on ships and at ports and that health measures are taken to ensure conveyances are free from sources of infection or contamination.

1.3.2 Standards of the International Labour Organization (ILO)

Maritime Labour Convention, 2006

The Maritime Labour Convention, 2006, adopted by the 94th (Maritime Session) of the International Labour Conference, the main body of the International Labour Organization, consolidates more than 60 existing ILO maritime labour standards, adopted by the ILO since 1919, several of which addressed issues relevant to health on board ships. Article IV, Seafarers' Employment and Social Rights, of the Maritime Labour Convention, 2006 provides, in paragraph 3, that: "Every seafarer has a right to decent working and living conditions on board ship" and, in paragraph 4, that: "Every seafarer has a right to health protection, medical care, welfare measures and other forms of social protection". The following Regulations of the Convention specifically address health issues:

- Regulation 1.2: Medical certificate provides, in paragraph 1, that "Seafarers shall not work on a ship unless they are certified as medically fit to perform their duties". The related mandatory standard sets out the requirements related to the medical examination of seafarers and the issuing of a medical certificate attesting that they are medically fit to perform the duties they are to carry out at sea.
- Regulation 3.1: Accommodation and recreational facilities provides, in paragraph 1 that "Each Member shall ensure that ships that fly its flag provide and maintain decent accommodations and recreational facilities for seafarers working and or living on board, consistent with promoting the seafarers' health and well-being". It sets out specific requirements concerning the size of rooms and other accommodation spaces; heating and ventilation; noise and vibration; sanitary facilities; lighting; and hospital accommodation. Standard A3.1, Accommodation and recreational facilities, paragraph 18, provides that "The competent authority shall require frequent inspections to be carried out on board ships, by or under the authority of the master, to ensure that seafarer accommodation is clean, decently habitable and maintained in a good state of repair. The results of each such inspection shall be recorded and be available for review".
- Regulation 3.2: Food and catering provides, in paragraph 1 that "Each Member shall ensure that ships that fly its flag carry on board and serve food and drinking water of appropriate quality, nutritional value and quantity that adequately covers the requirements of the ship and takes into account the differing cultural and religious backgrounds". Standard A3.2 provides, inter alia, that "Each Member shall ensure that ships that fly its flag meet the following minimum standards": "(b) the organization and equipment of the catering department shall be such as to permit the provision to the seafarers of adequate, varied and nutritious meals prepared and served in hygienic conditions" and "(c) catering staff shall be properly trained or instructed for their positions". There are further requirements and guidance related to proper food handling and hygiene.
- Regulation 4.1: Medical care on board ship and ashore provides, in paragraph 1 that "Each Member shall ensure that all seafarers on ships that fly its flag are covered by adequate measures for the protection of their health and that they have access to prompt and adequate medical care whilst working on board", in paragraph 3, that "Each Member shall ensure that seafarers on board ships in its territory who are in need of immediate medical care are given access to the Member's medical facilities on shore", and, in paragraph 4, that "The requirements for on-board health protection and medical care set out in the Code include standards for measures aimed at providing seafarers with health protection and medical care as comparable as possible to that which is generally available to workers ashore".

Furthermore, Regulation 5.1: Flag State responsibilities, paragraph 1, provides that "Each Member is responsible for ensuring implementation of its obligations under this Convention on ships that fly its flag", and paragraph 2 provides that "Each Member shall establish an effective system for the inspection and certification of maritime labour conditions...ensuring that the working and living conditions for seafarers on ships that fly its flag meet, and continue to meet, the standards in this Convention". Regulation 5.1.3: Maritime labour certificate and declaration of maritime labour compliance provides, in paragraph 3, that (for ships 500 gross tons and above) "Each Member shall require ships that fly its flag to carry and maintain a maritime labour certificate certifying that the working and living conditions of seafarers on the ship, including measures for ongoing compliance to be included in the declaration of maritime labour compliance...have been inspected and meet the requirements of national laws or regulations or other measures implementing this Convention", and paragraph 4 provides that "Each

Member shall require ships that fly its flag to carry and maintain a declaration of maritime labour compliance stating the national requirements implementing this Convention for the working and living conditions for seafarers and setting out the measures adopted by the ship owner to ensure compliance with the requirements on the ship or ships concerned". The flag State, or a recognized organization that has the delegated authority to do so, is required to inspect, among other things, accommodation, food and catering and on-board medical care before issuing the certificate, which is valid for period that shall not exceed five years (interim and intermediate certificates are also prescribed).

Work in Fishing Convention (No. 188) and Recommendation (No. 199), 2007

These instruments apply to fishers and fishing vessels and set out requirements and guidance on the issues of medical examination and certification of fishers; accommodation (including requirements aimed at ensuring vessels are constructed to be both safe and healthy) and food on board fishing vessels; medical care at sea; and access to medical care ashore. Annex III, paragraph 83, provides that "For vessels of 24 meters in length and over, the competent authority shall require frequent inspections to be carried out, by or under the authority of the skipper, to ensure that: (a) accommodation is clean, decently habitable and safe, and is maintained in a good state of repair; (b) food and water supplies are sufficient; and (c) galley and food storage spaces and equipment are hygienic and in a proper state of repair", and that "The results of such inspections, and the actions taken to address any deficiencies found, shall be recorded and available for review".

Consideration of the ILO standards

It is highly recommended that those involved in the design, construction, operation and inspection of ships, including port health officials, become fully aware of the provisions of the Maritime Labour Convention, 2006 and Work in Fishing Convention and Recommendation, as these standards are the basis for flag and port State control of living and working conditions of merchant ships and fishing vessels. The full texts of these instruments are available on the ILO web site at www.ilo.org.

International Maritime Organization

The International Maritime Organisation is a specialized agency of the United Nations and is based in the United Kingdom with around 300 international staff. The Convention establishing the International Maritime Organization (IMO) was adopted in Geneva in 1948 and IMO first met in 1959. IMO's main task has been to develop and maintain a comprehensive regulatory framework for shipping and its remit today includes safety, environmental concerns, legal matters, technical co-operation, [maritime security](#) and the efficiency of shipping. (Ref www.imo.org)

1.4 Roles and responsibilities

Infectious diseases on board may contribute to a considerable toll on the operational capacity of ships and in extreme circumstances become impediments to international commerce and travel. The prevention of such incidents and the proper response should they occur are a top priority for all those responsible for ship design, construction and operation.

There are distinct roles for the different organizations and individuals in maintaining good sanitation on ships. However, the objective of good ship sanitation is a common one that requires all to play their part. From design, through construction, procurement, operation and docking, all professionals involved in shipping have an important role to play within the preventative risk management approach to protecting passengers, crew, port populations and international communities from harm.

The major roles of accountability on board that relate to maintaining a safe environment for passengers and crew are assigned to the owner, operator, engineer, master and medical personnel. These roles and responsibilities are briefly outlined below.

1.4.1 Designer/constructor

Good sanitary design greatly reduces the chances of poor health outcomes arising on board or when the ship is in contact with external risks at port. Therefore, those who design and construct ships need to ensure that their ships can be readily operated in a sanitary manner.

The construction and layout of the ship must be suitable for its intended purposes. This requires attention to important details of design and construction that affect ship sanitation. The better and more failsafe a

ship's sanitary design, the easier it is for the owner/operator to minimize the inherent risk. On the other hand, a ship's design that has many flaws and places excessive reliance on operational practices is likely to lead to outbreaks.

In general, design and construction of ships and associated equipment should meet internationally accepted standards, e.g. various IMO standards, Codex alimentarius and ISO-Standards.

1.4.2 Owner/operator

Upon receiving a ship, the owner should ensure compliance with sanitary design standards that support sanitary ship operation. Examples include the need to ensure that clean food and water must be physically separated from waste and the need to ensure that design capacities for facilities such as recreational water environments are adequate. Responsibility for ensuring that a ship received is designed and built in a manner that does not expose passengers and crew to unacceptable health risks rests with the ship owner. The owner bears the ongoing responsibility for ensuring that the ship design is fit for its intended purpose.

Responsibility for ensuring that the ship can be operated in a manner that provides a safe environment for passengers and crew rests with the ship operator. The operator must ensure that there are adequate and properly maintained equipment and provisions, with sufficient trained crew to properly manage health risks on board.

1.4.3 Master/crew

According to IMO's International Management Code for the Safe Operation of Ships and for Pollution Prevention the ultimate responsibility for all aspects of crew safety on board is vested with the ship's master, as delegated by the operator. Responsibilities are often delegated such that they effectively become shared, although not abrogated, via the chain of command. The master must ensure that all reasonable measures are taken to protect crew and passenger health. The conscientious and diligent monitoring of operational control measures is the responsibility of the master and crew.

The ship's engineer is likely to be chiefly responsible, as delegated by the master, for the proper operation of the engineered systems that protect passenger and crew safety. This includes many aspects of the ship's operation, including the cooling and heating systems designed to maintain food and water at safe temperatures, water treatment systems for drinking, waste management and the integrity of piping and storage systems.

1.4.4 Port authorities

A responsibility of port authorities is to provide the required equipment, facilities, expertise and materials so that ships can undertake operations (e.g. providing safe food and water, safely removing ballast and waste) in a sanitary manner. One or more agencies may fulfil the roles of the Port Authority, Health Authority and Competent Authority of a flag state under the IMO.

Prevention of contamination at source to the maximum degree practicable is a key tenet of preventive control strategies. Since ships load at ports, the port authorities play a vital role in protecting public health by seeking to provide the best practicable raw materials for ships. Authorities should clarify which entity has the Ship Sanitation Certificate and food inspection responsibilities.

1.5 Structure of the Guide to Ship Sanitation

The Guide is structured into the following chapters:

- Chapter 1. Introduction
- Chapter 2. Water
- Chapter 3. Food
- Chapter 4. Recreational Water Environments
- Chapter 5. Ballast Water
- Chapter 6. Waste Management and Disposal
- Chapter 7. Vector and Reservoir Control

- Chapter 8. Controlling Infectious Disease Agents in the Environment

Chapter 1, Introduction, sets the Guide in its legal context, considering the IHR and describing its relationship to other international documents, regulations and standards.

Each of Chapters 2–7 follows the same structural approach, consisting of two sections: Background and Guidelines.

The “Background” section describes critical issues and supporting health evidence applicable to ships and the specific topic of the chapter.

The “Guidelines” section in each chapter provides user-targeted information and guidance applicable to the topic of the chapter, identifying responsibilities and providing examples of practices that should control risks. This section contains a number of specific **Guidelines** (a situation to aim for and maintain), each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action).

2 WATER

2.1 Background

Improperly managed water is an established infectious disease transmission route on ships. The importance of water was illustrated in the review of over 100 outbreaks associated with ships undertaken by Rooney et al., (2004), in which one fifth were attributed to a waterborne route. This is probably an underestimate, since over one third of the 100 reviewed outbreaks could not be associated with any specific exposure route, so some may have been waterborne. Furthermore, water may be a source of index cases of disease that might then be transmitted via other routes.

Most waterborne outbreaks of disease on ships involve ingestion of water contaminated with pathogens derived from human or animal excreta. Illnesses due to chemical poisoning of water have also occurred on ships, although chemical incidents are much less commonly reported than microbial ones.

To protect the health of passengers and crew, water used for potable purposes on board should be provided with sanitary safeguards in a multiple barrier system, (from the shore and distribution system, including connections to the ship system, through the ship treatment and storage systems and on to each water supply outlet), in order to prevent contamination or pollution during ship operation.

Waterborne outbreaks have been associated with bunkering water of poor quality. Therefore, the first waterborne disease prevention strategy should be to load ships with water that conforms to the WHO Guidelines for Drinking-water Quality (WHO 2004a), as amended, or relevant national standards, whichever is stricter.

Even if the water at the port is safe, that does not ensure that it will remain safe during the transfer and storage activities that follow. An understanding of the ship drinking-water supply and transfer chain will help to illustrate the points at which the water can become contaminated en route to the taps on board.

Generally, the ship drinking-water supply and transfer chain consists of three major components (Figure 2-1):

1. the **source** of water coming into the port;
2. the **transfer and delivery system**, which includes hydrants, hoses, water boats and water barges. This water transfer process provides multiple opportunities for the introduction of contaminants into the drinking-water; and
3. the **ship water system**, which includes storage, distribution and on board production of drinking water from overboard sources, such as seawater.

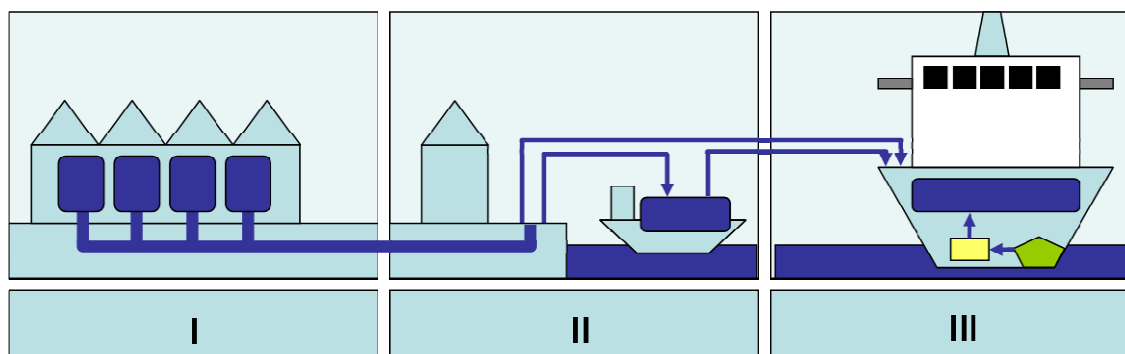


Figure 2-1. Schematic of ship drinking-water supply chain.

2.1.1 Standards related to potable water

The WHO *Guidelines for Drinking-water Quality* (WHO, 2004a) (hereinafter GDWQ) describe reasonable minimum requirements for safe practices to protect the health of consumers and derive numerical guideline values for constituents of water or indicators of water quality. Neither the minimum requirements for safe practices nor the numerical guideline values are mandatory limits, but rather health-based guidance to national authorities to establish their own enforceable standards, which may also consider other factors. In order to define such limits, it is necessary to consider the GDWQ in the context of local or national environmental, social, economic and cultural conditions. Nevertheless, given

the global nature of ship travel and the need for ships to board water from areas with variable and possibly inadequate standards of general hygiene and sanitation, the GDWQ (or national standards if more stringent) should be followed. This approach will provide passengers and crew with consistent reliable protection from the potential risks posed by contaminated drinking-water.

The GDWQ provide comprehensive guidance to ensure the quality and safety of drinking-water. Microbial risks in water on board ships are the principal concerns, although a few risks associated with toxic chemicals also exist.

The WHO *Guidelines for Drinking-water Quality* (WHO, 2004a) (GDWQ) identify the broad spectrum of contaminants, including microorganisms, inorganic and synthetic organic chemicals, disinfection by-products and radionuclides, that can reach hazardous concentrations in potable water supplies and describe systematic approaches to risk management. As a general definition, safe drinking-water, as defined by the GDWQ, does not represent any significant risk to health over a lifetime of consumption, including different sensitivities that may occur between life stages.

The ILO Convention C133 (C133 Accommodation of Crews (Supplementary Provisions) Convention, 1970) defines minimum standards, has been ratified by many states, and will be included in future in the Maritime Labour Convention 2006 (MLC).

The MLC provides comprehensive rights and protections at work for seafarers. The new labour standard consolidates and updates more than 65 international labour standards related to seafarers adopted over the last 80 years. Regulation

3.2 of the MLC includes requirements for drinking water on board.

In IMO's Life Saving Appliance Code (LSA-Code) additional information about potable water requirements in rescue boats are defined.

Reference should be made to six important international standards in relation to sanitary design and construction of ship water supplies and potable water quality assessment (www.iso.org):

- ISO 15748-1: 2002 – Ships and marine technology – Potable water supply on ships and marine structures – Part 1: Planning and design.
- ISO 15748-2: 2002 – Ships and marine technology – Potable water supply on ships and marine structures – Part 2: Method of calculation.
- ISO 19458:2006 – Water quality – Sampling for microbiological analysis.
- ISO 14726:2008 – Ships and marine technology – Identification colours for the content of piping systems.
- ISO/IEC 17025:2005 – General requirements for the competence of testing and calibration laboratories.
- ISO 5620-1/2: 1992 – Shipbuilding and marine structures – Filling connection for drinking water tanks.

2.1.2 Role of the International Health Regulations (2005)

The International Health Regulations (IHR (2005)) has provision for the State Party to designate ports to develop core capacities, such as the provision of a safe environment for travellers using port facilities, including eating establishments (Annex 1 B 1 (d) of the IHR (2005)).

In accordance with Articles 22(b) and 24(c) of the IHR (2005), States are required to take all practicable measures to ensure that international conveyance operators keep their conveyances free from sources of contamination and infection, and that the facilities at international ports are in sanitary condition and be responsible for the removal and safe disposal of any contaminated water and food from a conveyance.

However, it is the responsibility of each ship operator to establish all practicable measures to ensure that no sources of infection and contamination are present on board, including in the water system. For this purpose, it is important that regulations and standards are upheld on board ships and at ports, in terms of the safety of food and water served on board, from the source of supply ashore to distribution on board ship.

2.1.3 Potable water sources from ashore and uses on board ships

A port may receive potable water from either a municipal or private supply and usually has special arrangements for managing this water after it has entered the port.

Potable water is used in various ways on board ships, including direct human consumption, food preparation and sanitation/hygiene activities. Potential uses include:

- preparation of hot and cold beverages, such as coffee, tea and powdered beverages;
- ice cubes in drinks;
- reconstitution of dehydrated foods, such as soups, noodles and infant formula;
- food washing and preparation;
- direct ingestion from cold water taps and water fountains;
- reconstitution and/or ingestion of medications;
- brushing of teeth;
- hand and face washing, bathing and showering;
- dishwashing, cleaning of utensils and work areas;
- laundering purposes (could potentially use a lower grade of water); and
- emergency medical use.

Although some uses do not necessitate consumption, they involve human contact and possibly incidental ingestion (e.g. tooth brushing).

Although, whenever practicable, it is useful to have only one water system installed to supply potable water for drinking, culinary, dishwashing, ablutionary and laundering purposes, two or three systems are sometimes installed or required: potable, sanitary and wash water, for example. A wash water system, can be used to supply slop sinks, laundry facilities, water closets, bibcock connections for deck flushing and cleaning purposes, heated water for dishwashing and water for other special uses. All non-potable water taps need to be labelled with words such as “UNFIT FOR DRINKING”. There should never be a connection between wash water or other non-potable systems and the potable water system without using an appropriate backflow prevention device.

2.1.4 Health risks associated with potable water on ships

Some of the causal hazardous agents associated with waterborne disease outbreaks on board ships are listed in Table 2-1. Note that in some waterborne outbreaks, the causative agent was not identified.

Table 2-1. Pathogens and toxins linked to outbreaks of waterborne disease associated with ships, January 1, 1970-June 30, 2003

Pathogens/toxins	Number of outbreaks	Number of passengers and crew members affected
Enterotoxigenic <i>Escherichia coli</i>	7	2 917
Norovirus	3	788
<i>Salmonella typhi</i>	1	83
<i>Salmonella</i> spp.	1	292
<i>Shigella</i> sp.	1	690
<i>Cryptosporidium</i> sp.	1	42
<i>Giardia lamblia</i>	1	200
Unknown agent	5	849

Chemical water poisoning	1	544
Total	21	6 402

Source: Rooney et al., (2004).

Outbreaks were associated with causes such as:

- contaminated water supplied at the port;
- contaminated bunkered water;
- cross-connections between potable and non-potable water;
- poor design and construction of potable water storage tanks; and
- inadequate disinfection.

Some ports were found not to have supplied a safe source of water. In these cases contaminated water bunkered from port was associated with a number of outbreaks due to enterotoxigenic *E. coli*, *Giardia lamblia* and *Cryptosporidium*.

Space is often very limited on ships. Potable water systems are likely to be physically close to hazardous substances, such as sewage or waste streams, increasing the chance of cross-connections. Cold water systems may be close to sources of heat, and this elevated temperature increases the risk of *Legionella* spp. proliferation and the growth of other microbial life.

In considering evidence from outbreaks, presence of pathogens generally transmitted to humans from other human sources (viral pathogens and *Shigella* spp.) indicates that sewage is one of the more common sources that cause waterborne disease outbreaks on ships.

Legionnaires' disease is perhaps the most widely known form of legionellosis and is a form of pneumonia acquired from inhaling aerosols of water that contain excessive *Legionella* spp. bacteria. Ships are considered high-risk environments for proliferation of *Legionella* spp. for a variety of reasons. Firstly, source water quality could be of a potential health concern if untreated or subject only to treatment with a residual disinfectant prior to or upon bunkering. Secondly, water storage and distribution systems on ships are complex and could provide greater opportunities for bacterial contamination, as ship movement increases risk of surge and back-siphonage. Thirdly, potable water may vary in temperature (e.g. due to high temperatures in the engine room). In some tropical regions, risk of bacterial growth and occurrence of *Legionella* spp. contamination in cold-water-systems are increased because of higher water temperatures. Finally, proliferation is encouraged due to long-term storage and stagnation in tanks or pipes. Importantly, *Legionella* spp. can proliferate in warm water temperatures between 25°C and 50°C, such as those experienced in shower heads and spa pools, leading to potential exposure through aerosolization arising from showers and other plumbing fixtures. Many cases of Legionnaires' disease associated with ships are linked to whirlpool spas (WHO, 2001; see also Chapter 4). *Legionella pneumophila* has been found to be present in drinking water systems on general cargo ships (Temeshnikova et al., 1996).

The production of water on ships can be associated with its own potential health problems. Ships can produce their own water by several different processes such as reverse osmosis or evaporation of seawater. Desalination demineralizes seawater, which makes it corrosive, shortening the life of containers and conduits, and which may have health impacts associated with insufficient minerals in seafarers diet or consumption of dissolved metals (such as lead, nickel, iron, cadmium or copper) from corrosion products. Desalinated water may also be considered bland, flavourless and unacceptable by passengers and crew.

Evaporation systems on board are supplied with seawater that has been sucked in through so-called sea chests and is typically led directly into the evaporator. In the evaporator the seawater that is heated by the engine cooling water typically starts boiling at low temperatures (< 80°C) due to low pressure within these systems. When these low process temperatures are used, there is no guarantee of getting water free of pathogens. According to ISO-Standards water that has been produced below 80°C needs to be disinfected before it can be defined as potable water. The emerging steam condenses as distillate inside the evaporator. This distillate is collected and flows to further treatment components. It should be considered, that the distillate is free of any minerals and almost free of carbon dioxide. As a result, it is

necessary to add carbon dioxide into the distilled water to prepare it for the rehardening process.

Reverse osmosis involves pretreatment and the transport of water across membranes under pressure so that salts are excluded. Post-treatment may also occur prior to distribution. Partial desalination or breaches in membranes may have potential health implications due to trace elements and organic compounds occurring within the source seawater, including oil and refined petroleum products. In addition, seawater sources may contain hazards not encountered in freshwater systems. These include diverse harmful algae and cyanobacteria, certain free-living bacteria (including *Vibrio* species such as *V. parahaemolyticus* and *V. cholerae*) and some chemicals, such as boron and bromide, which are more abundant in seawater.

Repair work on a treatment and distribution system can offer several opportunities for widespread contamination of water supplies. Ship operators should take special precautions when carrying out repairs to storage tanks. For example, an outbreak of typhoid on a ship occurred after the potable water was contaminated with sewage while the ship underwent repairs in dry dock. The need for good hygienic practice and post-repair cleaning and disinfection is necessary. Ship builders and rehabilitators typically have written procedures for physical cleaning and disinfection before commissioning or recommissioning ships.

2.1.5 Bottled water and ice

Bottled water is considered as drinking-water by some regulatory agencies and as a food by others (WHO, 2004a). International bottled water quality specifications exist under the Codex Alimentarius Commission (FAO/WHO, 2001) and are derived from the GDWQ (WHO, 2004a). Since it is commonly designated as a food product, bottled water is considered in Chapter 3 on food.

Within this Guide, ice supplied to ships or manufactured on board for both drinking and cooling is classified as “food”. Guidance pertaining to ice used on ships is contained in Chapter 3. The GDWQ (WHO, 2004a) apply to both packaged water and ice intended for human consumption.

2.1.6 Definitions, overview and objectives of water safety plans

Water safety plans (WSPs) are an effective overarching management approach for assuring the safety of a drinking-water supply. WSPs are equivalent to Food Safety Plans (or Programmes) incorporating Hazard Analysis and Critical Control Points (HACCP) implemented as part of food safety management (see Chapter 3). As discussed, a potable water source at the port is not a guarantee of safe water on board because water may become contaminated during transfer to the ship or during storage or distribution on board. A WSP covering water management within ports from receipt of water through to its transfer to the ship, complemented by water quality measures on board, provides a framework for water safety in ships. A general overview of WSPs follows; their specific application to the safety of drinking-water on board ships will be described in section 2.2. A WSP has three key components, guided by health-based targets and overseen through drinking-water supply chain surveillance. They are:

- **system assessments**, which include:
 - description of the water supply system in order to determine whether the drinking-water supply chain (up to the point of consumption) as a whole can deliver water of a quality that meets health-based targets;
 - identification of hazards and evaluation of risks;
 - determination of control measures, reassessment and prioritization of risks;
 - development, implementation and maintenance of an improvement plan;
- **operational monitoring**, which includes identification of control measures that will ensure risks are maintained along with critical limits and operational monitoring;
- **management and communication**, including verification, preparation of management procedures and developing supporting programmes to manage people and processes, including upgrade and improvement.

The various steps involved in designing and implementing a WSP are illustrated in Figure 2-1. For more information on general principles of WSPs, see section 6.7.1 of the GDWQ (WHO, 2004a) and the *Water safety plan manual* (WHO, 2009).

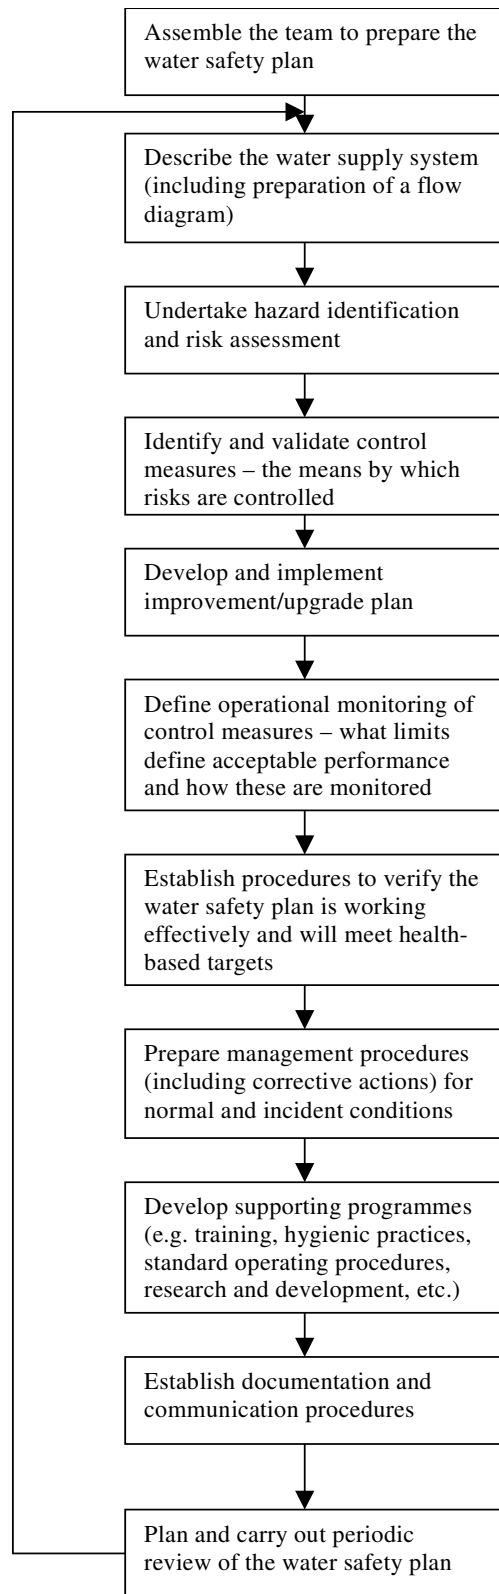


Figure 2-2. Application of water safety plans.

2.2 Guidelines

2.2.1 Guideline 2.1 Water Safety Plan for shore supplies and bunker boats or barges

Guideline 2.1— A water safety plan has been designed and implemented for the port water source, for the bunker boats or barges and for the delivery system to the ship.

Indicators for Guideline 2.1

1. A potable water system assessment has been carried out with risks and control points identified
2. Operational monitoring including operational limits and target criteria have been defined for the port water system and bunker boats or barges and corrective action plans developed
3. Management systems, including record keeping, validation and verification as well as communication have been included in the water safety plan of the port water system and bunker boats or barges

Guidance notes for Guideline 2.1

The GDWQ are intended to cover a broad range of water supplies and are not specifically targeted towards ships. Therefore, in drawing from their guidance, the specific context of the port and the ship needs to be taken into consideration. The overall approach promoted, involving the development and implementation of a WSP (WHO, 2004a; WHO, 2009), is as relevant to ships and ports as to any other water supply situation.

Roles and responsibilities

A WSP is an effective means of achieving consistency in assuring the safety of a drinking-water supply. The entity responsible for each component of the drinking-water supply chain (i.e. port water source, shore water distribution system, transfer and delivery system and ship water system) should be responsible for the preparation and implementation of a WSP for that part of the process. Examples of roles and responsibilities for each component are as follows:

Source water supplier (public or private): Role is to provide to the port a safe water supply of sufficient quantity and quality. Responsibilities are to monitor the water system by sampling water and providing sampling results to the port authority on request, informing the port authority of any adverse results and action to be taken, with the obligation to inform the port authority when the water supply has or may become contaminated. This is typically the municipal water supplier for the area in which the port is located.

Port operator & water supply: Role is to maintain the integrity of water supplied throughout the shore water distribution system and to provide safe water to the ship. Responsibilities are to maintain a safe water supply from the shore water distribution system through delivery to the ship, to monitor the water system and share sampling results with the water supplier, authorities and appropriate stakeholders, and to take corrective action as necessary.

1. System assessment for port water system, water boats and barges and delivery to the ship

Potable water for ships, including water boats and barges, needs to be obtained only from those water sources and supplies that provide potable water of a quality which meets the standards recommended in the GDWQ (WHO, 2004a) or national standards, whichever is the stricter. Particular attention to microbial water quality should occur as well as physical and chemical requirements.

Water is delivered to ships by hoses on the dockside or transferred to the ship by water boats or barges. Designated filling hoses must be provided at each pier or wharf for the use of ships not equipped with these designated filling hoses. Facilities for the direct delivery of water from shore sources to the filling line for the ship's potable water system include piping, hydrants, hoses and any other equipment necessary.

Plans for the construction or replacement of facilities for bunkering potable water on board must be

submitted to the competent authority for review. Plans must show the location and size of the distribution lines, location and type of check valves or backflow preventers, location and type of hydrants, including details of outlets protection, and storage lockers for filling hoses and attachments.

In some instances, local source water contamination may indicate the presence of protozoan pathogens such as *Cryptosporidium* or viruses, whose presence may not be well indicated by *E. coli* or thermotolerant (faecal) coliforms, and that require more stringent treatment. Based upon the findings of the WSP, additional controls and measurements may be necessary. Some disinfectants are effective at inactivating *E. coli*, but not *Cryptosporidium* or viruses. For instance, typical doses of chlorine or chloramine are ineffective against *Cryptosporidium* so membrane filtration or UV might need to be used; commonly used doses of ultraviolet disinfection are of limited value in controlling viruses, so higher ultraviolet doses or free chlorine may need to be used.

2. Guidelines for operational limits, control measures, corrective action and verification

Disinfection

The water supply delivered to ports must be suitable for distribution and consumption without further treatment, except as necessary to maintain water quality in the distribution system (e.g. supplemental disinfection, addition of corrosion control chemicals). A disinfectant residual should be detectable in water samples at the port, on the water barge and on the ship. Presence of a measurable disinfectant residual contributes to assuring that water is microbiologically safe for the intended use. Presence of the residual will be affected by the original dose, type of disinfectant used, disinfectant demand, temperature, and pH of the water, and time since application. A significant reduction in disinfectant residual may also indicate post treatment contamination.

New or repaired facilities must be disinfected before they are returned to service.

In the event of contamination of the water provided to the port, the port must complete corrective action and notify the party responsible for bunkering water as soon as possible to enable mitigation or prevention of contaminated water being transported onto ships.

Prevention of backflow and cross-contamination

The lines' capacity should maintain positive pressure at all times to reduce the risk of backflow. There must be no connections between the potable water system and other piping systems. All fittings, meters and other appurtenances used for bunkering of potable water need to be handled and stored in a sanitary manner. Inlets and outlets of potable water meters are typically capped when not in use.

Approved backflow preventers need to be properly installed between the ship and shore systems to permit effective operation and inspection. Drainage to prevent freezing may be needed.

Non-potable water hydrants are not normally located on the same pier as hydrants for potable water unless absolutely necessary. Potable water hydrants must be identified with signs such as "POTABLE WATER" and non-potable water hydrants with signs marked "NON-POTABLE WATER". Hydrants need to be adequately covered and located not to receive discharge from the waste of a ship. Drainage lines from supply lines or hydrants (or taps and faucets) should terminate above normal high-water level or the surge of water from incoming ships. Where compressed air is used to blow water out of lines and hydrants, a filter, liquid trap or similar device must be installed in the supply line from the compressed air system to protect water supply.

Water barges or boats

Water boats and barges are ships especially constructed and equipped to receive and provide water for both potable and non-potable water systems on board ships when direct shore delivery is not practicable. These boats have water tanks, water hoses and fittings, pumps and independent pipe systems to provide potable water to on board systems.

The reception, handling, storage and delivery to ship water systems needs to be carried out under completely sanitary conditions. All hoses, fittings and tools need to be stored in designated lockers which are closed and clean. Operators need to possess knowledge of water hygiene and good sanitary practice.

Facilities for disinfection, when and where necessary on board, need to be available. Regular cleaning and disinfection of hoses and fittings should be performed. Plans for construction of ships must show filling

lines, storage tanks, pumping equipment and protective measures for approval by the port health authority or other designated authority.

In the event of contamination of potable water at the delivery point or on the water boat or barge, the party responsible for transfer of the water must complete corrective action and notify the ship's operator as soon as possible so that they can take measures or prevent contaminated water being transported onto the ship.

3. Monitoring and verification

By far the greatest risks in drinking-water are associated with microbial contamination from human excreta sources. Monitoring source water at the port is carried out to ensure water is safe. Recommended parameters to be monitored include *Escherichia coli* (*E. coli*) or thermotolerant (faecal) coliforms, disinfectant residual, corrosion-related contaminants, turbidity, heterotrophic plate count (HPC) and aesthetic parameters. *E. coli* or thermotolerant (faecal) coliforms are utilized as the indicators of potential contamination from pathogens associated with human excreta. Total coliforms are not necessarily indicators of faecal contamination, but may reflect a lack of general cleanliness. *E. coli* and thermotolerant (faecal) coliforms should be measured using generally accepted analytical techniques. HPC should be measured to provide an overview of the general status of microbial life in the system.

Faecal indicators such as *E. coli* or thermotolerant (faecal) coliforms are valuable for ongoing verification or for batch testing of water that is on hold, but are of limited use for operational monitoring of water supplied on the ship, as even very brief exposure to unsafe water can lead to an outbreak. The tests typically take 18 to 24 hours to report by which time water may have been consumed. No *E. coli* or thermotolerant (faecal) coliforms should be detected in any 100 ml sample of the water. A positive test may indicate potential pathogenic (primarily bacterial) microorganisms associated with excreta, suggesting recent or substantial post-treatment faecal contamination or inadequate treatment.

It is important to check turbidity levels of the source water, as high levels of turbidity can protect microorganisms from disinfection, stimulate growth of bacteria and cause a significant disinfectant demand. In case of high turbidity, filtration can help to solve an acute problem but the reason for high turbidity should be found to avoid further problems.

Provided water entering the port conforms to acceptable standards, the principal concern regarding chemical contamination is likely to be metals leaching from the shore water distribution system. Corrosion in plumbing systems is a function of the stability and aggressiveness of the water towards the surfaces and fixtures that the water will contact during transport and storage. Metals such as lead, nickel, iron, cadmium or copper can be leached from some materials into the water and adversely affect taste or, in some cases, lead to health concerns. The need to monitor other chemicals of concern should be determined, depending on the local situation. All samples should meet GDWQ or national standards for chemicals as there are potentially significant effects from chronic exposures.

Documentation of monitoring should be kept for assurance and analysis in the event of an incident.

2.2.2 Guideline 2.2 Water quantity.

Guideline 2.2—Potable water is available in sufficient quantities.

Indicators for Guideline 2.2

1. Potable water quantities at the port are sufficient to ensure adequate pressure at all taps to minimize potential for contamination.
2. Potable water quantities on board are sufficient to meet foreseeable needs for all purposes (e.g. drinking, food preparation, sanitation and hygiene activities) and to achieve sufficient water pressure at each tap to minimize the potential for contamination.

Guidance note for Guideline 2.2

In providing adequate storage for potable water, consideration needs to be given to the size of the ship's complement of officers and crew, the maximum number of passengers accommodated, the time and distance between ports with potable water sources, and the availability of water suitable for treatment on board. Sufficient storage is needed to preclude the need for treating overboard water from heavily contaminated areas and to allow time for maintenance and repair.

The amount of storage may be decreased if the potable water supply can be supplemented by water purified on board to adequate safety standards.

An insufficient or non-existent quantity of potable water under pressure on board for drinking, culinary purposes and personal hygiene can have an impact on the health and welfare of passengers and crew. However, the amount of water required for these purposes should be adequately dealt with in typical ship designs. In no case should potable water storage be less than a reasonable base level that would allow water to be supplied during treatment system maintenance or repair, typically a two-day supply.

2.2.3 Guideline 2.3 Water Safety Plan for ship water supply.

Guideline 2.3—Water safety plan has been designed and implemented for the ship water system.

Indicators for Guideline 2.3

1. A potable water system assessment has been carried out with risks and control points identified
2. Operational monitoring including operational limits and health related targets have been defined for the ships water supply system and corrective action plans developed, where necessary
3. Management systems including documentation, validation and verification as well as communication have been included in the ship Water Safety Plan

Examples of hazards, control measures, monitoring procedures and corrective actions taken as part of a WSP for the ship water supply system are given in Annex A.

Guidance notes for Guideline 2.3

Roles and Responsibility of Ship Operator

The ship operator's role is to provide a safe water supply to passengers and crew fit for all intended purposes. Water on board should be kept clean and free of pathogenic organisms and harmful chemicals. Responsibilities are to monitor the water system, particularly for microbial and chemical indicators, to share sampling results with stakeholders, to report adverse results to the competent authority where required and to take corrective action. Adverse results should also be communicated to the crew and passengers when and where necessary. Where there are methods or materials advised by WHO for particular tests, these should be applied.

The ship's master or officer responsible for bunkering water must be responsible for ascertaining whether or not the source of water is potable. All staff should be encouraged to report symptoms indicating a potential waterborne disease. The ship's operator needs to provide adequate toilet and washing facilities for the crew to maintain personal hygiene. Known carriers of communicable diseases should never come into contact with potable water supplies. An adequate ratio of crew to facilities is required on board ship to enable proper servicing and maintenance activities. Minimum requirements can be found in ILO Convention 133 and the Maritime Labour Convention. The term "fresh water" used in ILO Conventions and MLC should be interpreted as potable water. To reduce disease spread among crew, shared drinking receptacles are not safe for use on ships unless they are sanitized between uses.

1. Assessment of the ship potable water system - *Hazards and hazardous events*

The ship operator should be aware of all hazards (biological, chemical or physical) and hazardous events that may occur in port water, when transferring water from port to ship or when water is produced on board. All potential hazards and hazardous events should be assessed within the Water Safety Plan. Knowledge of these hazards may be obtained from various sources, including data on water quality from the port health authority or epidemiological data on waterborne disease in the region of concern.

Outbreaks of illness due to toxic chemicals are much less frequent than those due to microbial hazards. Nevertheless, passengers and crew may be exposed to chemical contaminants in drinking-water over extended periods of time. These contaminants may have been present in the source water, be introduced into the water from leaching of components within the ship water distribution system or be present in water produced on board, such as boron and bromide from improperly treated seawater. Therefore, water on board should meet the GDWQ (or national standards if more stringent), for chemicals of concern (see also Guideline 2.2, No. 4, below).

Corrosion in plumbing systems is a function of the stability and aggressiveness of the water towards the surfaces and fixtures that the water will contact during transport and storage. Desalinated water produced on board ships may be corrosive, for example, and salt water and saline atmosphere may have corrosive effects on fixtures.

2. Operational monitoring (including control measures, operational limits and corrective actions)

Source of potable water

Potable water for ships needs to be obtained only from water sources and water supplies that provide potable water of a quality in line with standards recommended in the GDWQ (WHO, 2004a) or national standards if more stringent, specifically in relation to microbial, chemical, physical and radiological requirements.

The ship's operator must seek assurance as to the quality and nature of the source water before bunkering. Ship operators may choose to directly engage with port and local authorities to investigate levels of safety. If water is suspected to come from an unsafe source, testing for contamination may be necessary. If water provided at the port does not meet the GDWQ (or national requirements if more strict), the port will need to utilize an alternative higher-quality source. Terminal disinfection is a treatment step and, where a residual disinfectant is required, a final safeguard.

Ships using ports where water treatment is unreliable must carry equipment for basic testing (turbidity, pH and disinfectant residual) and ensure capacity to dose disinfectant or filter to appropriate levels to provide a minimum level of safety.

Detection of aesthetic parameters (odour/colour/taste) may indicate cross-connections with the liquid waste system or other potential contamination problems and should be investigated.

Bunkering stations

To mitigate risks during bunkering potable water, multiple barrier protection should be established. This starts with the use of appropriate hoses and fixtures, backflow preventers and filters at the bunker station and chlorination before water enters the storage tank. To help protect the quality of water passing through filling hoses, they should be durable, with a smooth, impervious lining, and equipped with fittings, designed to permit connection to the shore water supply system. Interior surfaces of potable water hoses should be made of material suitable for being disinfected and should not support the growth of biofilm. Hoses that are designed to be used for fire fighting are not appropriate to be used as potable water hoses. Potable water hoses should be clearly identifiable with words such as "POTABLE WATER". Hoses used exclusively for the delivery of potable water should be kept on each ship. The ends should be capped when not in use. Keeper chains will prevent misplacement of caps. The hose needs to be handled to prevent contamination by dragging ends on the ground, pier or deck surfaces or by dropping into the harbour water. A hose that has become contaminated should be thoroughly flushed and disinfected. The hose must be flushed in all cases before attaching to the filling line. It must be drained and dried after each use.

The filling hoses should be stowed, with the ends capped, in special lockers designated and marked "POTABLE WATER HOSE ONLY". Lockers must be closed, self-draining and fixed above the deck. The lockers should be constructed from smooth, non-toxic, corrosion-resistant and easily cleanable material. Hoses and fittings need to be maintained in good repair.

Non-potable water, if used on the ship, should be bunkered through separate piping using fittings incompatible for potable water bunkering. This water should flow through a completely different piping system and be identified with a different colour.

To provide for safe bunkering, every potable water tank must have a dedicated, clean filling line to which a hose can be attached. To avoid accidental connections of sewage hoses, the flange of this filling line should meet the criteria defined in ISO 5620-1/2. To prevent contamination of water, the filling line needs to be positioned a suitable distance above the top of the tank or of the deck that the line penetrates and is typically painted or marked in blue and labelled "POTABLE WATER FILLING". The filling line can have a screw cap or plug fastened by a chain to an adjacent bulkhead or surface in such a manner that the cap or plug will not touch the deck when hanging free. Lines to divert potable water to other systems by valves or interchangeable pipe fittings are not generally considered acceptable, except where an air gap follows a valve. If only one filling line is used to load potable water to all tanks, a direct connection

between the potable water tank and other tanks through an air gap is a satisfactory practice. To avoid intake of unwanted particles, a filter can be used in the filling line. These filters need to be backwashed or exchanged regularly according to manufacturers' instructions. All potable water passing through the potable water filling line should pass an automatic chlorination unit before it enters the potable water tanks.

Water production on board

To help prevent cross contamination, when seawater is to be treated on board for use as potable water, the overboard discharges should not be on the same side as the water intake. When it is not practicable to locate the overboard discharges on the opposite side of the ship, they should be located as far aft of, and as far above, the water intake as practicable.

Water may be produced on ships by desalination, reverse osmosis or distillation. A complete desalination process demineralises seawater. This makes it corrosive, shortening the life of containers and conduits, and may have health impacts associated with insufficient minerals in the diet of seafarers and skin irritations. Therefore, water produced by desalination is termed "aggressive". Special consideration needs to be given to the quality of such materials, and normal procedures for certification of materials as suitable for potable water use may not be adequate for water not "stabilized".

An evaporating plant that distils seawater and supplies water to the potable water system must be of such a design to produce potable water reliably. Distillation uses heat and pressure changes to vaporize seawater, thus liberating it of its dissolved and suspended solids and almost all dissolved gases. High- and low-pressure units connected directly to the potable water lines should have the ability to go to the waste system if the distillate is not fit for use. It should be considered, that in low pressure units, water is evaporated at low temperatures (<80°C). Therefore it cannot be guaranteed that the distillate is free of pathogens. According to ISO-Standards water that has been produced below 80°C needs to be disinfected before it can be defined as potable.

Disinfection should be implemented in the water treatment process, ideally in a way that guarantees that all water (including bunkered water) is treated before reaching the potable water tank. A distillation plant or other process that supplies water to the ship's potable water system must not operate in polluted waters or harbour areas, since some volatile pollutants may be carried through this process.

Treatment facilities should be designed to ensure efficient operation with the production of potable water that conforms to the GDWQ (WHO, 2004a) or any relevant authority's requirements.

Pre-acidification

Potable water that is produced by desalination typically contains extremely low concentrations of carbon dioxide. In the rehardening process carbon dioxide is required to dissolve the carbonate.



To add the missing carbon dioxide, normally a pre-acidification of the distillate or permeate is necessary. This pre-acidification is typically done by automated dosage of carbon dioxide or acid that is suitable for the use in potable water.

Rehardening

Due to the aggressive nature of desalinated water and because this water may be considered bland, flavourless and unacceptable, it is commonly stabilized by the addition of chemicals such as calcium carbonate. Once such treatment has been applied, desalinated waters should be no more aggressive than waters normally encountered in drinking-water supply. Chemicals used in such treatment must be subject to procedures for certification and quality assurance. The process of remineralisation of desalinated water must be validated by the use of a testing kit for pH, hardness and turbidity. Water that has not been stabilized due to a failure in the rehardening process, typically shows a very low electrical conductivity (e.g. 50 µS/cm) and an elevated pH above 8.0. High pH can be a reason for an unsatisfactory disinfection result and reduced hardness may lead to a leaching of metals into the water.

Materials

Materials used in the construction of all of the surfaces (hoses, couplings, pipes, tanks, fixtures, soldered joints) that may contact water during production, transfer and storage should be approved for this

purpose by an appropriate authority (regulatory or independent third party). The water that is being provided should not be corrosive to those surfaces and fixtures. Factors such as temperature, pH and alkalinity need to be controlled within appropriate ranges for the particular water type (see WHO, 2004a). Concerns have emerged in relation to plasticisers, solvents, jointing compounds and coatings used in water supply and transport systems. It is important to ensure that all materials that may come in contact with the water supply are suitable and will not contribute hazardous chemicals.

If the material of which a pipe or tank is constructed should require coating, such coating should not lead to the water becoming toxic or otherwise unfit for human consumption (e.g. chemical odour). Materials and devices must be suitable for hot/cold water use, as applicable.

Potable water tank

Potable water needs to be stored in tanks constructed, located and protected against any contamination from inside or outside the tank. Tanks need to be designed so that cross-connections between tanks holding non-potable water or pipes containing non-potable water is prevented. Ideally, potable water tanks should be located in rooms that have no sources of heat emission and dirt.

Potable water tanks must be constructed of metal or other suitable material safe for contact with potable water and be robust enough to exclude contamination. Proper maintenance of anticorrosive coatings in water tanks is important. The water tanks should not share a common wall with the hull or other tanks containing non-potable liquids. No drainage line of any kind or any pipe carrying wash water, salt water or other non-potable liquid should pass through potable water tanks. If this is unavoidable pipes should only pass potable water tanks through a watertight tunnel that is self draining. Similarly, it is best that soil waste drains not pass over potable water tanks or wash water tank manholes. It is also best if toilets and bathroom spaces do not extend over any part of a deck that forms the top of a potable water or wash water tank.

Every potable water storage tank will need to be provided with a **vent** located and constructed to prevent the entrance of contaminating substances and vectors. For example, the opening of the vent should be protected by a tight mesh to prevent entrance of insects. Due to the ships movement increased air exchange may take place in potable water tanks. To avoid intrusion of harmful particles filters that are designed to exclude substances like dirt and exhaust gases should be used. These filters need to be cleaned or exchanged regularly. Ventilating pipes should not end directly above the water surface to avoid dripping of substances into the water body. A potable water tank vent should not be connected to the vent of any tank holding or intended for holding non-potable liquid, as cross-contamination may occur.

It is important that the potable water tank be provided with an overflow or relief valve, located so that the test head of the tank is not exceeded. The overflow must be constructed and protected in the same manner recommended for vents. An overflow may be combined with a vent, but the provisions described for the construction and protection of both vents and overflows must be observed.

The potable water tank should be designed to be completely drained in case there is a need to dump water to remove contamination. The end of the tank suction line should be no closer than 50 mm above the tank bottom to avoid the intake of sediment or biofilms.

Any means provided for determining the depth of water in the potable water tanks should be constructed to prevent the entrance of contaminated substances or liquids. Potable water tanks need to be equipped with facilities to read the filling level of the tank from outside. This construction should not produce areas of stagnating water that could become a source of contamination. Manual sounding should not be performed as this may lead to unnecessary contamination of the potable water.

All potable water tanks need to be clearly labelled with capacity and words such as "POTABLE WATER TANK".

The potable water tank will need an inspection cover giving access for cleaning, repair and maintenance. To avoid contamination when opening the cover, the opening should not give direct access to the unprotected water surface. An inspection of the empty tank should be performed periodically (e.g. once a year). If tanks are entered by people, clean protective clothing should be worn. Staff should be equipped with a clean single-use overall, face mask, disposable rubber gloves, rubber boots that are light in colour, very clean and used only inside potable water tanks. Boots and any tool used in the tank need to be disinfected before entering. No people with any acute illness (e.g. diarrhoea) should be allowed to enter potable water tanks.

Sample cocks should be installed directly on each tank to allow tests to be taken to verify water quality and must point downwards to avoid contamination. Sample cocks should be made of material that allows disinfection and contact with flames for sterilizing. Cold potable water should be always stored at temperatures below 25°C. More detailed information about technical requirements of potable water tanks can be found in ISO 15748-1.

Potable water pumps

The potable water pump needs the capacity for regular servicing. To prevent contamination, the pump should not be used for any purpose other than pumping potable water. A filter can be installed in the suction line of the pump. Filters need to be maintained according manufacturer's instructions (e.g. exchange or regularly backwash). The installation of a standby pump is recommended for emergencies, such as breakdown in the main unit serving the potable water system. If this secondary pump and piping is filled with water it must be operated alternating with the primary pump to avoid build up of microbial contamination in stagnating water. Hand pumps, installed on some ships to serve galleys and pantries for emergency or routine use as a supplement to pressure outlets, need to be constructed and installed to prevent the entrance of contamination. Pumps should ensure continuous operation when required to maintain pressurization, for example, by priming automatically. A direct connection from the pump, with no air gap, should be used when supplying to a potable water tank.

Hydrophore

Hydrophore tanks are used to pressurize the potable water installation and facilitate the transport of the water through the system. In extended potable water installations permanent running potable water pumps are used instead of hydrophore tanks to establish a continuous positive pressure at all taps.

Hydrophore tanks need to meet the same criteria as other potable water tanks. The tanks should be equipped with maintenance openings for cleaning. They should be of adequate size and be located away from any heat sources. Where compressed air is used to produce the air cushion inside the hydrophore tank, a filter, liquid trap or similar device must be installed in the supply line from the compressed air system to protect the water supply. More detailed information can be found in the ISO-Standards.

Calorifier

Calorifiers are used to produce hot water. In small potable water systems, a so-called decentralised hot water production system can be used wherever hot water is needed. But in more extended installations a central hot water production unit is typically installed in combination with a hot water circulation system. Calorifiers should meet the same materials and construction criteria as all other parts in the potable water system. They should be equipped with a maintenance opening and with thermal insulation. To avoid the growth of *Legionella* spp., hot water should leave the calorifier at a temperature of at least 60°C. A hot water circulation system should be used and the returning water should not be colder than 55°C.

Water distribution system

Ships should have plumbing suitable to protect water safety. Before being supplied, new ships should be inspected for compliance with the design specifications by the competent authority or other authorised independent body. Technical standards like ISO-Standard should be considered. A clear and accurate layout of the engineered system on the ship is likely to be needed to support this inspection.

Materials in contact with water need to be safe for the intended purpose. To help ensure this, in new construction and in repairs and replacements on old ships, new pipes, tubing or fittings should be used in the potable water system and in the wash water system when wash water may be used to supplement potable water after treatment. All materials used should to be acceptable to the national health administration of the country of registration. Lead and cadmium-lined pipes, fittings and joints should not be used anywhere in the potable water system, as these can leach into and contaminate the water.

Potable water piping should be clearly identifiable to help prevent cross-connection plumbing errors. To identify potable water piping, the use of a colour code according international standards (ISO 14726: blue-green-blue) should be used.

Crew must be provided with training to take hygienic precautions when laying new pipes or repairing existing pipes. It is important in designing the ship to minimise the extent of points where water could collect and become warm (>25°C) and stagnant. For example, temperature control valves that prevent

scalding must be fit as close to the point of use as possible to minimise the formation of warm water pockets. The number of distribution system dead ends should be minimised.

If hot water piping and cold water piping are laid side by side, appropriate thermal insulation must be carried out to prevent warming or cooling of the respective pipes and the possibility of bacterial growth.

All piping components should be able to resist water temperatures of 90°C to facilitate thermal disinfection whenever necessary.

The distribution system should be designed to avoid any important treatment or storage processes being bypassed.

Fixtures (taps, shower heads)

Fixtures and fittings can harbour contamination, and the design needs to consider how to select suitable attributes to control these risks. To maintain their integrity, an accepted safe practice is to ensure all fixtures are resistant to the corrosive effects of salt water and saline atmosphere. In addition, fixtures must be easy to clean and designed to function efficiently. To aid cleaning, internal corners are best if rounded, wherever practicable.

All fixtures should be able to resist water temperatures of at least 70°C to facilitate thermal disinfection whenever necessary.

Potable water outlets must be labelled "POTABLE WATER". Similarly, non-potable outlets must be labelled "UNFIT FOR DRINKING". To encourage use of the safe potable supply, potable water outlets must be provided in convenient locations, such as near passenger, officer and crew quarters and in the engine and boiler rooms. To support food safety, hot and cold potable water must be supplied under pressure to the galley, pantry and scullery. Steam to be applied directly to food must be made from potable water. Boiler steam is a safe means of heating potable water and food if applied indirectly, through coils, tubes or separate chambers. Hot and cold potable water must be supplied under pressure to the medical care spaces for hand washing and care purposes. Only potable water must be piped to the freezer for making ice for drinking purposes.

A wash water system, when installed, can be used to supply slop sinks, laundry facilities, water closets, bibcock connections for deck flushing purposes, heated water for dishwashing and water for other special uses. Wash water storage tanks shall be constructed and protected as to prevent the possibility of contamination in a similar way to potable water. Any faucets on the wash water system must be clearly marked "UNFIT FOR DRINKING".

Wash basins should have hot and cold potable water lines ending in a simple mixing outlet to help control growth of bacteria that would otherwise proliferate in warm water lines. It is useful to encourage hygienic passenger and crew behaviour by placing a sign above the basin with instructions to "WASH BASIN BEFORE AND AFTER USE".

Seldom used taps or showers have a risk of high microbial growth due to water stagnation. This can lead to contaminations of the whole distribution system and should be avoided. Therefore seldom-used fixtures should be flushed for a few minutes regularly to mitigate this risk. A flushing schedule can be a useful tool to be performed during regular maintenance.

Aerators may harbour very high numbers of bacteria (e.g. *Pseudomonas aeruginosa*). Therefore regularly cleaning and disinfection of the aerators should be performed.

3. Operational limits, monitoring and corrective actions

Disinfection

When treatment, purification or disinfection is necessary, the method selected should be recommended by the competent authority and be most easily operated and maintained by ship's officers and crew. Disinfection is most efficient when the water has already been treated to remove turbidity and when substances exerting a disinfectant demand or capable of protecting pathogens from disinfection have been removed. However, disinfection does not always eliminate all infectious agents. For example, cross-contamination can easily impact water with a low residual disinfection. Furthermore, parasites such as *Cryptosporidium* spp. oocysts are very resistant to chlorine or chloramine disinfection and need to be removed by filtration or inactivated by an alternative methods such as ultraviolet irradiation.

In extended distribution systems, a residual disinfectant should be maintained to limit growth of

microbial hazards that can impart off-flavours to the water and foul lines and fittings. Maintaining residual disinfection, e.g. > 0.5 mg/L (ppm) free chlorine, will contribute to the control of *Legionella* spp. for instance. In addition, this residual may kill very low levels of some pathogens that may gain entry to the network.

Where chlorine is used as the disinfectant, a satisfactory chlorine residual (typically around 0.5–1 mg/L (ppm) of free chlorine or 1.0 mg/L (ppm) of chloramines as water enters the distribution or storage system) should be maintained.

The disinfectant residual for chlorine (the most common disinfectant) should ideally be no less than 0.2 mg/L (ppm) and no more than 5 mg/L (ppm).

A pH of above 8.0 will decrease the disinfecting effect of chlorine significantly. Test kits to check pH before any disinfection and level of free and total chlorine during disinfection should be available on board and used as per the manufacturer's specifications.

These normal residuals are not adequate to disinfect large ingress events and should not be relied upon. Presence of the residual disinfectant does not mean water is necessarily safe. Similarly, absence of a residual does not mean that the water is necessarily unsafe if the source is secure and distribution fully protected.

Process control parameters, such as disinfectant residuals at water disinfection plants and at the farthest tap (e.g. bridge deck), should be monitored at a sufficient frequency to detect deviations in control processes early enough to prevent contamination reaching water users, which ideally means continuous automated monitoring.

Absence of a residual where one would normally be found can be a useful indicator of cross-contamination. However, many viral and parasitic pathogens are resistant to low levels of disinfectant, so residual disinfection should not be relied upon to treat contaminated water. Low levels of residual may inactivate bacterial indicators such as *E. coli* and mask contamination that might harbour more resistant pathogens. In such cases, superchlorination treatment is typically applied to destroy the resistant viral and parasitic pathogens. Superchlorination involves various combinations of time and concentration, for instance, dosing chlorine to give a final chlorine residual of around 20 mg/L (ppm) after one hour of contact time.

Whenever the potable water tanks and system or any of their parts have been placed in service, repaired or replaced or have been contaminated, they must be cleaned, disinfected and flushed before returning to operation. Where a water distiller is connected to the potable water tank or system, the pipe and appurtenances between the distiller and the potable water tank or system must be disinfected and flushed with potable water thoroughly.

If ultraviolet (UV) light is intended for disinfection these devices need to be approved by the national authorities. UV devices need regularly maintenance including cleaning and lamp exchange, according to the manufacturer's instructions. Typically UV devices should be installed vertically to avoid accumulation of sediments on the lamp. Bypass around UV devices are neither allowed nor useful because of the increased risk of contaminating the whole system. In the case of high turbidity, pre-filters should be used before UV devices, to ensure the unit is operating within the manufacturer's specification. It should be considered that UV light has no residual effect and that all water needs direct contact with the light.

Chemical parameters

Temperature, pH, hardness and alkalinity are controlled within appropriate ranges for the particular water type to minimize corrosivity and potential leaching of metals. Metals such as lead, nickel, iron, cadmium or copper can be leached from some materials into the water and contribute to adverse taste or, in some cases, health concerns. Excess copper or iron can cause metallic taste; copper can cause gastrointestinal upset; excess lead can cause cognitive deficits from long-term high-level exposure in young children. The GDWQ value for copper is 2 mg/L (ppm); iron can be detectable by taste at about 0.3 mg/L (ppm); and the lead guideline value is 0.01 mg/L (ppm). In lieu of or in addition to monitoring for metals, appropriate management should be achieved through a corrosion control programme.

Disinfectant residuals should be monitored throughout the distribution system.

Physical and aesthetic parameters

Electrical conductivity of the water should be measured whenever water is produced on board. A very

low electrical conductivity gives information about a malfunction in the remineralisation process.

Turbidity in the potable water on the ship could indicate a gross contamination with biological material or that dirt has entered the system during delivery.

No undesirable tastes, colours or odours should be present in the drinking-water. Aesthetic parameters such as undesirable taste, colour or odour that appear after water treatment may be indicative of corrosion or cross-connections, contamination by foreign substances during transfer to the ship or inadequate plumbing conditions on board. Complaints about aesthetic parameters (odour/colour/taste) should trigger further investigations into water quality and may indicate the need to monitor turbidity. All these parameters signify the need to determine their cause and to take corrective actions so that water on the ship is both potable and palatable. Furthermore, water that is not aesthetically acceptable will not be consumed and passengers and crew may instead consume alternative less safe water.

Cool water is generally more palatable than warm water, and temperature will impact on the acceptability of a number of other inorganic constituents that may affect taste. High water temperature enhances the growth of microorganisms and may increase taste, odour, colour and corrosion problems (WHO, 2004a).

Occurrence of *Legionella* spp. in high numbers in drinking-water supplies is preventable through implementation of basic water quality management measures, including maintaining piped water temperatures outside the range at which *Legionella* spp. proliferates to high levels (25–50 °C). This can be achieved by setting heaters to ensure hot water is delivered to all taps at or above 50°C, (which can mean requiring above 55°C at the recirculating point and in the return line of hot water circulation systems), and insulating all pipes and storage tanks to ensure water is maintained outside the temperature range 25–50 °C. However, maintaining operating temperatures of hot water systems above 50 °C may result in increased energy requirements and present a scalding risk in young children, the elderly and mentally handicapped. In cold water distribution systems, temperatures should be maintained at less than 25 °C throughout the system to provide effective control. However, this may not be achievable in all systems, particularly those in hot climates. Maintaining disinfectant residuals above 0.2 mg/L (ppm) throughout the piped distribution system and storage tanks will contribute to the control of *Legionella* spp. in such circumstances. Disinfection devices using ultraviolet light (UV) can be installed into the distribution system to reduce risk of *Legionella* spp. contamination. Water flow in the distribution system should also be maintained during periods of reduced activity (WHO, 2007b).

Prevention of backflow

When potable water is delivered to non-potable systems and supplied under pressure, the system must be protected against backflow by either backflow preventers or air gaps. If backflow preventers fail, negative pressure can arise, and this can lead to ingress of contaminants into the system. The ship should have a comprehensive programme that provides safe connections to the potable water system through air gaps or appropriate backflow prevention devices at high-hazard locations.

To prevent contamination, it is advisable to ensure the potable water system is not connected to any non-potable water system. To achieve this, overflows, vents and drains from tanks and drains from the distribution system must not be connected directly to sewage drains. When drain lines are extended towards the bottom of the ship, they must terminate a suitable distance above the inner-bottom plating or above the highest point of the bilge in the absence of such plating, unless backflow is impossible. Air gaps and receiving funnels must be installed in these lines when they discharge to a closed tank of a non-potable water, to a deck drain or to a sanitary drain. Potable water piping should ideally not pass under or through sewage tanks or pipes or tanks holding non-potable liquids. The distribution lines, including suction lines of the potable water pump, should not be cross-connected with the piping or storage tanks of any non-potable water system. Potable water lines should ideally be located so that they will not be submerged in bilge water or pass through tanks storing non-potable liquids.

Examples of areas where backflow prevention may be used include:

- potable water supply lines to swimming pools, whirlpools, hot tubs, bathtubs, showers and similar facilities;
- photographic laboratory developing machines;
- beauty and barber shop spray rinse hoses;
- garbage grinders;

- hospital and laundry equipment;
- air conditioning expansion tanks;
- boiler feed water tanks;
- fire systems;
- toilets;
- freshwater or saltwater ballast systems;
- bilge or other waste water locations;
- international shore connections; and
- any other connection between the potable and non-potable water systems.

Each backflow preventer must be scheduled for inspection and service in accordance with the manufacturer's instructions and as necessary to prevent the device's failure. To facilitate this, backflow preventers should be located in easily accessible areas. A standard backflow preventer or other device to prevent the flow of water from ship to shore must be installed on every ship. Drainage to prevent freezing may need to be provided. The ship's crew needs to undertake, or commission, regular checks and tests on the adequacy of backflow preventers, possible cross-connection points, leaks, defective pipes, pressure and disinfection residuals. This should be included in a routine, comprehensive sanitary inspection programme.

Individual air gaps must be placed in drain lines from certain types of fixtures, such as refrigeration units and all hospital, food preparation and food servicing equipment, when such drainage is to a system that receives sewage or hospital wastes, unless, for example, drains are independent of each other and of all other drainage systems.

The sanitary or overboard water system, including all pumps, piping and fixtures, should be completely independent of the potable water and wash water systems. All faucets and outlets on the sanitary system should be clearly labelled "UNFIT FOR DRINKING". Any bidets installed should be of the jet type, and any potable or wash water line serving them equipped with a backflow preventer.

To control cross-contamination, saltwater service to bathtubs and showers must be independent, with no cross-connections to either the potable water or wash water systems.

When a ship is without power to operate its pumps, it may connect its fire fighting system to the shore potable water system. If the connection remains after the ship's power system is restored, the non-potable water from the ship's fire system may accidentally be pumped back into the shore potable water system. Measures should be put in place to ensure this doesn't occur.

Monitoring

Regular water quality monitoring must be used to demonstrate that source water being supplied to the port and potable water on board is not contaminated with fresh faecal material or other chemical and microbial hazards. Regular monitoring of each parameter is necessary to ensure safe water quality is maintained, as each step in the water transfer chain provides an opportunity for contamination. Monitoring needs to be specific in terms of what, how, when and who. The focus for the control of process operation should be on simple measurements that must be done online and in the field. In most cases, routine monitoring will be based on simple surrogate observations or tests, such as turbidity or structural integrity, rather than complex microbial or chemical tests. Infrastructure should be monitored (e.g. checks for filter cracks and pipe leaks, defective backflow preventers or cross-connections). Filters need to be exchanged or backwashed according to manufacturer's instructions. Seldom used taps and showers should be flushed regularly to avoid microbial growth due to stagnating water, with both actions described in the WSP. Disinfection must be monitored online by measurements of residual disinfectant, turbidity, pH and temperature; a direct feedback and control system must be included. As such tests must be carried out rapidly, with indicators often preferred to microbiological testing. It is essential that all monitoring equipment be calibrated for accuracy and checked against independent readings. Records of readings must be documented. Periodic sanitary surveys of the storage and distribution system are an important part of any WSP. These are inexpensive to carry out and can complement routine water quality measurements.

Monitoring actions need to provide information in sufficient time that corrective action can be taken to

ensure control and prevent contaminated water from reaching passengers and crew.

Aesthetic parameters such as odour, colour or taste are typically “measured” through consumer complaints, although the crew may also wish to do an independent periodic check. This is a subjective parameter, as individuals have different sensitivities.

Some countries may request additional monitoring for parameters over and above those suggested by the GDWQ within their jurisdiction for operational or regulatory reasons. Ports and ship operators should verify with their local authority if additional monitoring is required. These should be included in the WSP.

Investigative and corrective action

In the event of contamination of water on the ship, the ship’s operator should notify persons on board and take immediately mitigation measures or arrange for an alternative water supply. Appropriate action may include additional treatment or flushing and disinfection of transfer equipment or ship water tanks.

Specific corrective actions must be developed for each control measure in the WSP in order to deal with deviations when they occur. The actions must ensure that the control point has been brought under control and may include repair of defective filters, repair or replacement of pipes or tanks or breaking of cross-connections.

The ability to change temporarily to alternative water sources is one of the most useful corrective actions available but is not always possible. Backup disinfection plans may be necessary.

Investigative action and response could be as basic as reviewing records or include more comprehensive corrective action. Corrective action should involve remedying any mechanical, operational or procedural defect in the water supply system that has led to critical limits or guideline values being exceeded. In the case of mechanical defects, remedies should include maintenance, upgrading or refurbishment of facilities. In the case of operational defects, actions should include changes to supplies and equipment. In the case of procedural defects, such as improper practices, standard operating procedures and training programmes should be evaluated and changed, with personnel retrained. Any such changes should be incorporated accordingly into the WSP.

The competent authority (e.g. Port Health Authority) should be informed whenever required by the national regulations of the port state and in all cases of illnesses and/or complex problems on board. The report of illnesses and sanitary conditions that may pose a public health risk (e.g. water system in poor condition) is an international obligation due to the IHR.

Oversight should be provided to ensure corrective actions are implemented in accordance with written procedures and quickly enough to minimize exposure of the travelling public and crew members. Oversight could be performed by the responsible party for that segment of the supply chain or by an independent party, such as a regulatory authority.

Emergency/contingency actions may need to be taken, such as provision of water from alternative sources. During periods when corrective action is being taken, increased monitoring is required.

3. Management and communication

Verification monitoring

Verification monitoring of potable water on the ship is carried out at locations to ensure persons on board are provided safe water. Verification steps should be adequate to provide assurance that water quality has been restored to safe levels. It is important to separate verification monitoring from less sophisticated measures like simple on-site tests and more complex procedures like sampling for microbiological and chemical laboratory analysis. While simple on-site tests can be performed by ship’s staff to perform regularly verification monitoring of pH and chlorination, the sampling for complex chemical and/or microbiological analysis should always be performed by well trained professional staff that are authorized by a certified laboratory. Only special sampling containers (e.g. sterile glass bottles that contain sodium thiosulfate for microbiological samples, or special polyethylene bottles for chemical samples) should be used. Usually samples are taken in one port and the ship will leave port while the results are still pending. Often the results need to be interpreted by the next port and therefore it is necessary to follow a defined sampling scheme and sampling procedures (e.g. according ISO 19458) to have internationally comparable results.

A standard sampling scheme should be developed for each ship, depending on size and complexity of the

potable water system. At a minimum, it is diligent to take a sample directly from the tank (sampling taps necessary) and one sample at the farthest point of the distribution system (e.g. tap at the bridge deck). The tank-sample gives information about water quality of the water supply on board, while the bridge-sample gives information about the quality for the consumer. If both samples have been taken at the same time, they can be compared and provide information about the influence of the distribution system. This is an easy and affordable way to get a quick overview about the system's status.

Sampling guidelines for physicochemical and microbiological analysis can be found in Guidelines for drinking-water quality, 2nd edition, Volume 3, "Surveillance and control of community supplies" and in ISO 19458:2006 "Water quality – Sampling for microbiological analysis".

Detailed information about useful sampling schemes, sampling procedures, standard parameters and action triggers are given in chapter 2.2.4.

Laboratories engaged for potable water analysis should meet international quality standards (e.g. ISO 17025).

It is recommended that *E. coli* or thermotolerant (faecal) coliforms be monitored at representative taps (e.g. drinking fountains). Monitoring should take place at each major servicing, in addition to regular *E. coli* spot checks while in service.

HPCs can be used as an indicator of general water quality within the distribution system. An increase in HPCs indicates post-treatment contamination, regrowth within the water conveyed by the distribution system or the presence of deposits and biofilms in the system. A sudden increase in HPCs above historic baseline values should trigger actions to investigate and, if necessary, remediate the situation.

Testing for *Legionella* spp. bacteria serves as a form of verification that the controls are working and should be undertaken periodically, e.g. monthly, quarterly or annually, depending on the type of ship environment and climate of the shipping passage. This testing should not replace, or pre-empt the emphasis on control strategies. Furthermore, the tests are relatively specialised and need to be undertaken by properly equipped laboratories using experienced staff. Verification sampling should focus on system extremities and high-risk sites.

Pseudomonas aeruginosa can cause a range of infections but rarely causes serious illness in healthy individuals without some predisposing factor. It predominantly colonizes damaged sites such as burns and surgical wounds, the respiratory tract of people with underlying disease and physically damaged eyes. From these sites, it may invade the body, causing destructive lesions or septicaemia and meningitis. *Pseudomonas aeruginosa* can multiply in water environments and also on the surface of suitable organic materials in contact with water. *Pseudomonas* can be found frequently in aerators and showerheads. The presence of high numbers of *P. aeruginosa* in potable water can be associated with complaints about taste, odour and turbidity. If there is any evidence of stagnating water or inappropriate maintenance of taps and shower heads (especially in medical areas) a test for occurrence of *P. aeruginosa* should be completed.

The principal concern for toxic chemicals in potable water on board is most likely metals, such as lead, nickel, iron, cadmium or copper, or other chemicals leached from the distribution system into the water and contribute adverse taste or, in some cases, health concerns. For ships that produce their own water from seawater, other chemicals may be of concern, such as boron and bromide. The chemicals to be monitored need to be determined, depending on the situation. All samples need to meet GDWQ or national standards (whichever is stricter) for chemicals with potentially significant effects from chronic exposures.

In certain situations, the frequency of monitoring should be increased for a period necessary to determine appropriate corrective action and/or assurance that measured parameters have returned to safe levels. Examples of situations warranting increased monitoring are positive *E. coli* or thermotolerant (faecal) coliform results, excessively humid conditions, during or after natural disasters affecting source water quality, significant increase of HPC and immediately after maintenance activities that have the potential to affect water quality.

Record keeping

Documentation of monitoring should be kept for assurance and analysis in the event of an incident. Documentation should be showed to the competent authority whenever requested.

Training

Crew should be suitably trained by experienced professionals in all aspects of their water supply system operation and maintenance. Especially in risks of bunkering procedures, on-board water production, risks due to temperature and stagnation, maintenance of the water system and all treatment components.

2.2.4 Guideline 2.4: Independent surveillance

Guideline 2.4—Independent surveillance of potable water safety is performed by a competent authority.

Indicators for Guideline 2.4

1. Audit/inspection procedures are put in place by a competent authority.
2. Documentation of a water safety plan and its implementation are reviewed, and feedback is provided.
3. An independent competent authority responds following reports of incidents with the potential to adversely affect public health.

Guidance notes for Guideline 2.4

One limitation with water quality monitoring is that by the time contamination is detected, it is likely that some of the contaminated water has been consumed. Therefore, surveillance should extend to auditing, whereby the processes in place to protect water quality are checked on board ship and at port by an appropriately experienced auditor.

Ship water quality surveillance is an ongoing investigative activity undertaken to identify and evaluate potential health risks associated with the use and consumption of potable water on board. Surveillance protects public health by promoting the improvement of quality, quantity, accessibility and the continuity of potable water supplies. This guideline addresses surveillance of these factors only and does not address surveillance relating to monitoring of or response to outbreaks or other disease events (i.e. public health surveillance).

Levels of surveillance of drinking-water quality differ widely. Surveillance should be developed and expanded progressively, by adapting the level to the local situation and economic resources, with gradual implementation, consolidation and development of the programme to the level ultimately desired. When accepting a WSP, the competent authority in a given jurisdiction may take responsibility for surveillance of the programme, which may include performing random water sampling and auditing the WSP programme.

Although this guideline addresses surveillance by oversight authorities, many concepts discussed could be employed by the water supplier to ensure that the WSP is being implemented effectively.

1. Establishment of procedures

In most cases, surveillance consists primarily of sanitary inspections based on the WSP of ports, watering facilities or ships. Sanitary inspection is a tool for determining the state of the water supply infrastructure and identification of actual or potential faults and should be carried out regularly.

A State health inspector should have the authority to conduct independent inspections and verify the reliability of the supplier's information. This does not normally need to be as frequent as the continuous control performed by ports/ship operators.

Surveillance should be accomplished by authorized and trained officers from public health authorities, or the services of qualified independent auditors may be utilized if they have been authorized by the relevant competent health authority.

Specifications for qualifications of the inspectors should be established, and inspectors should undergo adequate training, including periodic updates and recertification. Independent auditors and inspectors should meet the same requirements as those from the public health authorities.

2. Review of documentation and plan implementation

WSPs should be provided by the port authority and the ship operators, and all documentation pertaining to the WSPs reviewed. The independent review of the WSPs should include a systematic approach, based upon the components of the WSPs, by external auditing of the documentation, implementation and

monitoring of critical control points.

Some components of the independent review include inspection of crew personal hygiene through demonstration of crew members following procedures, inspections and recording these inspections of equipment and environmental conditions to ensure dedicated equipment is used and stored in sanitary conditions, and water sampling through on-site or laboratory tests. Periodic microbiological surveillance of the entire water supply system from the source to representative taps on board should be a key priority because of the acute risk to health posed by pathogens in contaminated drinking-water. Verification of compliance with water standards should start at the source and extend throughout the water distribution system. Each water source, transfer point/critical point in the distribution system and end-point should be monitored. If this is not possible, at a minimum end-points and tanks should be monitored, but it should be possible to trace back when an unsatisfactory result is found.

Inspection of procedures or control systems should be adequate to provide assurance that responsible parties in the water supply chain are able to implement timely corrective measures. Supporting programmes should be reviewed to ensure management procedures and training are adequate to maintain a safe supply of water.

Communication procedures by and to the water supplier, port authority, delivery points, ship operator's and the public should also be reviewed. A notification system should be established that integrates all parties within the water supply and transfer chain.

3. Response to incidents

Response to incidents may include written reports from the responsible party or independent inspectors or written or verbal reports from affected individuals or their representatives. The competent authority should investigate reports of incidents by interviewing reporters, responsible parties and other affected individuals and independently verifying water quality and relevant process parameters (maintenance checklists, training records, etc.) through on-site inspections and other means. The competent authority should coordinate with and advise responsible parties on appropriate corrective actions (modifications to water safety, management, training and maintenance plans, notification of potentially affected individuals, etc.) and ensure remedial action plans are effective and implemented.

Sampling scheme:

Sampling has to be done by professionally trained personnel only. Sampling procedures for microbiological testing of potable water are described in ISO 19458. Laboratories should analyze the water according to internationally accepted technical standards like ISO 17025. It is important that sampling methods and analyzing procedures are comparable from laboratory to laboratory and from state to state. Examples of parameters frequently tested in potable water and typical values are given in Table 2-2.

Before a standard sampling scheme can be defined it is necessary to consider that there are two reasons for sampling:

1. Standard surveillance to perform verification of good management and
2. More detailed inspection in case of any suspected problems.

In case of suspected problems either a broad assessment or a focused search in the system can be completed. The sampling should be performed after an inspection of the whole system. WHO's Recommended Procedures for Inspection of Ships and Issuance Ship Sanitation Certificates provide more detailed information for a system assessment on board. When monitoring, a standard sampling scheme can be very useful to get reliable and comparable information.

The explanations below give information about how to select a sampling point, action triggers to decide which parameters should be examined and procedures on how to take samples.

All procedures should be discussed in advance with the laboratory that will analyze the samples to avoid any misunderstandings.

If the water has been produced on board or water has been bunkered from ashore the water quality in the ship's tank gives information about the source water quality. Sampling should be performed directly from a defined and labelled sampling tap installed at the tank according to the procedure described in ISO 19458 purpose "A": Disinfect or sterilize the sampling tap with a gas burner or with suitable disinfection

liquid (e.g. Ethanol 70%), let water flow out until the temperature is constant (or at least 10 litres if directly taken from the tank) and fill the sterile sampling bottle.

Where water is used for human consumption on board ship it has to be potable. If information is needed about the influence of the distribution system, the farthest tap should be examined to inform the assessor of the highest potential risk. This tap typically can be found at the bridge deck. Here an additional sample should be taken according ISO 19458 purpose "B": Remove aerator, clean the tap, disinfect or sterilize the tap by using disinfection liquid or gas burner, let some water flow out (approximately 2-3 Litres) and fill the sterile sampling bottle.

Whenever water temperature is between 25°C and 50°C a high risk of *Legionella* spp. contamination exists. The main risk is that contaminated aerosols can be inhaled (e.g. in the shower). Therefore at least one shower should be examined within a monitoring program. It is useful to take a cold and hot water sample from the same shower to avoid unnecessary follow-up sampling. Sampling for *Legionella* spp. analysis is not defined in ISO 19458 but could be performed as follows: Choose sampling point (e.g. showerhead), do not remove the showerhead and hose, do not disinfect showerhead or hose, open cold water tap, let 2-3 litres flow out, take the sample, measure temperature, let the cold water flow for 5 minutes and measure temperature again, then close the cold water tap. Open hot water tap, let 2-3 litres flow out, take the sample, measure temperature, let the hot water flow for 5 minutes and measure temperature again, then close the hot water tap. Additionally to the sampling at one shower, a sample at the flow line and at the return line close to the calorifier can be useful to get information whether the whole system or just the single shower is contaminated.

When there is evidence found of stagnating water or otherwise poorly maintained fixtures in medical areas, testing for *Pseudomonas aeruginosa* can be useful. In this case sampling should be performed as described in ISO 19458 purpose "C": Choose a sampling point, do not remove aerators or showerheads, do not disinfect or sterilize the fixture or showerhead, open the tap and take the sample immediately. The same sampling procedure should be applied at suspected taps if there is any outbreak on board that gives suspicion to a waterborne host.

When there is any evidence of malfunction in water rehardening procedures (e.g. missing pre-acidification, high pH, low conductivity, low hardness, colour changes in water or at surfaces that are in contact with water) a chemical analysis of dissolved metals should be arranged from one tap. Two different methods can be applied:

Method A: Take one sample directly from the tap without any other measures in advance. Usually a polyethylene bottle with a volume of one litre would be used. This method requires just one sample but will not provide further information on the contamination source. The disadvantage of this method is that there is no information about the stagnation time of the water in the piping before the sample has been taken.

Method B: Advise the officer in charge on board to begin 4 hours before sampling with the following procedure: Flush the chosen sampling tap (e.g. bridge deck) thoroughly for at least 15-20 minutes and close and secure the tap against accidental use until the sampling arrive (in 4 hours).

For sampling three polyethylene bottles with a volume of 1 litre should be used.

Bottle 1: Open the tap and fill the bottle immediately.

Bottle 2: Let 2-3 litres of water flow through and fill the 2nd bottle.

Bottle 3: Let the water flow for at least 15-20 minutes and fill 3rd bottle.

The analysis of bottle 1 will give information about influence of the fixture, bottle 2 represents the influence of the piping and bottle 3 provides information about the water source.

If tank coatings or other materials that are in contact with the potable water appears to render the water unfit for human consumption (e.g. chemical odour) a specialized chemical analysis should be performed.

Whenever water samples are taken on board or ashore, some on-site parameters should be measured as these can change while samples are transported to the laboratory. These parameters are pH, level of free chlorine, level of total chlorine, conductivity, temperature and turbidity. These values should always be documented together with detailed information about how and where the samples have been taken.

To get reliable and comparable information about the sanitary status of the potable water installation it is recommended to take samples at the same places (e.g. always at the tank and from the bridge deck).

To establish communication between different ports in international travel, it is recommended to issue the water quality analysis reports in English. The sampling points should be clearly indicated and all analysis results should be clearly documented. It should be considered, that some port states do not accept potable water analysis reports when they do not make clear that the laboratory was working according ISO 17025 - Standard.

Table 2-2. Examples of parameters frequently tested in potable water and typical values.

Parameter	Typical value	Unit	Comments
pH ⁽¹⁾	6.5 - 9.5		Ideal pH depends on the used materials. pH > 8.0 does not allow effective water disinfection with chlorine and gives evidence that self produced water may not be remineralized adequately. Further assessment of potable water quality should be performed.
Temperature, cold water ⁽²⁾	5 - 25	°C	Ideally below 20°C to avoid growth of <i>Legionella</i> spp. If >25°C a high risk of <i>Legionella</i> spp. contamination exists. Violation should trigger testing for <i>Legionella</i> spp. contamination.
Temperature, hot water ⁽²⁾	50 - 90	°C	To prevent growth of <i>Legionella</i> spp. temperatures above 55°C should be maintained in hot water storages and whole piping system ⁽¹⁾ . Violation should trigger testing for <i>Legionella</i> spp. contamination.
Conductivity	n.a.	µS / cm	Indirect measure of Total Dissolved Solids (TDS) Typical values (approximately): Untreated distillate: 50 µS/cm Water from shore sources: 500 µS/cm Seawater: 50 000 µS/cm Too low conductivity should trigger evaluation of corrosive processes in the piping and existence of heavy metals due to corrosion.
Hardness ⁽¹⁾ (calcium carbonate)	> 100	mg/litre	< 60 mg/litre calcium carbonate is posing high risk of copper-corrosion. Too low hardness should trigger evaluation of corrosive processes in the piping and existence of heavy metals due to corrosion.
Turbidity ⁽¹⁾	1	NTU	Turbidity should be below 1 NTU for effective disinfection.
Escherichia coli	0	CFU / 100 ml	ISO 9308-1/2:1990
Heterotrophic plate counts (HPC) (at 20 °C)	No abnormal deviations	CFU / 100 ml	
Heterotrophic plate counts (HPC) (at 37 °C)	No abnormal deviations	CFU / 100 ml	
<i>Legionella</i> spp.	< 100	CFU /	T > 55°C in hot water and < 25°C in cold water to avoid

Parameter	Typical value	Unit	Comments
		100 ml	excessive growth of <i>Legionella</i> spp.
Lead ⁽¹⁾	10	µg / litre	
Copper ⁽¹⁾	2 000	µg / litre	Copper has been shown to cause acute gastrointestinal discomfort and nausea at concentrations above about 3 mg/L.
Cadmium ⁽¹⁾	3	µg / litre	
Iron ⁽¹⁾	200	µg / litre	
Nickel ⁽³⁾	70	µg / litre	The concentration of nickel in drinking water is normally less than 20 µg / litre.
Zinc ⁽¹⁾	3 000	µg / litre	
Chlorine, free ⁽¹⁾	< 5	mg / litre	For effective disinfection, there should be a residual concentration of free chlorine of ≥ 0.5 mg/litre after at least 30 min contact time at pH < 8.
Chlorine dioxide ⁽²⁾	0.05	mg / litre	
Colour	< 15	FTU	No visible colour
<p>1: Guidelines for Drinking-water Quality, 3rd Edition, Volume 1, WHO Geneva, 2004</p> <p>2: ISO 15748 -1:2002 Ships and marine technology – Potable water supply on ships and marine structures – Part 1: Planning and design</p> <p>3: Guidelines for Drinking-water Quality, 1st Addendum to 3rd Ed., Volume 1, WHO Geneva, 2006</p>			

3 FOOD

3.1 Background

This chapter focuses on foodborne disease and includes disease associated with bottled water and ice. The previous chapter (Chapter 2) considered disease associated with potable water supplied on board.

3.1.1 Food supply and transfer chain

Foodborne outbreaks have been associated with sourcing unsafe food. Therefore, the first preventative strategy should be to source safe food. Even if the sourced food is safe, measures need to be put in place to ensure that it remains safe during the transfer, storage, preparation and serving activities that follow. An understanding of the ship food supply and transfer chain will help to illustrate the points at which the food can become contaminated en route to the point of consumption.

Generally, the ship food supply and transfer chain consists of five major components that provide multiple opportunities for the introduction, or proliferation, of contaminants in food:

1. the source of food coming into the port;
2. the transfer of food to storage points on board ship;
3. the storage on board ship, which includes storage and general distribution;
4. the preparation and serving of food, including cooking and mixing by food handlers; and
5. the handling and storage of food for personal consumption by passengers or crew, including handling of food, taking food away and storing food in private areas for subsequent consumption.

3.1.2 Health risks associated with food on ships

Significant levels of foodborne disease transmission on ships have been reported. The Rooney et al., (2004) review of over 100 outbreaks associated with ships found that two fifths of the outbreaks reported were attributed to a foodborne outbreak. Since more than one third of the reviewed outbreaks could not be associated with any specific exposure route the true contribution from foodborne transmission to the total may be significantly higher. The WHO (2001) review provided important information on examples of, and possible causes of, foodborne disease and have been cited throughout this chapter.

Importantly, the majority of reported foodborne disease outbreaks were caused by pathogenic bacteria such as *Salmonella* spp., *Shigella* spp. and *Vibrio* spp. The symptoms of bacterial infections can be more severe and prolonged than are typically observed with more common viral diseases or from *Cryptosporidium* infection. This implies an enhanced morbidity burden due to foodborne disease that further emphasizes the significance of this exposure route.

Foodborne disease is often referred to generally as “food poisoning” which has in turn been defined by WHO as “any disease of an infectious or toxic nature caused by or thought to be caused by the consumption of food”. This definition includes all illness regardless of the presenting symptoms and signs thought to have been caused by food. The definition includes acute illnesses characterized by diarrhoea and/or vomiting and illnesses presenting with manifestations not related to the gastrointestinal tract, such as scrombotoxin poisoning, paralytic shellfish poisoning, botulism, and listeriosis. In addition, the definition includes illnesses caused by toxic chemicals but excludes illness due to known allergies and food intolerances. Note that ‘foodborne’ refers to the probable source of the infection, not the nature of the signs and symptoms. Many of the signs and symptoms of the diseases that can be foodborne can also be acquired from other causes such as person-to-person and waterborne transmission.

Foodborne biological hazardous agents include bacteria, viruses, fungi and parasites. These organisms are commonly associated with humans, with raw products entering the food preparation site and with the occurrence of pests. Many of these microorganisms occur naturally in the environment where food is grown. Therefore, some contamination by these pathogens can be expected in raw food.

A range of helminthic and protozoan parasites can contaminate food. Many are zoonotic (capable of infecting many species of animals and humans) so meat and poultry can become directly contaminated at source. Some diseases are faecal-oral whilst others are transmitted via consumption of contaminated flesh. Parasitic infections are commonly associated with undercooked meat products or contaminated

ready to eat food. Some parasites in products that are intended to be eaten raw, marinated or partially cooked can be killed by effective freezing techniques (the precise conditions appropriate will depend on the nature of both the food and the parasites).

Chemical contaminants in food may be inadvertently added during the growing phase, be naturally occurring or may be added accidentally during processing, for example, by the misuse of cleaning chemicals or pesticides. Examples of naturally occurring chemicals are mycotoxins (e.g. aflatoxin), scombrototoxin (histamine), ciguatoxin, mushroom toxins and shellfish toxins.

Some of the causal hazards associated with foodborne disease outbreaks associated with ships are listed in Table 3-1 (Rooney et al., (2004). Note that in some foodborne outbreaks the causative agent may not be identified.

Table 3-1. Agents associated with foodborne disease outbreaks within ships, January 1, 1970-June 30, 2003

Pathogens/ toxins	Number of outbreaks	Number of passengers and crew members affected
Enterotoxigenic <i>Escherichia coli</i> (ETEC)	8	2670
Invasive <i>Escherichia coli</i>	1	153
Norovirus	4	866
<i>Vibrio</i> spp	6	1259
<i>Salmonella</i> spp (non typhi)	15	1849
<i>Shigella</i> spp	8	2076
<i>Staphylococcus aureus</i>	2	380
<i>Clostridium perfringens</i>	1	18
<i>Cyclospora</i> spp	1	220
<i>Trichinella spiralis</i>	1	13
Unknown agent	3	360

Source: Rooney et al., (2004)

Factors contributing to foodborne outbreaks on board ship have included:

- contaminated raw ingredients; and
- inadequate temperature control;
- inadequate heat treatment;
- infected food handlers; and
- use of seawater in the galley.

Bacteria and fungi present the greatest risk for two reasons:

1. Both raw and cooked food can provide a fertile medium and support rapid growth of these organisms. Food can become re-contaminated after it has cooled such that cooked food is not necessarily safe.
2. There are toxins of fungal and bacterial origin that are relatively heat stable and can remain at hazardous levels even after cooking.

Therefore, the contamination levels in raw food should be minimized even when cooking occurs.

Unlike bacteria and fungi, human-pathogenic viruses are unable to reproduce outside a living cell. In

general, they cannot replicate in food, and can only be carried by it. Furthermore, most foodborne viruses affecting humans are limited to human hosts. This makes contamination by the unclean hands of infected food handlers or from human faecal contamination the prime risk factors.

The presence of non-potable water on ship can also present additional risks to foods. For example, outbreaks of *Vibrio parahaemolyticus* gastrointestinal illness have been associated with the use of seawater in the galley. Recommendations for preventing subsequent outbreaks emphasized that only potable water should be supplied to the galley and food should not be held at ambient temperature for extended periods.

Outbreaks have been associated with pre-symptomatic, symptomatic and post symptomatic food handlers and viral shedding can occur from asymptomatic, infected individuals. Infected food handlers should be encouraged to report symptoms and be excluded from work until at least 48 hours after symptoms have ceased. Exposed food that will not be cooked, such as fruit, should be discarded if it may have become contaminated.

The pressure on space and facilities on board ship can lead to a lack of adequate facilities and equipment and this can be a contributing factor in causing disease. For example, in an outbreak of multiple antibiotic resistant *Shigella flexneri* 4a the spread of infection by a food handler may have been facilitated by limited availability of toilet facilities for the galley crew Lew et al., (1991). Conveniently located hand washing and toilet facilities are a prerequisite for hygienic handling of food.

3.1.3 International Health Regulations (2005)

The International Health Regulations (IHR (2005)) has provision for the State Party to designate ports to develop core capacities, such as the provision of a safe environment for travellers using port facilities, including eating establishments (Annex 1 B 1 (d) of the IHR(2005)).

In accordance with Articles 22(b) and 24(c) of the IHR(2005), States are required to take all practicable measures to ensure that international conveyance operators keep their conveyances free of sources of contamination and infection, and that the facilities at international ports are in sanitary condition and be responsible for the removal and safe disposal of any contaminated water and food from a conveyance.

However, it is the responsibility of each ship operator to apply all practicable measures to ensure that no sources of infection and contamination are present on board, including in the water system. For this purpose, it is important that these standards are upheld on board ships and at ports, in terms of the safety of the food served, from the source of supply ashore to distribution on board ship.

3.1.4 Overview of Food Safety Plans and HACCP

The Codex Alimentarius Commission (CAC) implements the joint FAO/WHO Food Standards Programme, the purpose of which is to protect the health of consumers and to ensure fair practices in the food trade. The Codex Alimentarius is a collection of internationally adopted food standards presented in a uniform manner. It also includes advisory provisions in the form of codes of practice, guidelines and other recommended measures to assist in achieving the purposes of the Codex Alimentarius (CAC 1995; 1997a, b; 1999; 2003). The CAC guidance provides important information on basic food safety which will be referred to throughout this chapter. The International Labour Organization has developed labour standards that include consideration of food and catering requirements and competencies for merchant ships. Food Safety Plans, or Food Safety Programmes (FSP) are required to manage the process of providing safe food. Typically, the FSP is based around Hazard Analysis and Critical Control Points System (HACCP) which is described in detail by FAO/WHO (CAC 1997a, b; 1999; 2003; ISO 22000:2005) and NACMCF (1997). The base reference in this document for food safety management is the HACCP. There may be other acceptable food safety management programs that involve partial application of the full HACCP system.

A modern FSP would generally be based around HACCP principles and the prerequisite supporting programs. The FSP is intended to provide a systematic approach to identifying specific hazards and measures for their control to ensure the safety of food. The FSP should be used as a tool to assess hazards and establish control systems that focus on prevention rather than relying mainly on end product testing. The FSP should be capable of accommodating change, such as changes to the ship menus, layout and equipment, advances in equipment design, processing procedures or technological developments. The FSP implementation should be guided by scientific evidence of risks to human health. As well as enhancing food safety, implementation of a FSP can provide other significant benefits including, providing

a framework to support inspection and certification by regulatory authorities and registrars. The successful implementation of a FSP requires the full commitment and involvement of both management and the work force.

The prerequisite supporting programs of a FSP typically include:

- good design;
- quality construction;
- hygienic work practices;
- training of chefs and food handlers;
- raw material ingredient quality assurance; and
- operating in accordance with any appropriate food safety legislation.

The core HACCP steps and principles will be briefly described as they relate to ships. It is important when applying HACCP to be flexible where appropriate, given the context of the application and taking into account the nature and size of the operation.

Preliminary steps

- Step 1. Assemble HACCP team. The ship operator should ensure that the appropriate knowledge and expertise is available for the development of an effective HACCP plan. The scope of the HACCP plan should be identified.
- Step 2. Describe the products. Full description should be given including storage conditions.
- Step 3. Identify intended use. Vulnerable groups of the population e.g. elderly or pregnant may have to be considered, as may allergic groups.
- Step 4. Construct flow diagrams. A flow diagram should cover all steps in any given operation.
- Step 5. Onsite confirmation of flow diagram. The HACCP team should confirm the process operation against the flow diagram and make amendments where necessary.

HACCP principles

- Principle 1. Hazard analysis. The team should list all potential hazards associated with each step, conduct a hazard analysis and consider any measures to control identified hazards. Hazard identification includes defining which hazards are of a nature that their elimination or reduction to acceptable levels is essential for the preparation of safe food. The HACCP team must then consider whether control measures, if any exist, can be applied to each hazard. More than one control measure may be required to control a specific hazard(s) and more than one hazard may be controlled by a specified control measure. In conducting the hazard analysis, wherever possible, the following should be included:
 - the likely occurrence of hazards and severity of their health effects;
 - the qualitative and/or quantitative evaluation of the presence of hazards;
 - survival or multiplication of microorganisms of concern;
 - production or persistence in foods of toxins, chemicals or physical agents; and
 - conditions leading to the above.
- Principle 2. Determine Critical Control Points (CCP). CCP are the stages in the preparation and cooking of food which must be controlled to ensure the safety of the food. There may be more than one CCP at which control is applied to address the same hazard. The determination of a CCP in the HACCP system can be facilitated by the application of a decision tree, which indicates a logic reasoning approach.
- Principle 3. Establish critical limits for each CCP. Critical limits must be specified and technically validated for each CCP. Criteria often used include temperature, time, available chlorine and sensory parameters such as visual appearance and texture.
- Principle 4. Establish a monitoring system for each CCP. Monitoring is the scheduled

measurement or observation of a CCP relative to its critical limits. The monitoring procedures must be able to detect loss of control at the CCP. Further, monitoring should ideally provide this information in time to make adjustments to ensure control of the process to prevent violating the critical limits. Where possible, process adjustments should be made when monitoring results indicate a trend towards loss of control at a CCP. If monitoring is not continuous, then the amount or frequency of monitoring must be sufficient to guarantee the CCP is in control.

- Principle 5. Establish corrective actions. Corrective actions must be developed for each CCP in the HACCP system in order to deal with deviations when they occur. The actions must ensure that the CCP has been brought under control.
- Principle 6. Establish verification procedures. Verification and auditing methods, including random sampling and analysis, can be used to determine if the HACCP system is working correctly. The frequency of verification should be sufficient to confirm that the HACCP system is working effectively.
- Principle 7. Establish documentation and record keeping. Efficient and accurate record keeping is essential to the application of a HACCP system. Documentation and record keeping should be appropriate to the nature and size of the ship.

Training programmes should be routinely reviewed and updated where necessary. Systems should be in place to ensure that food handlers remain aware of all procedures to maintain the safety and suitability of food.

3.2 Guidelines

This section provides targeted information and guidance, identifying responsibilities and providing examples of practices that can control risks. 12 specific **Guidelines** (situations to aim for and maintain) are presented, each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action).

The guiding principle for this section is ensuring that food is safe for intended use at the point of consumption.

Guidelines 3.2–3.13 can be considered components under the umbrella Guideline 3.1. However, their importance in ensuring safe water quality on board ships warrants that they have additional detailed elaboration.

3.2.1 Guideline 3.1: Food safety plans

Guideline 3.1—Food safety plans are in place for each component of the food chain.

Indicators for Guideline 3.1

A food safety plan is designed and implemented for the:

1. food source;
2. transfer of food to the ship;
3. ship food storage system;
4. ship food preparation and serving system; and
5. consumer handling and storage processes on board ship.

Guidance notes for Guideline 3.1

Attention should be given to the contemporary use of a preventative, multiple barrier risk management approach to food safety termed the 'Food Safety Plan' and based around the 'Hazard Analysis and Critical Control Point' (HACCP) principles (as per section 3.1.4).

Most of the microorganisms that cause foodborne disease are killed or inactivated by normal cooking processes. However, there are limitations to those contaminants which can be removed. Cooking processes are not always carried out effectively and some hazardous agents can persist through cooking processes (such as toxins). Furthermore, food can become recontaminated following cooking, either by

passengers and crew or vectors such as rodents and insects. Therefore, reliance should not be placed on the cooking processes alone.

Food poisoning on board ships can be reduced by control and careful selection of suppliers, training of food handlers, optimum construction of galleys and strict personal hygiene. Control measures for biological hazards include:

- Source control, i.e. control of the presence and level of microorganisms by obtaining ingredients from suppliers who can demonstrate adequate controls over the ingredients and suitable transport to ships.
- Temperature/time control i.e. Proper control of refrigeration and storage time, proper thawing, cooking and cooling of food). Passenger ship operators should consider alternatives to packed food for takeaway by passengers, or eliminate potentially hazardous foods for packaged takeaway, to ensure that these time/temperature control limits are not exceeded.
- Cross-contamination control, both direct (e.g. resulting from direct contact between raw and cooked food) and indirect (e.g. resulting from the use of the same utensils to contact both raw and cooked food).
- Proper cleaning and disinfection which can eliminate or reduce the levels of microbiological contamination. Galleys should be designed so that the risk of cross-contamination is reduced. Specific guidelines for sanitary conveniences and hand washing facilities for the shipping industry should be considered by those designing and maintaining ships. Seawater should not be used in or near food or food preparation areas.
- Personal and hygienic practices. It is recommended that ships have policies for ensuring that staff with infections that can be transmitted via food do not perform any task connected with food handling. Food handlers with cuts, sores or abrasions on their hands should not handle food unless such sores are treated and covered. Staff should not be penalized for reporting illness, rather the reporting of illness should be promoted. Preventing outbreaks attributed to infected food handlers requires the cooperation of employers, since many food handlers may conceal infection to avoid pay loss or penalty.
- It is important that First Aid boxes are readily available for use in food handling areas and that a suitably trained person be appointed to take charge of first aid arrangements. There are no specific requirements covering the contents of a First Aid Box, but minimum contents might reasonably be a plastic-coated leaflet giving general guidance on first aid, individually wrapped sterile dressings of assorted sizes, sterile eye pads, individually wrapped triangular bandages, safety pins, medium-sized (approximately 12 cm x 12 cm) individually wrapped sterile unmedicated wound dressings and one pair of disposable gloves.

3.2.2 Guideline 3.2: Food receipt

Guideline 3.2—Food should be inspected and confirmed to be in safe condition upon receipt.

Indicators for Guideline 3.2

1. Received food is inspected and confirmed to be in safe condition before acceptance.

Guidance notes for Guideline 3.2

Ships operators are expected to take all practicable measures to ensure that they do not receive unsafe or unsuitable food. This means that they must make sure that the food they receive:

- is protected from contamination;
- is clearly identifiable; and
- is at the correct temperature and condition when it arrives (e.g. a food that is labelled frozen and shipped frozen by a food processing plant shall be received frozen).

Codex provides details of temperatures and conditions that should be confirmed as items are received. A number of examples are given in Table 3-2 although for current requirements Codex should be used as the primary source of information.

Table 3-2. Examples of proper receival temperatures and conditions for foods supplied to ship.

Item	Temperature upon receiving	Condition upon receiving
Meat and poultry	5°C (41°F) or below	Obtained from an approved source. Stamped with official inspection stamp. Good colour and no odour. Packaging clean and in good condition.
Seafood	5°C (41°F) or below Codex recommends a temperature as close as possible to 0°C;	Obtained from an approved source. Good colour and no off-odours. Packaging clean and in good condition.
Shellfish	7°C (45°F) or below Codex recommends a temperature as close as possible to 0°C;	Obtained from approved source. Clean, shells closed, and no broken shells. Shellstock tags must be readable and attached.
Crustacea (unprocessed)	7°C (45°F) or below	Obtained from an approved source. Clean and in good condition.
Crustacea (cut or processed)	5°C (41°F) or below	Obtained from an approved source. Clean and in good condition.
Dairy Products	5°C (41°F) or below unless labeled otherwise	Obtained from an approved source. Packaging clean and in good condition.
Shell eggs	7°C (45°F) or below	Clean and uncracked. Obtained from an approved source.
Liquid eggs	5°C (41°F) or below	Frozen, and dry eggs – pasteurized. Obtained from an approved source.

3.2.3 Guideline 3.3: Equipment and utensils

Guideline 3.3—Equipment and utensils should be suitable for preparation, storage and contact with food.

Indicators for Guideline 3.3

1. Equipment and utensils are suitable for food contact and use.

Guidance notes for Guideline 3.3

It is good practice to ensure the equipment and containers coming into contact with food are designed and constructed to ensure that, they can be adequately cleaned, disinfected and maintained to avoid the contamination of food. Equipment and containers must be made of materials with no toxic effect on their intended use. Where necessary, equipment should be durable, movable or capable of being disassembled to allow for maintenance, cleaning, disinfection and to facilitate pest inspection.

Depending on the nature of food operations undertaken, adequate facilities need to be available for preparing, heating, cooling, cooking, refrigerating and freezing food, for monitoring food temperatures, and when necessary, controlling ambient temperatures. Equipment used to cook, heat, treat, cool, store or

freeze food must be designed to achieve the required food temperatures as rapidly as necessary in the interests of food safety. Such equipment can include design features to allow temperatures to be monitored and controlled.

Containers for waste products and inedible or dangerous substances, must be made specifically identifiable, suitably constructed and where appropriate, made of impervious material. Waste containers used in the galley must be provided with foot-operable lids, be emptied frequently and be easy to clean and disinfect.

All washing facilities, kitchen equipment, storage, stoves and hoods used in the preparation and serving of food and all food-contact surfaces must be so constructed as to be easily cleaned and disinfected, if necessary, and kept in good repair.

The following is a list of examples of the sort of equipment that might need to be considered and assessed for its suitability:

- Blast chillers incorporated into the design of passenger and crew galleys. More than one unit may be necessary depending on the size of the ship, the unit's intended application, and the distances between the chillers and the storage and service areas;
- Food preparation sinks in as many areas as necessary (i.e. in all meat, fish, and vegetable preparation rooms; cold pantries; and in any other areas where personnel wash or soak food). An automatic vegetable washing machine may be used in addition to food preparation sinks;
- Storage cabinets, shelves, racks for food products, and equipment in food storage, preparation, and service, including bars, pantries and storage associated with waiter trays;
- Portable tables, carts, or pallets in areas where food is dispensed from cooking equipment, such as from soup kettles, steamers, braising pans, tilting skillets, or ice storage bins. A storage cabinet or rack for large items such as ladles, paddles, whisks, and spatulas;
- Knife lockers that are easily cleanable and meet food contact standards;
- Dish storage and dispensing cabinets;
- Food preparation counters that provide sufficient work space;
- Drinking fountains; and
- Cleaning lockers.

Depending on the size of facilities and distance to the central pot washing facilities, heavy-use areas such as bakeries, butcher shops, and other preparation areas may require a three-compartment sink with a pre-wash station or a four-compartment sink with an insert pan and an overhead spray. All food preparation areas are likely to need easy access to a three compartment utensil washing sink or a dishwashing machine equipped with a dump sink and a pre-wash hose.

Beverage or condiment dispensing equipment typically requires a readily removable drain pan, or built in drains in the tabletop. Bulk milk dispensers should have readily removable drain pans to enable cleaning of potentially hazardous milk spillages. A utility sink is desirable in areas such as beverage stations where it is necessary to refill pitchers or dispensers or discard liquids such as hot or cold drinks, ice cream or sherbet. Dipper wells ideally need to be provided with running water and proper drainage.

Clean storage areas need to be sufficient to house all equipment and utensils used in food preparation such as ladles and cutting blades.

The design of all installed equipment needs to direct food and wash water drainage into a deck drain scupper, or deck sink, and not directly or indirectly onto a deck.

For openings to ice bins, food display cases, and other such food and ice holding facilities, tight fitting doors or similar protective closures are desirable to prevent contamination of stored products.

Countertop openings and rims of food service areas, bains-marie, ice wells, and other drop in type food and ice holding units must be protected with, a raised edge or rim of 5 mm (0.2 in) or more above the counter level around the opening.

3.2.4 Guideline 3.4: Materials

Guideline 3.4—Materials should be suitable for contact with food and should protect food from

contamination.

Indicators for Guideline 3.4

1. Materials in contact with food are suitable for this purpose.
2. Materials not in food contact are suitable to their roles in protecting food from contamination.

Guidance notes for Guideline 3.4

1. Food contact areas

The materials used for food contact surfaces need to be suitable, for example, being corrosion resistant, non-toxic, non-absorbent, easily cleanable, smooth and durable. This applies especially to heating units in contact with food, cooking fats, oils or similar cooking media. Cutting boards should be of a suitable material, such as one equivalent to or better than hard maple. If using materials other than those already accepted and listed for use as food contact surfaces or containers, advice should be sought from the relevant public health authority before installation. In general, painted surfaces are not recommended for food contact unless appropriate paint is used.

2. Non-food contact areas

Materials used for non-food contact surfaces must be made to be durable and readily cleanable. Welding materials used in joining together non-corrosive materials must be selected to ensure the weld area is corrosion resistant. Surface coatings and paint should be suitable for their intended use and non toxic.

All permanent or stationary equipment needs to be installed and constructed with flashing to exclude openings hidden by adjacent structures or other equipment, unless adequate clearance for proper cleaning is provided. As an example, a minimum clearance of 15 cm (5.9 in) is recommended under leg-mounted equipment between the lowest horizontal framing member and the deck, or the equipment must be mounted as described in the last paragraph of this section.

It is important to ensure that counter mounted equipment, unless portable, is either sealed to the tabletop or mounted on legs. Once again, to facilitate cleaning, counter-mounted equipment should have sufficient clearance, typically at least 7.5 cm (3 in), between the lowest horizontal member and the counter top. There is also a need to provide cleaning access behind counter-mounted equipment, including beverage equipment.

The clearance between the back of enclosed equipment, such as ranges and refrigerators, and the bulkhead should be governed by the combined length of the items. For example, for equipment up to 61 cm (2 ft) long, a suitable clearance might be 15 cm (5.9 in); for longer equipment the clearance might be proportionally greater, up to a maximum of 61 cm (2 ft) for equipment 2.45 m (8 ft) or more in length. If the space between the equipment and the bulkhead is readily accessible from one end, the above clearances could be halved; with 15 cm (5.9 in) being a suitable minimum.

If two items of equipment, such as ovens or ranges, are located near each other, the space between them needs to be adequate to enable cleaning, as described in the previous paragraph. Alternatively, the space between them could be effectively closed on all sides by tightly fitting flashing.

When mounting equipment on a foundation or coaming, there is a need to consider that an adequate separation distance above the finished deck has been provided, at least 10 cm (4 in). Cement or a continuous weld must be used to seal equipment to the foundation. The overhang of the equipment from the foundation must not be excessive, less than 10 cm (4 in). To avoid possible vermin habitat, it is advisable to completely seal any overhang of equipment along the bottom.

Equipment installed without adequate clearances, such as those suggested in the previous paragraphs, can have the spaces under, next to and behind them effectively enclosed and sealed to the deck and/or bulkhead. Penetrations such as cable, conduit or pipe openings must be provided with tightly fitting collars made of materials acceptable to the relevant national health administration.

Electrical wiring from permanently installed equipment must be encased in durable and easily cleanable material. The use of braided or woven stainless steel electrical conduit outside of technical spaces or where it is subject to splash or soiling is not recommended. The length of electrical cords to equipment on benches should be adjusted or fasten in a manner that prevents the cords from lying on countertops.

Other bulkhead or deckhead mounted equipment such as phones, speakers, electrical control panels, or outlet boxes must be sealed to the bulkhead or deckhead panels. Such items must be kept away from areas exposed to food splash.

Any areas where electrical lines, steam or water pipelines, penetrate the panels or tiles of the deck, bulkhead or deckhead, including inside technical spaces or work surfaces should be tightly sealed. The number of exposed pipelines should be minimized.

3.2.5 Guideline 3.5: Facilities

Guideline 3.5—Facilities should be suitable for safe food storage, preparation and serving.

Indicators for Guideline 3.5

1. Water and ice are of potable quality.
2. There are sufficient cleaning and disinfecting facilities.
3. Ventilation is adequate and designed to avoid food contamination.
4. Lighting is sufficient to allow hygienic food operations.
5. Storage facilities are adequate and provide for safe food storage.
6. Food contact areas are sanitary.
7. Non-food contact areas are designed to avoid food contamination.

Guidance notes for Guideline 3.5

1. Water and ice

An adequate supply of potable water with appropriate facilities for its storage and distribution is required to be available whenever necessary to ensure the safety and suitability for food. Non-potable water (e.g. seawater) must have a separate system and must not be supplied to the galley unless essential, as discussed in Chapter 2.

Ice that will come in contact with food or drink needs to be manufactured from potable water. Shore sources must be checked with the local health authority and delivery of ice from shore to ship must be carried out in a sanitary manner. Upon delivery to the ship, shore ice needs to be handled in a sanitary manner, the handler wearing clean clothing, gloves and boots. Ice must be stored in a clean storage room and raised off the surface by use of deck-boards or similar devices permitting drainage and free flow of air. Ice manufactured on board ship needs to be handled and stored in a sanitary manner.

2. Cleaning and disinfecting facilities

To protect food safety, design criteria for adequate facilities must be adopted in constructing systems for cleaning food, utensils and equipment. Such facilities need an adequate supply of hot and cold potable water. Facilities need to be readily available to encourage an appropriate personal hygiene and to avoid food contamination. Facilities to be located beside the galley can include:

- adequate means of hygienically washing and drying hands, including wash basins and a supply of hot and cold water;
- toilets of appropriate hygienic design with hand basins, which do not open directly into galleys or other food handling areas. An adequate supply of soap and hand drying facilities at hand basins; and
- adequate changing facilities for personnel including suitable storage facilities for clothes.

3. Ventilation

Adequate means of natural or mechanical ventilation help to support safe food operations. Ventilation systems must be designed and constructed so that air does not flow from contaminated areas to clean areas and so that they can be adequately maintained and cleaned. Louvers or vents at ventilation terminals must be made readily removable for cleaning. Particular attention should be given to:

- minimizing air-borne contamination of food, for example, from aerosols and condensation droplets;
- controlling ambient temperatures; and
- where necessary controlling humidity.

4. Lighting

Adequate natural or artificial lighting supports hygienic work practices. The intensity of light should be set according to the nature of the work. Lighting fixtures can be protected to ensure that food is not contaminated if breakage occurs.

5. Storage

The long-term and improper storage of provisions on board seagoing ships is a hazard as provisions are frequently carried for many weeks or even months and the ship can be subject to extreme climatic influences. Storage, especially in cold stores, in an unpacked condition might have an adverse effect on provisions.

The type of storage facilities required will depend on the nature of the food on board. Adequate facilities for the storage of food, ingredients and non-food chemicals (e.g. cleaning materials, lubricants, and fuels) must be provided. Food storage facilities must be designed and constructed to:

- permit adequate maintenance and cleaning;
- avoid pest access and harbourage;
- enable food to be effectively protected from contamination during storage; and
- provide an environment which minimizes the deterioration of food (e.g. by temperature and humidity control).

6. Food contact areas

Food contact surfaces should be free of open seams, cracks or crevices and easily cleanable. Exposed construction fittings (such as bolts and nuts) are not generally acceptable. Corners formed by joining the sides of food contact surfaces must be built with a radius of curvature that helps cleaning, at least 3 mm (0.12 in). On coved corners of food contact surfaces the coved radius must be sufficient to help cleaning, at least 1.6 mm (0.06 in).

Food areas need to be protected against the leakage or seepage of lubricants or other extraneous or foreign substances. Sound deadening or undercoating material is not generally applied to the surface of equipment that is directly above an area where exposed food is kept as this material may harbour hazards.

Drawers and bins that come into contact with food must be removable and easily cleaned. They must be free of open seams or cracks and finished smooth on all sides. Covers, insets, or receptacles for unpackaged food or beverages must be removable or designed for easy cleaning *in situ*.

7. Suitable non-food contact areas

Exposed non-food contact surfaces should be designed to reduce risks of contaminating food by being free of open seams, cracks or crevices. Equipment housing or component parts must be made free of openings into inaccessible areas where food, liquid or dust may enter and insects may shelter. Mixers, refrigerators, compressors and similar units, if provided with openings or louvres, should contain readily removable inspection ports or panels, with routine cleaning in place.

Deck mounted equipment must be installed with the base flush with the deck (openings and joints sealed), or with a minimum clearance of 15 cm (5.9 in), being provided between the lowest horizontal framing member of the equipment and the deck. This also applies when equipment is mounted on an island or curbing. Control mechanisms, couplings and other components mounted on the housing of the equipment must be designed and installed to preclude the entrance of dirt and vermin and the formation of inaccessible areas which may prevent proper cleaning and inspection. Bases, curbs or elevated islands for supporting equipment above deck level, if provided with toe space, must be not indented a distance greater than the height of the lowest framing member of the equipment above the deck. Toe space should

have a minimum suitable height of 5 cm (2 in). Enclosed spaces, such as columns, vertical supports and legs, must be sealed against the entrance of vermin.

Horizontal openings on top of food storage cabinets must be protected by a coaming around their periphery. The minimum height of this coaming needs to be 5 mm (0.2 in) measured from the surface of the cabinet or from the overflow level. Openings in work tables or dish tables to food refuse and waste receptacles can have a watertight turned-down edge extending at least 1.25 cm (0.5 in) below the table surface, unless the opening is provided with a scrap block. Exposed edges on horizontal surfaces, such as tops of dressers, tables and shelves, can have turned-down or return flanges with a suitable space of, at least 2 cm (0.8 in) between the sheared edge and the frame angles, or they should be totally enclosed.

Hoods over steam kettles, ranges and other cooking units should have smooth, easily cleanable interiors. Gutters, if provided, must be designed and dimensioned to facilitate cleaning. Filters, if used, must be installed to direct condensation into gutters. Baffles, vanes, dampers and other air-control facilities must be readily accessible or removable. Sea-rails on cooking ranges must be removable and easily cleanable.

Exposed refrigerant coils located in food compartments must be of a finless type and arranged to allow thorough cleaning. Blower-type or fin-type evaporators must be enclosed or shielded to protect them from spillage of food and to protect the food from condensation. Enclosed-type refrigeration evaporators must be provided with condensate drains. Refrigerant and water coils in water cooling units must be readily accessible for brush cleaning and have the ability to be flushed and drained.

Sliding doors on galley and pantry equipment must be removable and their tracks free of inaccessible openings. The lower tracks must be slotted at the ends to facilitate removal of dust and debris. Equipment doors, whether sliding or hinged, should avoid openings into inaccessible areas. If gaskets are used on insulated doors, they must be made easily cleanable and replaceable and should fit tightly. Door catches and other fastening devices must be made free of openings that could permit vermin and debris to enter channels, door panels or other component parts of the equipment. Catches, hinges and other hardware must be fabricated of smooth, easily cleanable material.

Cutting boards must be readily removable for cleaning or easily cleanable without removal. They must be free of open seams or cracks and finished smooth on all sides. Drawers and bins must be readily removable and easily cleanable.

Insulation material must be protected against seepage and condensation. Flashing must be made to exclude food fragments or debris.

Coaming around equipment such as steam kettles must be sealed against seepage, infiltration and the entrance of vermin, and provided with drains having removable strainers. The drain must be located at the lowest point within the area. Drains for galley and sink equipment should have the following dimensions:

- sinks: 3.75 cm (1.5 in) minimum diameter; and
- steam tables and bains marie: 2.5 cm (1 in) minimum diameter.

Exposed horizontal drainpipes, including the traps, must be installed to permit proper cleaning of the floor area. Drainpipes should not be located above areas used for storage, preparation or serving of food.

To help avoid contamination, water inlets to steam tables, kettles and other sink-type equipment must be located a minimum safe distance of twice the diameter of the water inlet, and in any case not less than 2.5 cm (1 in), above the flood level rim. If the water supply line is required to be below that, vacuum breakers of an acceptable type should be properly installed.

Shelves used as false bottoms must be made readily removable or sealed in place to preclude the entrance of food fragments and vermin. Silverware containers must be removable, designed and fabricated to permit cleaning followed by disinfecting or sterilization. Dipper wells for ice cream dippers must be equipped with running water from an above-the-rim inlet and constructed of smooth, seamless material.

3.2.6 Guideline 3.6: Storage, preparation and service spaces

Guideline 3.6—Spaces should be suitable for the safe storage, preparation and service of food.

Indicators for Guideline 3.6

1. Spaces are readily cleaned and disinfected and do not harbour hazards.

Guidance notes for Guideline 3.6

The decks, or flooring, of all spaces where food or drink is stored, handled, prepared, or where utensils are cleaned and stored, must be so constructed as to be easily cleaned maintained and inspected at all times. Surfaces must be smooth and kept in good repair.

To comply with good practice provision rooms, walk in refrigerators and freezers, and transportation corridors, use hard, durable, non-absorbent decking, e.g. tiles, or diamond plate corrugated stainless steel deck panels in refrigerated provision rooms. Painted steel decking is acceptable in provisions passageways, and drystore areas, although stainless steel is preferred. It is advisable to provide tight-fitting stainless steel bulkheads in walk in refrigerators and freezers and line doors with stainless steel. Painted steel is acceptable for provision passageways and in drystores areas. Light colours are recommended to reveal any dirt. If a forklift will be used in these areas, reinforce stainless steel panels should be used so that buckling is prevented and bumper guards should be fitted on bulkheads to prevent damage. It is good practice to close deckhead mounted cable trays, piping or other difficult to clean deckhead mounted equipment, or completely close the deckhead. All bulkhead and deck junctures should be coved, for example, a 10 mm (0.4 in) radius and sealed tight.

For galleys, food preparation rooms, and pantries, decks should be constructed from hard, durable, non-absorbent and non-skid material. Installation can include durable coving with adequate radius, at least a 10 mm (0.4 in), or open design, such as > 90 degrees, as an integral part of the deck and bulkhead interface and at the juncture between decks and equipment foundations. Stainless steel or other coving, if installed, must be of sufficient thickness so as to be durable and stainless steel deck plate panels must be sealed with a continuous, non-corroding weld. All deck tiling must be sealed with a durable, water-tight grouting material.

In technical spaces below undercounter cabinets, counters or refrigerators, the deck must be a durable, non-absorbent, easily cleanable surface such as tile or stainless steel. Painted steel and concrete decking is not recommended. All openings where piping and other items penetrate through the deck must be sealed. Bulkheads and deckheads, including doors, door frames, and columns, must be constructed with a high quality, corrosion resistant stainless steel. The gauge should be thick enough so that the panels do not warp, flex, or separate under normal conditions. For seams that must be sealed, greater than 1 mm (0.04 in) but less than 3 mm (0.12 in), it is common practice to use an appropriate sealant. For bulkhead and deckhead seams too large to be so sealed, greater than 3 mm (0.12 in), stainless steel profile strips are recommended. All bulkheads to which equipment is attached needs to be of sufficient thickness or reinforcement to allow for the reception of fasteners or welding without compromising the quality and construction of the panels. Utility line connections need to be installed through a stainless steel or other easily cleanable food service approved conduit that is mounted away from bulkheads for ease in cleaning. Back splash attachments need to be sealed to the bulkhead with a continuous or tack-weld and polish. An appropriate sealant is required to make the back splash attachment watertight. All openings must be sealed where piping and other items penetrate the bulkheads and deckheads, including inside technical compartments.

For food service areas, it is advisable to ensure that all buffet lines have hard, durable, non-absorbent decks that are a suitable width, at least 1 m (3.3 feet), measured from the edge of the service counter or from the outside edge of the tray rail. The dining room service stations can have a hard, durable, non-absorbent deck, e.g., sealed granite or marble, with a safe separation distance of at least 61 cm (2 feet), from the edge of the working sides of the service station. The decks behind service counters, under equipment, and in technical spaces must be constructed of hard, durable, non-absorbent materials, e.g., tiles, epoxy resin, or stainless steel. Painted steel and concrete decking is not recommended. Durable coving with radius at least a 10 mm (0.4 in), or open design > 90 degrees must be used as an integral part of the deck and bulkhead interface and at the juncture between decks and equipment foundations. Stainless steel or other coving, if installed, needs to be of sufficient thickness so as to be durable and securely installed. Durable linoleum tile or vinyl deck covering is only recommended in staff, crew or officers' dining areas. Bulkheads and deckheads may be constructed of decorative tiles, pressed metal panels or other hard, durable, non-corroding materials. Stainless steel is not required in these areas. However, the materials used need to be easily cleanable. All openings where piping and other items penetrate through the deck need to be sealed.

Bulkheads and deckheads of spaces in which food and drink are stored, prepared or handled, or in which utensils are stored or cleaned, can have smooth, hard-finished, light-coloured, washable surfaces. Fibrous insulation or similar materials must be sheathed so as to prevent particles of the insulating materials

from falling on foods. Cloth or plaster surfacing is not generally acceptable for satisfactory protection. Fibrous air filters are not recommended to be installed in the deckheads or over food processing equipment. Perforated acoustic material is not recommended in galleys, pantries, sculleries and other food handling or food storage spaces. It is acceptable for use in dining rooms, provided that the particles of material are prevented from falling on food through holes and seams.

Pipes in unsheathed deckheads over spaces where food is stored, handled, prepared or served, or where utensils are washed, must be insulated if condensation forms. Drainage lines carrying sewage or other liquid waste should be diverted from passing directly overhead or horizontally through spaces where food is prepared, served, or stored, or where the washing of utensils occurs. Where such drainage lines exist, they must be not contain clean-out plugs and flanges, or these should be welded closed where they must occur. Exceptions in existing installations may be made where the lines do not leak, drip, or spray non-potable liquids on food or utensils. Drainpipes passing through insulation surrounding refrigerated spaces are considered acceptable.

3.2.7 Guideline 3.7: Toilet and personal hygiene facilities

Guideline 3.7—There should be adequate toilet and personal hygiene facilities for food handling personnel.

Indicators for Guideline 3.7

1. There are adequate and suitably located toilets for food handling personnel.
2. There are adequate and suitably located hand washing facilities for food handling personnel.

Guidance notes for Guideline 3.7

1. Toilet facilities.

Adequate toilet facilities for food handling personnel must be placed near food preparation spaces to encourage personal hygiene and sanitation. On smaller ships, these facilities may be shared by the crew. Such facilities need to be accessible at all times. To avoid contamination toilet rooms should not open directly into spaces where food is prepared, stored or served. If toilet rooms do open directly into such food areas, the doors need to be tight fitting and self-closing. Wherever possible, there should be a ventilated space between the toilet rooms and food spaces.

2. Hand washing facilities.

Adequate hand washing facilities must be provided within or adjacent to toilet rooms. Toilet rooms should include: hot and cold running water from a single mixing outlet, single-service paper or cloth towel dispenser, suitable soap or detergent and signs over the basin reading, for example, "WASH HANDS AFTER USING TOILET - WASH BASIN BEFORE AND AFTER USING". Signs warning personnel to wash hands after using the toilet should also be conspicuously posted on the bulkhead adjacent to the door of the toilet.

The following areas can also be provided with similar hand washing facilities, with appropriate signs located above basins:

- Central kitchen - additional wash basins may be needed depending upon distance, partitions, size of spaces and number of employees served, and other impediments to convenient use of facilities.
- Individual galleys, pantries, bakery spaces, butcher spaces, vegetable preparation rooms and sculleries - a single washbasin may serve more than one such area if easily accessible.

Where a common washbasin serves both a food handling space and a toilet for food handlers, a sign reading as above must be posted. On ships where hand washing facilities exist in a food service employees' stateroom, easily accessible from the food handling spaces, additional facilities are not required in the food handling spaces. In such cases, individual cloth towels for food handlers are acceptable. Scullery sinks, slop sinks, laundry tubs, dishwashing sinks and similar facilities cannot be used for hand washing. Wash water may be used at washbasins provided that the water is heated to a temperature of 77°C (170°F). Only potable water should be used for the cold water supply to wash basins.

3.2.8 Guideline 3.8: Dishwashing

Guideline 3.8—There should be adequate and effective dishwashing facilities.

Indicators for Guideline 3.8

1. Dishwashing facilities are adequate and suitable for safe and effective dishwashing.
2. Waste arising from dishwashing will not recontaminate wash water.

Guidance notes for Guideline 3.8

1. Dishwashing facilities.

Rinse hoses for pre-washing are recommended in some areas. If a sink is to be used for pre-rinsing, a removable strainer may be needed.

All dishwashing machine components, including encased pulper wiring must be elevated at least 15 cm (5.9 in) above the deck to provide for drainage.

Removable stainless steel splash panels must be provided to protect the pulper and technical areas. Grinder cones, pulper tables, and dish-landing tables must be constructed from stainless steel with continuous welding. Platforms for supporting dishwashing equipment must be constructed from stainless steel, avoiding the use of painted steel.

Dishwashing machines must be designed and sized for their intended use and installed according to the manufacturer's recommendations. Dishwashing machines using chemical sanitizers must be equipped with a device that indicates audibly or visually when more chemical sanitizer needs to be added.

Dishwashing machines can have an easily accessible and readable data plate. The plate, affixed to the machine, can include the machine's design and operating specifications:

- temperatures required for washing, rinsing, and sanitizing;
- pressure required for the fresh water sanitizing rinse unless the machine is designed to use only a pumped sanitizing rinse;
- conveyor speed for conveyor machines or cycle time for stationary rack machines; and
- chemical concentration (if chemical sanitizers are used).

Three-compartment dishwashing sinks with a separate pre-wash station must be provided for the main galley, crew galley, lido galley and other full-service galleys with pot-washing areas. For meat, fish, and vegetable preparation areas, there must be at least one three-compartment sink or an automatic dishwashing machine with a pre-wash station. Sinks must be made large enough to submerge the largest piece of equipment used in the area. Sinks should have coved, continuously welded, internal corners. Dishwashing machine wash and rinse tanks should be equipped with baffles, curtains, or other means to minimize internal cross-contamination of the solutions in wash and rinse tanks. A pass-through type dishwashing machine is preferable to an under counter model.

Hot water sanitizing sinks (accept those that use halogen for the sanitization step) must be equipped with accessible and easily readable thermometers, a long-handled stainless steel wire basket, or other retrieval system and a jacketed or coiled steam supply with a temperature control valve to control water temperature.

Sufficient shelving for storage of soiled and clean ware must be provided. As an example, the storage available for soiled ware must be approximately one third the volume provided for clean ware. Either solid or open tubular shelving or racks must be used. Solid overhead shelves must be designed so that they drain at each end to the landing table below.

Adequate ventilation is required to prevent condensation on the deckhead or adjacent bulkheads. Any filters installed over dishwashing equipment need to be easily removable for cleaning.

2. Food waste handling.

In all food preparation areas, adequate space is needed for trash cans, garbage grinders, or pulping

systems. Food waste grinders are optional in pantries and bars.

For tables that store used and soiled dishes and that are installed with pulper systems, the pulper trough needs to extend the full length of the table and slope towards the pulper to help take away waste. The tables back edge must be sealed to the bulkhead, or have sufficient clearance, 45 cm (17.7 in), between the table and the bulkhead. Such tables must be designed to drain waste liquids and to prevent contamination of adjacent surfaces.

To prevent water from pooling, clean tables should be equipped with across-the-counter gutters with drains at the exit from the machine and sloped to the scupper. A second gutter and drain line must be installed if the first gutter does not effectively remove pooled water from the entire table. The length of drain lines must be minimized and where possible, placed in straight vertical lines with no angles.

One of the following arrangements must be used to prevent excessive contamination of rinse water with wash water splash:

- an across-the-counter gutter with a drain dividing the wash compartment from the rinse compartment;
- a splash shield of sufficient height, greater than 10 cm (4 in), above the flood level rim of the sink between the wash and rinse compartments; or
- an overflow drain in the wash compartment sufficiently below, at least 10 cm (4 in), the flood level.

3.2.9 Guideline 3.9: Safe food storage

Guideline 3.9—There should be safe food storage systems.

Indicators for Guideline 3.9

1. Temperatures used in storage should not support microbial pathogen growth.
2. Ready to eat food is separated from raw food.
3. All food is separated and protected from sources of contamination.

Guidance notes for Guideline 3.9

1. Temperature

Inadequate food temperature control is one of the most common causes of foodborne illness and food spoilage on ships. On passenger ships the preparation of a wide variety of foods, at the same time, for a large number of people, increases the risk of mishandling food and unsatisfactory temperature variations. For example, an outbreak of staphylococcal food poisoning on a cruise ship occurred after pastry was prepared in large quantities by several food handlers. This provided opportunities for the introduction of staphylococci into the pastry. Prolonged time at warm temperature allowed for production of enterotoxin.

In large scale catering it is often necessary to prepare food hours before it is needed and to hold food, under refrigeration, in a hot holding apparatus, or even at ambient temperature. If procedures are strictly controlled and storage temperatures are at levels that will not permit bacterial growth, then hazards can be adequately controlled. The ship's operators must implement systems to ensure that temperature is controlled effectively where it is critical to the safety and suitability of food. Where appropriate, temperature-recording devices must be checked at regular intervals and tested for accuracy by the crew.

The temperature within refrigerators and freezers should be measured using an internal thermometer. Sufficient shelving is needed in all refrigeration units to prevent stacking and to permit adequate ventilation and cleaning. Examples of suitable food storage temperatures are found in VSP and Codex references which specifically relate to the storage of food on passenger and cruise ships. These documents are subject to periodic review and current versions should be considered by the ship's operator.

When foods are undercooked or inadequately thawed, particularly large joints of meat or poultry, with cooking times too short and temperatures too low, salmonellae and other bacteria may survive. Subsequent poor storage will permit multiplication of organisms and the introduction of a significant risk.

It is important that large joints of meat and poultry are thawed out before cooking. Precautions need to be taken to cool cooked food quickly and to cold store those items that will not be cooked immediately.

2. Separation of raw and ready to eat food

Pathogens can be transferred from one food to another, either by direct contact or by food handlers, contact surfaces or via airborne transmission. Space is sometimes limited in galleys preventing the clear separation of raw and cooked foods.

Raw food, especially meat, needs to be effectively separated, either physically or by time, from ready to eat foods, with effective intermediate cleaning and where appropriate, disinfection. Surfaces, utensils, equipment, fixtures and fittings must be thoroughly cleaned and where necessary disinfected after raw food has been handled.

3. Separation of food from contaminant sources

Systems must be in place to prevent contamination of foods by foreign bodies such as glass or metal shards from machinery, dust, harmful fumes and unwanted chemicals, particularly after any maintenance work.

3.2.10 *Guideline 3.10: Maintenance and cleaning*

Guideline 3.10—There should be a comprehensive maintenance and cleaning program.

Indicators for Guideline 3.10

1. There is a comprehensive maintenance and cleaning program.

Guidance notes for Guideline 3.10

Cleaning and disinfection programmes ensure that all parts of the establishment are appropriately clean, and include the cleaning of cleaning equipment. Cleaning and disinfection programmes must be continually and effectively monitored for their suitability and effectiveness and where necessary, documented.

Cleaning can remove food residues and dirt, which may be a source of contamination. The necessary cleaning methods will depend on the nature of the catering and size of the ship. Disinfection may be necessary after cleaning. Cleaning chemicals should be handled and used carefully and in accordance with manufacturers' instructions. Cleaning chemicals should be stored, separately from food, in clearly identified containers to avoid the risk of contamination. Galley and food areas and equipment need to be kept in an appropriate state of repair and condition to:

- facilitate all cleaning and disinfection procedures;
- function as intended, particularly at critical steps; and
- prevent contamination of food e.g. from debris and chemicals

Cleaning must be carried out by separate or the combined use of physical methods, such as heat, scrubbing, turbulent flow, vacuum cleaning or other methods that avoid the use of water, and chemical methods using detergents, alkalis or acids. Cleaning procedures may involve:

- removing gross debris from surfaces;
- applying a detergent solution to loosen soil and bacterial film;
- rinsing with potable water to remove loosened soil and residues of detergent; and
- where necessary disinfection.

Where written cleaning programmes are used, they might specify:

- areas, equipment and utensils to be cleaned;
- cleaning materials/equipment and chemicals to be used;
- who is responsible for particular tasks;
- methods, including the dismantling and re-assembly of equipment;

- safety precautions;
- frequency of cleaning and monitoring arrangements; and
- the standard(s) to be achieved.

In addition, there may at times, be deep cleaning, such as at six-monthly or annual intervals, subject to usage and requirements of the specific area, e.g. ducting and extraction systems. Cleaning programmes might also be in place for environmental cleaning, with appropriate methods for cleaning the cleaning materials.

During pesticide spraying all foodstuffs, utensils, food preparation and cleansing equipment should be covered to protect them from toxic substances. Instructions for the use of sprays should be carefully followed (refer chapter 7).

3.2.11 Guideline 3.11: Personnel hygiene

Guideline 3.11—Food handling personnel should maintain personal hygiene.

Indicators for Guideline 3.11

1. All food handlers should practice good food hygiene.
2. Food handlers known to be infected with potentially hazardous conditions are not permitted to handle food.

Guidance notes for Guideline 3.11

Crew, including maintenance personnel, who do not maintain an appropriate degree of personal cleanliness, or who have certain illnesses or conditions, can contaminate food and transmit illness to consumers.

1. Food handler hygiene.

Food handlers need to maintain a high degree of personal cleanliness and, where appropriate, wear suitable protective clothing, head covering, and footwear. Cuts and wounds, where personnel are permitted to continue working, must be covered by suitable waterproof dressings.

Protective clothing should be light-coloured, without external pockets and not one-piece overalls, as these could become contaminated from the floor when using the toilet. Disposable gloves might be used in some food handling situations, however they can be misused and give food handlers a false sense of hygiene security.

Personnel need to wash their hands to ensure food safety, for example:

- at the start of food handling activities;
- immediately after using the toilet;
- after handling raw food or any contaminated material, where this could result in contamination of other food items; and
- they should avoid handling ready to eat food or money.

People engaged in food handling activities must refrain from behaviour which could result in contamination of food such as:

- smoking;
- spitting;
- chewing or eating; and
- sneezing or coughing over unprotected food.

Personal effects such as jewellery, watches, pins or other items must not be worn or brought into food handling areas if they pose a threat to food safety.

2. Food handler illness.

Crew known, or suspected, to be suffering from, or a carrying a disease or illness likely to be transmitted through food, should not be allowed to enter any food handling areas if there is a likelihood of them contaminating food. Any person affected needs to immediately report their illness or symptoms. In one outbreak of foodborne viral gastroenteritis six foodhandlers were ill but were reluctant to report their infections because of concern about job security. The outbreak investigation implicated freshly cut fruit salad at two buffets. This is a difficult issue to resolve because food handlers may deny that they are ill for fear of being penalised. Even once symptoms of illness have abated, people can remain infectious, or symptoms may reappear. Therefore, food handlers should ideally not begin working with food for at least 48 hr, following the cessation of symptoms. In practice, this recommendation is purely practical since people can remain infectious for weeks, albeit at a reduced level. Therefore, recently ill food handlers should be encouraged to take extra precautions.

Conditions which should be reported to management so that any need for medical examination and/or possible exclusion from food handling can be considered include:

- jaundice;
- diarrhoea;
- vomiting;
- fever;
- sore throat with fever;
- visibly infected skin lesions (boils, cuts etc); and
- discharges from the ear, eye or nose.

New food handling staff must be asked questions about their state of health and all food handling staff must be asked about their state of health after a period of leave.

Possible questions include those found in the “Guidance for Food Businesses, Enforcement Officers and Health Professionals, Department of Health, UK, 1995” which provides questions to ask employees when considering employing new food handlers or reinstating food handlers after any extended shore leave.

3.2.12 Guideline 3.12: Training

Guideline 3.12—Food handlers should be adequately trained in food safety.

Indicators for Guideline 3.12

1. There is a comprehensive food handler training program.

Guidance notes for Guideline 3.12

Those engaged in food preparation or who come directly or indirectly into contact with food need to be trained, and/or instructed in food hygiene to a level appropriate to the operations they are to perform.

Food hygiene training is fundamentally important. All personnel need to be aware of their role and responsibilities in protecting food from contamination or deterioration. Food handlers need to have the necessary knowledge and skills to enable them to handle food hygienically. Those who handle strong cleaning chemicals or other potentially hazardous chemicals must be instructed in safe handling techniques. This includes maintenance personnel who enter food handling areas in order to undertake their work. It is not essential that such employees are trained in all food hygiene matters, but they should have an awareness of the relevant hygiene aspects appropriate to their work.

Periodic assessments of the effectiveness of training and instruction programmes must be made, as well as routine supervision and checks to ensure that procedures are being carried out effectively.

Managers and supervisors of food processes need to have the necessary knowledge of food hygiene principles and practices to be able to judge potential risks and take the necessary action to remedy deficiencies. Annex B provides an example of a training checklist. More advanced training courses should deal with management and systems, including HACCP.

3.2.13 Guideline 3.13: Food wastes

Guideline 3.13—Food waste should be stored and disposed of in a hygienic manner.

Indicators for Guideline 3.13

1. Food waste is managed to prevent contamination of food and to prevent vermin proliferation.

Guidance notes for Guideline 3.13

Food wastes and refuse readily attract rodents and vermin, particularly flies and cockroaches. The proper retention, storage and disposal of such wastes on board, ashore, and overboard where shore areas will not be affected, will prevent the creation of health hazards and public nuisances.

All ships must be equipped with facilities for safe storage of food refuse. All food refuse must be received and stored in watertight, non-absorbent and easily cleaned containers, fitted with tight covers which should be closed during food preparation and serving and cleaning operations in food-handling spaces. These containers must be placed in waste storage spaces, specifically constructed and used for this purpose, or on open decks when necessary. After each emptying, each container must be thoroughly scrubbed, washed, and treated with disinfectant, if necessary, to prevent odours and to minimize the attraction of rodents, flies and cockroaches. Containers should not be left uncovered except during the necessary food handling and clean up procedures.

It is important to characterize the waste stream and the amount of wastes produced in galleys and related areas in order to provide a basis for planning to prevent environmental contamination. People in charge of waste collection should use personal protection equipment including special disposable gloves, face masks and/or protective eyewear, safety boots and appropriate protective clothing.

4 RECREATIONAL WATER ENVIRONMENTS

4.1 Background

This chapter focuses on waterborne disease arising due to recreational water environments on cruise ships. A previous chapter (Chapter 2) considered disease associated with potable water supplied on board.

4.1.1 Health risks associated with recreational water environments on ships

Recreational water environments can present a number of risks to health. The most immediate and severe danger arises from accidental drowning. Another source of harm is injuries, potentially serious or even fatal, that can arise from slipping and tripping or from becoming snagged in ropes and fences or fittings such as ladders and drains. There have even been cases where swimmers have been thrown clear of the pool onto hard surfaces in heavy seas. In relation to ship sanitation, a number of infectious diseases can be acquired in swimming and spa pools and cause diarrhoea or skin, ear, eye, and upper respiratory infections. Hot tubs and whirlpools and associated equipment can create an ideal habitat for the proliferation of *Legionella* spp. and *Mycobacteria* spp. In addition, *Pseudomonas aeruginosa* is frequently present in whirlpools and skin infections have been reported when the pool design or management is poor.

Faecal-oral pathogens have commonly been associated with swimming and spa pools and arise from pathogens entering with sewage or animal faecal contamination or from contamination released directly by infected bathers. One of the most important such pathogens is *Cryptosporidium* spp. which has infectious oocysts that are resistant to even the highest levels of chlorine that are generally used for maintaining residual disinfection in pools. Thousands of cases of swimming-associated cryptosporidiosis have been reported (Lemmon et al., 1996, CDC 2001a) and public swimming pools can be temporarily shut down as a result. Where water quality and treatment have been inadequate, bacterial infections from *Shigella* spp. (CDC 2001b) and *Escherichia coli* O157:H7 (CDC 1996) have been associated with swimming and spa pools.

Infections of surfaces such as skin and ears have been associated with spa pools where disinfection has been inadequate. These infections arise from opportunistic pathogens that are commonly present in water and soils. The recreational water environment presents a considerable risk because it can both amplify the concentration of the hazard and facilitate exposure to humans. The presence of organic matter and elevated temperatures associated with many recreational water environments can provide an environment suitable for the proliferation of opportunistic pathogens that can infect mucous membranes, lungs, skin and wounds. The loss of disinfectant residual in these environments will permit proliferation of such pathogens to unsafe levels.

P. aeruginosa infection has been associated with a number of skin and ear infections arising from immersion in water with inadequate disinfection (Gustafson et al., 1983, Ratnam et al., 1986, CDC 2000). Symptoms have included outer ear and ear canal infections (“Swimmer’s Ear” or “Otitis Externa”) and skin infections such as dermatitis and folliculitis. Where aerosols are generated, the elevated temperature found in some recreational water environments can support *Legionella* spp., infections from which have caused outbreaks of legionnaire’s disease associated with hot tubs, including outbreaks on board ships discussed in the review by Rooney et al., (2004). More recently, mycobacterial infections have been associated with pneumonitis linked to exposure to aerosols from swimming and spa pools (Falkinham 2003).

In using disinfectants, risk from microbial hazards can arise. For example, harm can result from excessive disinfectant chemical addition either directly or potentially through disinfection by-products. The disinfection by-products arise when chlorine reacts with organic matter, such as is found in sloughed skin, sweat and urine, and forms organohalide compounds, such as chloroform. Ozone can also react to produce a different set of by-products. These by-product compounds are of uncertain health significance at the low concentrations found but might be weakly associated with certain types of cancer or adverse pregnancy outcomes if consumed in large amounts (WHO 2004a).

Recreational water environment usage levels are directly related to risk. The more people that recreate, the higher the concentrations of pathogens released, the greater the demand on the disinfection system and the higher the number of people in a position to become infected.

Pools are particularly attractive to children and infants which in turn gives rise to an increased risks of

contamination and safety. Children and infants are more likely to swallow pool water and be infected with enteric pathogens than adults and they are more likely to release faeces into the water, either through smears or through accidental faecal release. Finally, children and infants are more prone to carelessness and slips, trips and drowning than adults.

Another important risk factor that particularly affects pools on ships is the movement of the ship itself. This movement increases the likelihood of accidents in particular.

4.1.2 Recreational water environment guidelines

The Guidelines for Safe Recreational Waters Volume 2 - Swimming Pools and Similar Recreational Water Environments (WHO 2004b) should be referred to as these apply generally to recreational water environments. Attention should be given to the contemporary use of a preventive, multiple barrier risk management approach to recreational water safety (WHO 2004b).

4.2 Guidelines

This section provides user-targeted information and guidance, identifying responsibilities and providing examples of practices that can control risks. Three specific **Guidelines** (situations to aim for and maintain) are presented, each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action).

4.2.1 Guideline 4.1: Design and operation

Guideline 4.1—Pools should be designed and operated in ways that reduce risks to safe levels.

Indicators for Guideline 4.1

1. Circulation and hydraulics ensure adequate mixing to enable disinfection.
2. A realistic bather load is catered for in the design.
3. Filtration is designed to remove oocysts and cysts.
4. Disinfection is designed to inactivate pathogens.
5. *Legionella* spp. bacteria are controlled through the use of biocides and water turnover.
6. Ventilation is designed to maintain air quality within the indoor recreational water environment.
7. Showers and toilets are incorporated into the design to reduce risks of faecal shedding and other contamination.

Guidance notes for Guideline 4.1

Outbreaks associated with recreational water environments have been linked to poor system design. Therefore, the first disease prevention strategy is ensuring the adequate design of recreational water environments given the extent and nature of use. Another common cause of outbreaks is improper operation of controls such as allowing recreational water environments to be bunkered beyond capacity or engaging in poor operational practices. Design limits should be adhered to and systems should be properly operated at all times.

Treatment systems can reduce contamination levels but these can become overloaded. Therefore, reliance should not be placed on treatment alone and multiple barriers should be actively maintained including:

- filling and topping up recreational water environments with the safest possible water;
- controlling usage rates to within system design capacity;
- maintaining treatment to control forms of contamination; and
- taking prompt action to clear the recreational water environment and remove overt contamination, such as visible faecal releases.

Swimming pools and similar recreational water environments may be located either outdoors, indoors or both. They may be supplied with potable or marine water, supervised or unsupervised and heated or

unheated. For the purposes of this guide swimming pools, hot tubs, whirlpools, spa pools and plunge pools are considered together under the general heading of recreational water environments .

Pool design needs to be tailored to a realistic understanding of the way that the pool will be used. For example, the number and type of users, temperature of use and any special health considerations for particular user groups will all affect the details of how the pool should be designed, constructed and managed. Specific considerations might include:

- the daily opening hours;
- the peak periods of use;
- the anticipated number of users; and
- special requirements such as temperature and equipment.

Swimming and bathing pool water needs to be safe. These water quality requirements need to be met through optimal matching of the following design factors:

- design of the correct pool hydraulics (to ensure optimal distribution of disinfectant throughout the pool);
- recirculating swimming pools need to provide adequate circulation, such as complete circulation of the water within the pool, with replacement of the water every 6 hours, or less during pool operation;
- installation of the appropriate treatment system (to remove particulate pollutants and disinfectant-resistant microorganisms);
- installation of a disinfection system (to inactivate infectious microorganisms so that the water cannot transmit and propagate disease-causing microbiological agents); and
- inclusion of systems to add fresh water at frequent intervals (to dilute substances that cannot be removed from the water by treatment).

The control of pathogens is typically achieved by a combination of recirculation of pool water through treatment (typically involving some form of filtration plus disinfection) and the application of a residual disinfectant to inactivate microorganisms introduced to the pool by bathers.

A dedicated crew member should be assigned to the operation of the recreational water environment and should be suitably trained.

Swimming pools

The flow through swimming pool is generally the type most practicable for construction, installation and operation on board ships, while fill and draw swimming pools are not recommended. The pool and its water supply needs to be designed, constructed and operated in view of the health and safety protection of bathers and are summarised in the paragraphs below, while details on specific requirements of pool and spa types follows.

Circulation and hydraulics

The purpose of giving close attention to circulation and hydraulics is to ensure that the whole pool is adequately served. Treated water needs to reach all parts of the pool, and polluted water needs to be removed - especially from areas most used and most polluted by bathers. If not, even good water treatment may not result in good water quality. The design and positioning of inlets, outlets and surface water withdrawal are crucial.

Pools usually use seawater, or a potable water supply passing through an air gap or backflow preventer. The fill level of the pool is at the skim gutter level. The pool overflows can either be directed by gravity to the make-up tank for recirculation through the filter system or disposed of as waste. Surface skimmers need to be capable of handling sufficient volume, such as approximately 80 percent, of the filter flow of the recirculation system. There should be sufficient skimmers, such as at least one skimmer for each 47 m² (500 ft²) of pool surface area.

Circulation rate is related to turnover period, which is the time taken for a volume of water equivalent to the entire pool water volume to pass through the filters and treatment plant and back to the pool. In principle, the shorter the turnover period, the more frequent the pool water treatment. Turnover periods

need to suit the particular type of pool. Ideally, turnover must be designed to vary in different parts of the pool: longer periods in deep areas, shorter where it is shallow.

Disinfectant and treatment will not remove all pollutants. The design of a swimming pool should recognize the need to dilute the pool water with fresh water. Dilution limits the build-up of pollutants from bathers (e.g., constituents of sweat and urine), the by-products of disinfection and various other dissolved chemicals and pollutants.

A drain must be installed at the lowest point in the pool, and drainage facilities need to be sufficient to ensure quick emptying. The drains from the pool should be independent; however, when they are connected to any other drainage system, a back-water valve must be installed in the recreational water environment to stop cross-connections. Anti-vortex and anti-entanglement type drain covers must be provided, which are constructed of durable easily visible and easily cleanable material.

Children's pools can have their own independent recirculation, filtration and halogenation system because children are particularly potent sources of pathogens. The turn-over rate of water needs to be sufficient, ideally higher than in adult pools, such as at least once every 30 minutes. Anti-vortex and anti-entanglement type drain covers must be provided that are constructed of durable easily visible, easily cleanable material.

Filtration

Controlling clarity involves adequate water treatment, usually involving filtration and coagulation. Filtration is crucial to good water quality, impacting both aesthetic clarity and disinfection. Disinfection will be compromised by reduced clarity, as particles associated with turbidity can surround microorganisms and shield them from the action of disinfectants. In addition, filtration is important for removing *Cryptosporidium* oocysts and *Giardia* cysts and some other protozoa that are relatively resistant to chlorine disinfection.

Filters need to be designed to remove particles at a sufficient rate, such as removing all particles greater than 10 µm from the entire volume of the pool in 6 hours or less. Filters can be cartridge or media-type (e.g: rapid-pressure sand filters, high rate sand filters, diatomaceous earth filters or gravity sand filters). All media-type filters need to be capable of being back-washed. Filter accessories, such as pressure gauges, air-relief valves, and rate-of-flow indicators should be provided as required. Sufficient access should be maintained to sand filters so that they can be inspected at a regular frequency, at least on a weekly basis and the media must be changed periodically.

Some of the factors that are important to consider in the design of a granular media (such as sand) filtration system include:

- Filtration rate: the higher the filtration rate, the lower the filtration efficiency. Some of the higher-rate granular filters do not handle particles and colloids as effectively as medium-rate filters and cannot be used with coagulants.
- Bed depth: The correct sand bed depth is important for efficient filtration.
- Number of filters: pools will benefit greatly from the increased flexibility and safeguards of having more than one filter. In particular, pools can remain in use with a reduced turnover on one filter while the other one is being inspected or repaired. Filtered water from one filter can be used to backwash another.
- Backwashing: the cleaning of a filter bed clogged with suspended solids is referred to as backwashing. It is accomplished by reversing the flow, fluidizing the sand and passing pool water back through the filters to waste. It should be initiated as recommended by the filter manufacturer, when the allowable turbidity value has been exceeded or when a certain length of time without backwashing has passed. The filter may take some time to settle once the flow is returned to normal and water should not be returned to the pool until it has.
- A hair strainer is required between the pool outlet and the suction side of the pumps to remove foreign debris such as hair, lint, and pins etc. The removable portion of the strainer should be corrosion-resistant and have holes that are smaller than 6 mm (0.24 in) in diameter.

Coagulants (and flocculants) enhance the removal of dissolved, colloidal or suspended material by bringing this material out of solution or suspension as solids (coagulation), then clumping the solids together (flocculation), producing a floc, which is more easily trapped in the filter. Coagulants are

particularly important in helping to remove the infective cysts and oocysts of *Cryptosporidium* spp. and *Giardia* spp., which otherwise would pass through the filter. Coagulant efficiency is dependent upon pH which, therefore, needs to be controlled. Dosing pumps should be capable of accurately dosing the small quantities of coagulant required and adjusting to the requirements of the bathing load. Coagulation is often required as a prerequisite to effective filtration, depending on the filtration process selected.

Chemical dosing including disinfection

Disinfection is a process whereby pathogenic microorganisms are removed or inactivated by chemical (e.g. chlorination) or physical (e.g. filtration, UV radiation) means such that they represent no significant risk of infection. Recirculating pool water is disinfected using the treatment process, and the entire water body is disinfected by application of a disinfectant residual, which inactivates agents added to the pool by bathers.

Chlorination is the most widely used pool water disinfectant, usually in the form of chlorine gas or sodium or calcium hypochlorite. Ozone in combination with chlorine or bromine is a very effective disinfection system but the use of ozone alone cannot ensure a residual disinfectant capacity throughout the swimming pool.

For disinfection to occur with any biocidal chemical the oxidant demand of the water being treated must first be satisfied and sufficient chemical must remain to effect disinfection.

Issues to be considered in the choice of a disinfectant and application system include:

- safety;
- compatibility with the source water (hardness and alkalinity);
- type and size of pool (disinfectant may be more readily degraded or lost through evaporation in outdoor pools);
- oxidation capacity;
- bathing load (sweat and urine from bathers will increase disinfectant demand); and
- operation of the pool (i.e. supervision and management).

The choice of disinfectant used as part of swimming pool water treatment should ideally comply with the following criteria:

- effective, rapid, inactivation of pathogenic microorganisms;
- capacity for ongoing oxidation to assist control of contaminants during pool use;
- a wide margin between effective biocidal concentration and concentration resulting in adverse effect on human health;
- availability of a quick and easy determination of the disinfectants concentration in pool water (simple analytical and test methods); and
- potential to measure the disinfectant's concentration electrometrically to permit automatic control of disinfectant dosing and continuous recording of the values measured.

Commonly used disinfectants include:

- Chlorine is inexpensive and relatively convenient to produce, store, transport and use. The chlorinated isocyanurate compounds are somewhat complex white crystalline compounds with slight chlorine-type odour that provide free chlorine when dissolved in water. They are an indirect source of chlorine, via an organic reserve (cyanuric acid). The relationship between the chlorine residual and the level of cyanuric acid is critical and can be difficult to maintain. Chlorinated isocyanurates are not suited to the variations in bathing loads usually found in large pools. However, they are particularly useful in outdoor swimming pools exposed to direct sunlight where UV radiation rapidly degrades free chlorine.
- Ozone can be viewed as the most powerful oxidizing and disinfecting agent that is available for pool and spa water treatment. However, it is unsuitable for use as a residual disinfectant. It is most frequently used as a treatment step, followed by deozonation and addition of a residual disinfectant, such as chlorine. Excess ozone must be destroyed by an activated carbon filter because this toxic gas could settle, to be breathed by pool users and staff. Residual disinfectants

should also be removed by the activated carbon filter and are, therefore, added after this step.

- Like ozone, UV radiation is a plant-room treatment that purifies the circulating water, inactivating microorganisms and to a certain extent breaks down some pollutants by photo-oxidation. This decreases the chlorine demand of the purified water but does not leave a disinfectant residual in the pool water. For UV to be most effective, the water must be pre-treated to remove turbidity-causing particulate matter that prevents the penetration of the UV radiation or absorbs the UV energy.

Microbial colonization of surfaces can be a problem and is generally controlled through cleaning and disinfection such as shock dosing and cleaning.

The method of introducing disinfectants to the pool water influences their effectiveness. Individual disinfectants can have their own specific dosing requirements, but the following principles apply to all:

- Automatic dosing is preferable: electronic sensors monitor pH and residual disinfectant levels continuously and adjust the dosing correspondingly to maintain correct levels. Regular verification of the system (including manual tests on pool water samples) and good management are important.
- Hand dosing (i.e. putting chemicals directly into the pool) is rarely justified. Manual systems of dosing must be backed up by good management of operation and monitoring. It is important that the pool is empty of bathers until the chemical has dispersed.
- Trying to compensate for inadequacies in treatment by shock dosing is bad practice, because it can mask deficiencies in design or operation that may produce other problems and can generate unwelcome by-products.
- Dosing pumps should be designed to shut themselves off if the circulation system fails (although automatic dosing monitors should remain in operation) to ensure that chemical dispersion is interrupted.
- Residual disinfectants are generally dosed at the very end of the treatment process. The treatment methods of flocculation, filtration and ozonation serve to clarify the water, reduce the organic load and greatly reduce the microbial count, so that the post-treatment disinfectant can be more effective and the amount of disinfectant that must be used can be minimized.
- It is important that disinfectants and pH adjusting chemicals be well mixed with the water at the point of dosing.
- Dosing systems, like circulation, should continue 24 h per day.

The production of disinfection by-products can be controlled by minimizing the introduction of their organic precursors (compounds that react with the disinfectant to yield the by-products) through good hygienic practices (pre-swim showering), and maximizing their removal by well managed pool water treatment. The control of disinfectant by-products involves dilution, treatment and disinfection modification or optimization. Because of the presence of bromide ions in salt water, a common by-product formed in the water and air of seawater pools on ships will be bromoform which can result from either chlorine or ozone treatment.

It is inevitable that some volatile disinfectant by-products will be produced in the pool water and escape into the air. This hazard can be managed to some extent through good ventilation.

The use of analyzers helps to automate dosing and optimize conditions for pool safety, such as automatic dosing of chemicals for disinfection and pH adjustment. Water sample points must be provided throughout the system for the testing of halogen levels and routine calibration of the analyzer. Analyzer controlled halogen-based disinfection equipment would be provided as required. It may be necessary to ensure that pH adjustment is accomplished by using appropriate acids and bases and that a buffering agent is used to stabilize the pH. This can be added to the functionality of the analyzer.

Legionella control

In recreational water environments it is impractical to maintain temperatures outside the range 25 to 50°C. However *Legionella* spp. levels can be kept under control through the implementation of appropriate management measures, including filtration and maintenance of a continuous disinfection residual in recreational water environments, and the physical cleaning of all spa pool equipment

including associated pipes and air-conditioning units. Rooms housing recreational water environments must be well ventilated to avoid an accumulation of *Legionella* spp. in the indoor air. Therefore, it is necessary to design and implement a range of other management strategies, which may include:

- Add biocides to the spa water, plumbing, and filter. Whirlpool spas shall typically maintain a free residual chlorine of ≥ 3.0 mg/L (ppm) and ≤ 10 mg/L (ppm), or a free residual bromine of ≥ 4.0 mg/L (ppm) and ≤ 10 mg/L (ppm) (WHO 2004b). However, in some areas there are alternative lower and upper limits expressed. To ensure that free halogen is effective for disinfection, there is a need to maintain or regularly adjust the pH, typically remaining in the range 7.2 to 7.8.
- Ensure staff have appropriate training and skills to operate the recreational facility.
- Apply a constant circulation of water in the whirlpool and spa pool.
- Cleaning filter systems, e.g. by back-washing filters.
- Clean pool surrounds.
- Replace a portion, e.g. 50%, of the water in each whirlpool and spa pool daily.
- Completely drain whirlpools, spa pools and natural thermal pools and thoroughly physically clean all surfaces and all pipe work regularly.
- Maintain and physically clean heating ventilation air conditioning (HVAC) systems serving the room in which spa pools are located.
- Installation of signs that list standard safety precautions, placed near the recreational water environments that cautions people who are immunocompromised or who are taking immunosuppressant medicines against using the recreational water environments.

Routine cleaning of the whole circulatory system, including the spa, sprays, pumps and pipe work, is critical and can require quite intensive doses of disinfectant since *Legionella* spp. can persist in biofilms (scums on the surfaces of fittings and pipework) making them difficult to inactivate.

Bathers must be encouraged to shower before entering the water. This will remove pollutants such as perspiration, cosmetics and organic debris that can act as a source of nutrients for bacterial growth and as neutralising agents for the oxidizing biocides. Bather density and duration in whirlpools and spa baths can also be controlled. Spa pool facilities may require programmed rest periods during the day to allow recovery of disinfectant concentrations.

Testing for *Legionella* spp. bacteria serves as a form of verification that the controls are working and should be undertaken periodically, e.g. monthly, quarterly or annually, depending on the type of ship environment. This testing should not replace, or pre-empt the emphasis on control strategies. Furthermore, the tests are relatively specialised and need to be undertaken by properly equipped laboratories using experienced staff and, therefore, are not generally performed by crews or during voyages. Verification sampling should focus on system extremities and high-risk sites.

Air quality

It is important to manage air quality as well as water quality in swimming pools, spas and similar recreational water environments. Rooms housing spas should be well ventilated to avoid an accumulation of *Legionella* spp. in the indoor air. In addition, ventilation will help reduce exposure to disinfectant by-products in the air. Adequate ventilation should reduce risks from *Legionella* spp., but it is important that the system does not create its own risks. All surfaces of HVAC systems serving the room in which the spa is located should be physically cleaned and disinfected to control biofilm.

Other design and construction aspects

The pool mechanical room must be made readily accessible and well-ventilated and a potable water tap must be provided in this room. To help with ongoing maintenance, it is valuable to mark all piping with directional-flow arrows and maintain a flow diagram and operational instructions in a readily available location. The pool mechanical room and re-circulation system needs to be designed for easy and safe storage of chemicals and re-filling of chemical feed tanks. Drains need to be installed in the pool mechanical room in order to allow for rapid draining of the entire pump and filter system, with a sufficiently large drain, at least 8 cm (3.1 in), being installed on the lowest point of the system.

To help reduce drowning risks, the depth of the pool and depth markers must be displayed prominently

so that they can be seen from the deck and in the pool. Depth markers must be in either in feet or meters, or both and be installed for every significant change of depth, 1 m (3.3 feet).

Re-circulating pools

The equipment and the operating procedures need to provide complete circulation of the water within the pool at a sufficient frequency, such as replacement of the water every 6 hours, or less, during pool operation. Equipment should include filters and other equipment and devices for disinfection and treatment as may be necessary to meet the requirements or recommendations of the national health administration of the country of registration. Self-priming, centrifugal pumps are suitable to re-circulate pool water.

Flow-through pools

The flow-through swimming pool is probably the type most practicable for construction, installation and operation on board ships. The number of bathers that can use a swimming pool safely at one time and the total number that can use a pool during one day are governed by the area of the pool and the rate of replacement of its water. Therefore, the pool should be designed with special attention to the probable peak bathing load and the maximum space available for the construction of a pool. The following principles should be applied in the design of flow-through pools.

The design capacity of the pool should be judged on the basis of the area, such as 2.6 m² (27 ft²) per bather. For the maintenance of satisfactorily clean water in the pool, the rate of flow of clean water needs to be sufficient to achieve complete replacement every 6 hours or less. The water flowing through must be delivered to the pool through multiple inlets, located to ensure uniform distribution. These inlets can be served by a branch line taking off from the main supply line, at the pressure side of the filling valve near the pool. Control of the flow must be independent of the filling valve.

The overflow must be discharged into skim gutters or a similar boundary overflow, with multiple outlets spaced at not more than 3 m (9.8 ft) apart, and discharging to the waste system.

The bottom of the pool should slope towards the drain or drains in such a manner as to effect complete drainage of the pool. In the interest of safety, the slope of any part of the pool bottom in which the water is less than a standing depth, 1.8 m (6 ft) deep, should not be more than a 1 in 15 gradient. For safety, there should be no sudden change of slope within the area where the water depth is shallow, less than 1.5 m (5 ft).

It is preferable to have a separate water-supply system, including the pump for the recreational water environments. The water intake must be forward of all sewage and drainage outlets. However, if the pool is to be filled and operated only when the ship is underway, the fire or sanitary water pumps, or a combination of these pumps may be used, noting that the following can be used to reduce contamination risks:

- The delivery line to the pool is independent of other lines originating at or near the discharge of the pump or the valve manifold, or at a point where the maximum or near-maximum flushing of the fire or sanitary water pump.
- If seawater is drawn into the pool, water should not be drawn when the ship is in port, or if underway in contaminated waters. A readily accessible shut-off valve should be located close to the point from which the water is drawn, and be labelled "CLOSE WHILE IN HARBOURS".

Flow-through seawater supply systems for pools shall be used only while the ship is underway and at sea beyond 12 NM from land. The pool (when in flow-through seawater mode) should be drained before the ship reaches port, and it should remain empty while in port. If the pool is not drained before arriving in port, the pool's seawater filling system should be shut off 12 NM before reaching land, and a recirculation system should be used with appropriate filtering and halogenation.

Whirlpool spas

Whirlpools are subject to high bather loads relative to the volume of water. With high water temperatures and rapid agitation of water, it may become difficult to maintain satisfactory pH, microbiological quality

and disinfectant residuals, as such additional care must be taken in their operation.

Potable water supplied to whirlpool systems must be supplied through an air gap or approved backflow preventer. Water filtration equipment needs to be able to remove all particles greater than 10 µm from the entire whirlpool volume in 30 minutes or less. Filters can be cartridge, rapid pressure sand filters, high-rate sand filters, diatomaceous earth filters or gravity sand filters. A clear sight glass can be added on the backwash side of the filters.

The overflow system must be designed so that water level is maintained. It is advisable that whirlpool overflows are either directed by gravity to the make-up tank for recirculation through the filter system or disposed of as waste. Self-priming, centrifugal pumps must be used to recirculate whirlpool water.

Sufficient skimmers, one for every 14 m² (150 ft²) or fraction thereof of water surface area should be provided. The fill level of the whirlpool needs to be at the skim gutter level to enable skimming to take effect.

A temperature control mechanism is required to prevent the temperature from exceeding 40°C (104°F) to avoid scalding and overheating.

A make-up tank may be used to replace water lost by splashing and evaporation. An overflow line at least twice the diameter of the supply line, and located below the tank supply line should be used.

The system needs to permit regular, such as daily, shock treatment or superhalogenation. Halogenation equipment that is capable of maintaining the appropriate levels of free-halogen throughout the use period must be included.

Spa pools

Spa pools have different operating conditions and present a special set of problems to operators. The design and operation of these facilities make it difficult to achieve adequate disinfectant residuals. They may require higher disinfectant residuals because of higher bathing loads and temperatures, both of which lead to more rapid loss of a disinfectant residual.

A *P. aeruginosa* concentration of less than 1 per 100 ml should be readily achievable through good management practices. Risk management measures that can be taken to deal with these non-enteric bacteria include ventilation, cleaning of equipment and verifying the adequacy of disinfection.

Spa pools that do not use disinfection require alternative methods of water treatment to keep the water microbiologically safe. A very high rate of water exchange is necessary - even if not fully effective - if there is no other way of preventing microbial contamination.

In spa pools where the use of disinfectants is undesirable or where it is difficult to maintain an adequate disinfectant residual, superheating spa water to 70°C on a daily basis during periods of non-use may help control microbial proliferation.

To prevent overloading of spa pools, some countries recommend that clearly identifiable seats be installed for users combined with a minimum pool volume being defined for every seat, a minimum total pool volume and a maximum water depth.

4.2.2 Guideline 4.2: Pool hygiene

Guideline 4.2—Pool hygiene should be continuously maintained.

Indicators for Guideline 4.2

1. Pre-swim showering is promoted.
2. Pre-swim use of toilets is promoted.
3. Effective procedures are in place to respond to vomits and accidental faecal releases.

Guidance notes for Guideline 4.2

1. Pre-swim showering.

Pre-swim showers will remove traces of sweat, urine, faecal matter, cosmetics, suntan oil and other potential water contaminants. The result will be cleaner pool water, easier disinfection using a smaller amount of chemicals, and water that is more pleasant to swim in.

Pre-swim showers should be located adjacent to the swimming pool and be provided with water of drinking water quality as children and some adults may ingest the shower water. Shower water must run to waste.

2. Visiting toilets pre-swim.

Toilets must be provided where they can be conveniently used before entering the pool and after leaving the pool. Users should be encouraged to use the toilets before bathing to minimize urination in the pool and accidental faecal releases (AFRs). Parents need to encourage children to empty their bladders before they swim. Children below a certain age, such as below two years old, may not be permitted to use some pools.

3. Vomits and accidental faecal releases.

It is necessary to minimize accidental faecal releases (AFRs) and vomits and to respond effectively to them when they occur. AFRs appear to occur relatively frequently, and it is likely that most go undetected. A pool operator faced with an AFR or vomit in the pool water needs to act immediately.

If a faecal release is a solid stool, it can simply be retrieved quickly and discarded appropriately. The scoop used to retrieve it must be disinfected so that any bacteria and viruses adhering to it are inactivated and will not be returned to the pool the next time the scoop is used. As long as the pool is in other respects operating properly (disinfecting residuals, etc) no further action is necessary.

If the stool is runny (diarrhoea) or if there is vomit, the situation is potentially hazardous. Even though most disinfectants deal relatively well with many bacterial and viral agents in AFRs and vomits, the possibility exists that the diarrhoea or vomits is from someone infected with one of the protozoan parasites, *Cryptosporidium* and *Giardia*. The infectious stages (oocysts/cysts) are relatively resistant to chlorine disinfectants in the concentrations that are practical to use. The pool must therefore be cleared of bathers immediately.

The safest action, if the incident has occurred in a small pool, hot tub or whirlpool, is to empty and clean it before refilling and reopening. However, this may not be possible in larger pools.

If draining down is not possible, then the procedure given below - an imperfect solution that will only reduce but not remove risk - can be followed:

- the pool is cleared of people immediately;
- disinfectant levels are maintained at the top of the recommended range;
- the pool is vacuumed and swept;
- using a coagulant, the water is filtered for six turnover cycles. This could take up to a day and so might mean closing the pool until the next day;
- the filter is backwashed (and the water run to waste); and
- the pool is reopened.

There are a few practical actions pool operators can take to help prevent faecal release into the pools:

- no child (or adult) with a recent history of diarrhoea should swim;
- parents should be encouraged to make sure their children use the toilet before they swim;
- thorough pre-swim showering is a good idea and parents should encourage their children to do it;
- young children should whenever possible be confined to pools small enough to drain in the event of an accidental release of faeces or vomit; and

- lifeguards or pool attendants, if present, should be made responsible for looking out for and acting on AFR/vomits.

4.2.3 Guideline 4.3: Monitoring

Guideline 4.3—Monitor key parameters and maintain within target values.

Indicators for Guideline 4.3

1. Pool water turbidity is maintained within target values.
2. Disinfectant levels and pH are maintained within target values.
3. Microbial quality is maintained within target levels and there are effective procedures in place to respond to adverse detection events.

Guidance notes for Guideline 4.3

Frequent monitoring of control measures will help to provide early warning of deviations and could include:

- checking and adjusting the disinfection residual and pH;
- inspection of maintenance and cleaning operations;
- inspection of the physical condition of recreational water environments, filters and equipment; and
- undertaking surveillance for lower respiratory illness (e.g. pneumonia) among passengers and staff by recording all visits to the ship's medical office for confirmed or suspected pneumonia.

Parameters that are easy and inexpensive to measure and of immediate health relevance - that is, turbidity, disinfectant residual and pH - must be monitored frequently and in all pool types.

1. Turbidity

The ability to see either a small child at the bottom of the pool or markings on the pool bottom from the lifeguard or pool attendants position while the water surface is in movement, is important. A turbidity limit of 0.5 NTU, or equivalent measurement, provides a good target value for well-treated water. To exceed turbidity limits suggests both a significant deterioration in water quality and a significant health hazard. Such exceedance merits immediate investigation and may lead to facility closure pending remedial action.

2. Disinfectant and pH

For a conventional public or semi-public swimming pool with good hydraulics and filtration, operating within its design bathing load, adequate routine disinfection should be achieved with a free chlorine level of 1 mg/l (ppm) throughout the pool. In a well-operated pool it is possible to achieve such a residual with maximum levels in any single point below 2 mg/L (ppm) for pools. Lower residuals (0.5 mg/L (ppm)) will be acceptable in combination with the additional use of ozone or UV disinfection, whereas higher levels (ranging from 2–3 mg/l) may be required for hot tubs, because of higher bathing loads and higher temperatures (WHO *Guidelines for Safe Recreational Water Environments Volume 2: Swimming Pools, Spas and Similar Recreational Water Environments*, 2003).

Disinfectant residuals must be checked by sampling the pool before it opens and during the opening period (ideally during a period of high bathing load) (WHO *Guidelines for Safe Recreational Water Environments Volume 2: Swimming Pools, Spas and Similar Recreational Water Environments*, 2003). The frequency of testing during swimming pool use depends upon the nature and use of the swimming pool. Samples should be taken at a depth of 5–30 cm. It is good practice to include as a routine sampling point the area of the pool where the disinfectant residual is lowest. Occasional samples should be taken from other parts of the pool and circulation system. If the routine test results are outside the recommended ranges, the situation needs to be assessed and action taken.

The pH value of swimming pool water needs to be maintained within the recommended range to ensure optimal disinfection and coagulation. The pH should be maintained between 7.2 and 7.8 for chlorine disinfectants and between 7.2 and 8.0 for bromine-based and other non-chlorine processes (WHO

Guidelines for Safe Recreational Water Environments Volume 2: Swimming Pools, Spas and Similar Recreational Water Environments, 2003). In order to do so, regular pH measurements are essential, and either continuous or intermittent adjustment is usually necessary. For heavily used pools, the pH value must be measured continuously and adjusted automatically. For less frequently used pools, it may be sufficient to measure the pH manually.

To avoid the formation of excessive disinfectant by-product or disinfectant irritation to mucosal surfaces, disinfectant residuals should be maintained at levels that are consistent with satisfactory microbiological quality but that are not unnecessarily excessive. Operators should attempt to maintain free chlorine residual levels below 5 mg/L (ppm) at all points in the pool or spa.

3. Microbiological quality

There is limited risk of significant microbial contamination and illness in a well managed pool or similar environment with an adequate residual disinfectant concentration, a pH value maintained at an appropriate level, well operated filters and frequent monitoring of non-microbial parameters. Nevertheless, samples of pool water from public and semi-public pools should be monitored at appropriate intervals for microbial parameters, including heterotrophic plate count, thermotolerant coliforms or *E. coli*, *Pseudomonas aeruginosa* and *Legionella* spp. and *Staphylococcus aureus*. The frequency of monitoring and the guideline values vary according to microbial parameter and the type of pool.

Where operational guidelines are exceeded, pool operators should check turbidity, residual disinfectant levels and pH and then resample. When critical guidelines are exceeded, the pool should be closed while investigation and remediation are conducted.

- The HPC (37 °C for 24 h) gives an indication of the overall bacterial population within the pool. It is recommended that operational levels should be less than 200 cfu/ml.
- Thermotolerant coliforms and *E. coli* are indicators of faecal contamination. Either thermotolerant coliforms or *E. coli* should be measured in pools, hot tubs and spas. Operational levels should be less than 1/100 ml.
- Routine monitoring of *Pseudomonas aeruginosa* is recommended in hot tubs and spas. It is suggested for swimming pools when there is evidence of operational problems (such as failure of disinfection or problems relating to filters or water pipes), a deterioration in the quality of the pool water or known health problems. It is recommended that for continuously disinfected pools, operational levels should be <1/100 ml. If high counts are found (>100/100 ml), pool operators should check turbidity, disinfectant residuals and pH, resample, backwash thoroughly, wait one turnover and resample. If high levels of *P. aeruginosa* remain, the pool should be closed and a thorough cleaning and disinfection programme initiated. Hot tubs should be shut down, drained, cleaned and refilled.
- Periodic testing for *Legionella* spp. is useful, especially from hot tubs, in order to determine that filters are not being colonized, and it is recommended that operational levels should be <1/100 ml. Where this is exceeded, hot tubs should be shut down, drained, cleaned and refilled. Shock chlorination may be appropriate if it is suspected that filters have become colonized
- The routine monitoring of *Staphylococcus aureus* is not recommended, although monitoring may be undertaken as part of a wider investigation into the quality of the water when health problems associated with the pool are suspected. Where samples are taken, levels should be less than 100/100 ml.

Further advice on testing for *Legionella* spp. can be found in WHO (2008)

5 BALLAST WATER

5.1 Background

This chapter deals with the management of ballast water including its storage and safe disposal.

5.1.1 Health risks associated with ballast water on ships

Many ships use water as ballast to maintain stability and navigate safely, carrying from 30 to 50% of the total cargo in ballast water. This may represent a volume that would vary from a few hundred litres up to more than 10 thousand tonnes per ship. Therefore, this activity represents an important risk to human health with the possibility of introducing new endemic diseases and spreading disease by transferring pathogens and harmful organisms. In this context, more than 7 000 marine species travel daily and approximately ten billion tonnes of ballast water are transported annually by ship. Concern regarding transfer of ballast water and sediments from ships has increased and there is a theoretical possibility of transporting hazards such as toxigenic *Vibrio cholerae* O1 and O139 which might then be associated with cholera outbreaks in port areas.

5.1.2 Standards

The Marine Environment Protection Committee (MEPC) has adopted, since 1993, voluntary guidelines for the prevention of risks from unwanted organisms through Ballast Water and Sediments from ships. The IMO Assembly, in 1997, adopted through Resolution A.868 (20) the “Guidelines for the Control and Management of Ballast Water from Ships” in order to minimize the transfer of harmful aquatic organisms and pathogenic agents.

The “International Convention for the Control and Management of Ships’ Ballast Water and Sediments” was adopted in February 2004. The objective of this Convention is to prevent, minimize and ultimately eliminate the risks to the environment, human health, property and resources arising from the transfer of harmful aquatic organisms and pathogens through the control and management of ships’ Ballast water and sediments. Further, to provide guidance to avoid unwanted side-effects from the control measures put in place, and to encourage development in related knowledge and technology. The measures for inspection and control of the sanitary risk of ballast water tank sediments must consider the procedures established in the IMO International Convention for the Control and Management of Ships’ Ballast Water and Sediments. From 2009, but not later than 2016, the Convention requires the establishment of a Ballast Water Management System on board ships which will replace the uncontrolled ballast water uptake and discharge operations common until then. In future, ballast water has to be treated on board before being discharged into the marine environment, in compliance with the ballast water performance standard in Regulation D-2 of the Ballast Water Convention.

Parties of the Convention are given the right to take, individually or jointly with other Parties, more stringent measures with respect to the prevention, reduction or elimination of the transfer of harmful aquatic organisms and pathogens through the control and management of ships’ ballast water and sediments, consistent with international law.

5.2 Guidelines

This section provides user-targeted information and guidance, identifying responsibilities and providing examples of practices that can control risks. Three specific **Guidelines** (situations to aim for and maintain) are presented, each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action).

In some cases ballast water treatment systems have failed to perform as required, resulting in unsafe situations. Therefore, reliance should not be placed on treatment and management systems alone. Multiple ballast management barriers should be actively maintained including:

- filling with ballast water from safe environments wherever practicable;
- matching ballast treatment facilities to their required capacities; and
- maintaining sound practices in discharging ballast water.

Staff at ports and ship crews need to be adequately trained in the protection of the environment, safe

operation (including collection, handling and disposal of wastes) and relevant legislation.

5.2.1 Guideline 5.1: Ballast water management

Guideline 5.1—Ballast Water Management Plan should be designed and implemented.

Indicators for Guideline 5.1.

1. An approved Ballast Water Management Plan and System should be in place and reviewed regularly.
2. Ballast Water Management requirements and practices should be carried out as per the approved Plan and System.
3. A Ballast Water Record Book should be kept with accurate records maintained.
4. Audit measures are in place and adhered to.

Guidance notes for Guideline 5.1

Ships are required to implement a Ballast Water Management Plan approved by the Administration (Regulation B-1, IMO). The Ballast Water Management Plan is specific to each ship and includes a detailed description of the actions to be taken to implement the Ballast Water Management requirements and supplemental Ballast Water Management practices.

Ballast Water Management systems must be approved by the Administration in accordance with IMO Guidelines for the approval of ballast water management systems (G8) (Resolution MEPC.174(58)). These include systems which make use of chemicals or biocides; make use of organisms or biological mechanisms; or which alter the chemical or physical characteristics of the Ballast Water.

Ships must have a Ballast Water Record Book (Regulation B-2) to record when ballast water is taken on board; circulated or treated for Ballast Water Management purposes; and discharged into the sea. It should also record when Ballast Water is discharged to a reception facility and accidental or other exceptional discharges of Ballast Water.

Ships are required to be surveyed and certified (Article 7 Survey and certification) and may be inspected by port State control officers (Article 9 Inspection of Ships) who can verify that the ship has a valid certificate; inspect the Ballast Water Record Book; and/or sample the ballast water. If there are concerns, then a detailed inspection may be carried out and "the Party carrying out the inspection shall take such steps as will ensure that the ship shall not discharge Ballast Water until it can do so without presenting a threat of harm to the environment, human health, property or resources."

The specific requirements for ballast water management are contained in regulation B-3 Ballast Water Management for Ships:

- Ships constructed before 2009 with a ballast water capacity of between 1 500 and 5 000 cubic metres must conduct ballast water management that at least meets the ballast water exchange standards or the ballast water performance standards until 2014, after which time it shall at least meet the ballast water performance standard.
- Ships constructed before 2009 with a ballast water capacity of less than 1 500 or greater than 5 000 cubic metres must conduct ballast water management that at least meets the ballast water exchange standards or the ballast water performance standards until 2016, after which time it shall at least meet the ballast water performance standard.
- Ships constructed in or after 2009 with a ballast water capacity of less than 5 000 cubic metres must conduct ballast water management that at least meets the ballast water performance standard.
- Ships constructed in or after 2009 but before 2012, with a ballast water capacity of 5 000 cubic metres or more shall conduct ballast water management that at least meets the standard described in regulation D-1 or D-2 until 2016 and at least the ballast water performance standard after 2016.
- Ships constructed in or after 2012, with a ballast water capacity of 5 000 cubic metres or more shall conduct ballast water management that at least meets the ballast water performance

standard.

Guideline 5.2—Ballast water should be safely treated and disposed of.

Indicators for Guideline 5.2.

1. Disposal of ballast water is carried out safely.
2. Overboard discharge of ballast water are only carried out within permitted bounds.

Guidance notes for Guideline 5.1

1. Disposal of ballast water

Ships are not generally permitted to discharge ballast water, bilge water or any other liquid containing contaminating or toxic wastes within an area from which water for a water supply is drawn, or in any area restricted from the discharge of wastes by any national or local authority. Overboard discharge in harbours, ports and coastal waters are subject to the regulations of the governing authorities in these areas. Sewage, food particles, putrescible matter and toxic substances must not be discharged to the bilge.

The International Convention for the Control and Management of Ships' Ballast Water and Sediments Regulation has defined ballast water exchange standard and a ballast water performance standards.

As per, regulation D-1 Ballast Water Exchange Standard, ships performing Ballast Water exchange shall do so with an efficiency of 95 per cent volumetric exchange. For ships exchanging ballast water by the pumping-through method, pumping through three times the volume of each ballast water tank shall be considered to meet the standard described. Pumping through less than three times the volume may be accepted provided the ship can demonstrate that at least 95 percent volumetric exchange is met.

Regulation D-2 Ballast Water Performance Standard - Ships conducting ballast water management shall discharge less than 10 viable organisms per cubic metre greater than or equal to 50 µm in minimum dimension and less than 10 viable organisms per ml less than 50 µm in minimum dimension and greater than or equal to 10 micrometres in minimum dimension; and discharge of the indicator microbes shall not exceed the specified concentrations.

The indicator microbes, as a human health standard, include, but are not be limited to:

- a. Toxicogenic *Vibrio cholerae* (O1 and O139) with less than 1 colony forming unit (cfu) per 100 ml or less than 1 cfu per 1 gram (wet weight) zooplankton samples;
- b. *Escherichia coli* less than 250 cfu per 100 ml; and
- c. Intestinal Enterococci less than 100 cfu per 100 ml.

Other methods of ballast water management may also be accepted as alternatives to the ballast water exchange standard and ballast water performance standard, provided that such methods ensure at least the same level of protection to the environment, human health, property or resources, and are approved in principle by IMO's Marine Environment Protection Committee (MEPC).

Under Article 5 Sediment Reception Facilities, parties undertake to ensure that ports and terminals where cleaning or repair of ballast tanks occurs, have adequate reception facilities for the intake of sediments. Barges and/or trucks for the reception of liquid wastes, or shore connections at ports to receive these wastes into a sewer system, are typically provided at ports. Where the port servicing area or barge does not provide a hose and suitable connections to receive liquid wastes, a ship must provide a special hose and connections large enough to allow rapid discharge of the wastes to sewer or other suitable point. This hose needs to be durable, impervious, and with a smooth interior surface. It must be of a fitting different from that of the potable water hose or other water filling hose, and it must be labelled, "FOR WASTE DISCHARGE ONLY". After use, the hose must be cleaned, disinfected and stored in a convenient place, and labelled, "WASTE DISCHARGE HOSE".

2. Overboard discharge of ballast water

Overboard discharge of waste should be done according to the Annex V of MARPOL, Resolution A.868 (20), International Convention for the Control and Management of Ships' Ballast Water and Sediments,

and any national regulations.

Under International Convention for the Control and Management of Ships' Ballast Water and Sediments Regulation B-4 Ballast Water Exchange, all ships using ballast water exchange should:

- whenever possible, conduct ballast water exchange at least 200 nautical miles from the nearest land and in water at least 200 metres in depth, taking into account Guidelines developed by IMO;
- in cases where the ship is unable to conduct ballast water exchange as above, this should be as far from the nearest land as possible, and in all cases at least 50 nautical miles from the nearest land and in water at least 200 metres in depth.

When these requirements cannot be met areas may be designated where ships can conduct ballast water exchange. All ships shall remove and dispose of sediments from spaces designated to carry ballast water in accordance with the provisions of the ships' ballast water management plan (Regulation B-4).

6 WASTE MANAGEMENT AND DISPOSAL

6.1 Background

This chapter deals with the management of solid and liquid waste on board ship, including its storage and safe disposal.

6.1.1 Health risks associated with wastes on ships

Unsafe management and disposal of ship wastes can readily lead to adverse health consequences. Humans can become exposed directly, both on ship and at port, due to contact with waste that is not being managed in a safe manner. Exposure can also occur via the environmental transfer of disease-causing organisms or harmful substances due to unsafe disposal. However, waste can be managed and disposed of in ways that prevent harm occurring.

Waste can contain hazardous microbial, chemical or physical agents. For example, sharp objects are in themselves dangerous and may harbour infectious agents. Used syringes are a good example and can transmit disease-causing agents such as hepatitis C virus and human immunodeficiency virus. Furthermore, harmful chemicals must not be deposited in waste.

Risks of harm arising due to improperly managed ship waste are increasing with the greater number of ships in service and the increase in habitation in port areas. Waste streams on ships include sewage, grey water and garbage as well as effluent from oil/water separators, cooling water, boiler and steam generator blow down, medical wastes (e.g. health care wastes, laboratory wastes and veterinary care wastes), industrial waste water (e.g. from photo processing) and hazardous waste (radioactive, chemical, biological wastes, and unwanted pharmaceuticals).

Food wastes and refuse readily attract disease vectors (see Chapter 7) including rodents, flies and cockroaches which are reservoirs and vectors of etiological agents of many diseases.

Restrictions on depositing hazardous wastes into water bodies mean that ships need to capture and retain those wastes onboard for periods of time. The process of packaging and storing hazardous wastes is in itself can be hazardous to the crew, while the storage of hazardous wastes leads to the risk of harm arising should spills or leaks occur. Waste needs to be appropriately disposed of in accordance with the rules and regulations applicable at the point of disposal.

6.1.2 Standards

Waste management from ships is covered in the IHR and is covered in more detail in MARPOL. The International Convention for the Prevention of Pollution from Ships (MARPOL 73/78, as amended) was adopted by the International Conference on Marine Pollution in 1973 and has been subject to numerous amendments as it is updated including the 1978 Protocol and amendments collated into a consolidated version in 2002. Regulations covering the various sources of ship-generated pollution are contained in the six Annexes of the Convention:

- Annex I. Regulations for the Prevention of Pollution by Oil.
- Annex II. Regulations for the Control of Pollution by Noxious Liquid Substances in Bulk.
- Annex III. Prevention of Pollution by Harmful Substances Carried by Sea in Packaged Form.
- Annex IV. Prevention of Pollution by Sewage from Ships (entry into force date 27 September 2003).
- Annex V. Prevention of Pollution by Garbage from Ships.
- Annex VI. Prevention of Air Pollution from Ships (adopted September 1997).

Medical waste requires special management. Specifically, details of health care waste management can be found at http://www.who.int/water_sanitation_health/en/ and in the Guidelines for Safe Disposal of Unwanted Pharmaceuticals in and After Emergencies WHO/EDM/PAR 99.2 (1999).

6.2 Guidelines

This section provides user-targeted information and guidance, identifying responsibilities and providing examples of practices that can control risks. Three specific **Guidelines** (situations to aim for and maintain) are presented, each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action).

Outbreaks and harm associated with waste have been linked to poor storage and disposal practices. Once generated, stored waste becomes a potential source of harm. Therefore, the first disease prevention strategy should be to minimize the amount of hazardous waste generated as far as practicable. It is also necessary to ensure that the systems for collecting and storing waste are adequate given the extent and nature of waste generated on board ship.

In some cases waste management treatment systems have failed to perform as required, resulting in unsafe situations. Therefore, reliance should not be placed on treatment and management systems alone. Multiple waste management barriers should be actively maintained including:

- considering how waste is generated onboard and choosing activities and practices that produce the least hazardous waste in the first place;
- matching waste management treatment facilities to their required capacities; and
- maintaining sound practices in collecting and storing waste.

Staff at ports and ship crews need to be adequately trained in the protection of the environment, safe operation, and relevant legislation. People involved in the collection, handling and disposal of wastes need to be trained in the relevant legislation and the risks posed by wastes.

6.2.1 Guideline 5.1: Sewage and grey water management

Guideline 5.1—Sewage and grey water should be safely treated and disposed of.

Indicators for Guideline 5.1

1. The sanitary system must adequately contain the liquid waste.
2. Grease traps are used to manage greasy liquid wastes.
3. Appropriate treatment is applied, where required, before storage or discharge of sewage and grey water.
4. Disposal of sewage and grey water is carried out safely.
5. Overboard discharge of sewage and grey water are only carried out within permitted bounds.

Guidance notes for Guideline 5.1

1. Disposal of sewage and liquid wastes

Ships are not generally permitted to discharge sewage or any other liquid containing contaminating or toxic wastes within an area from which a water supply is drawn, or in any area restricted for the discharge of wastes by any national or local authority. Overboard discharge in harbours, ports and coastal waters are subject to the regulations of the governing authorities in these areas. Sewage, food particles, putrescible matter and toxic substances must not be discharged to the bilge.

Any country may provide special barges for the receipt of these wastes or shore connections which input to the sewer system. Where the shore servicing area or barge does not provide hose or connections to receive these wastes, the ship must provide a special hose and connections large enough to allow rapid discharge of wastes. This hose must be durable, impervious, and with a smooth interior surface, it would be of a size different from that of the potable water hose or other water filling hoses, and it could be labelled, "FOR WASTE DISCHARGE ONLY". After use, the hose must be cleaned by thorough flushing with clear water, and stored in a convenient place, labelled, "WASTE DISCHARGE HOSE".

The prohibition against discharge of wastes near a water supply intake or in any body of water where measures for the prevention and control of pollution are in force will require the provision of retention tanks or sewage treatment equipment on board.

Systems need to be designed and constructed so as not to leak wastes and need to be amenable to ready inspection to check for leaks or bursts. Approved back flow preventers (vacuum breakers) or acceptable air gaps must be installed in the water supply lines to the grinders. All piping should be colour coded and labelled (e.g. according to ISO 14726:2006) at least every five meters to avoid confusion and possible cross-connection to potable water. Drain, soil and waste pipes need to be maintained frequently to prevent clogging and the backflow of sewage, grey water or contaminated wastes into the fixtures and spaces served by the collection system.

2. Grease traps

All galley wastes, exclusive of ground refuse, that may contain grease must be made to flow through grease interceptors (grease traps) to a retaining box prior to discharge. Overboard discharge may occur after a suitable separation distance with the closest line of land, such as 3 NM (territorial sea – 12 NM), or in compliance with other national rules, or to treatment on board ship. The grease collected may be disposed of by incineration, by storage for shore disposal, or by overboard discharge on the high seas. The design of the interceptors may also need to be approved by the appropriate authority of the country of registration.

3. Treatment

All ships must be equipped with facilities for managing wastes from toilets and urinals, hospital facilities and medical care areas, and wastes from food-refuse grinders. These facilities include treatment systems and/or safe holding tanks, properly equipped with pumps and piping. Wastes from safe holding tanks may be discharged to ports connections or to special barges or trucks. The design of treatment systems and waste holding tanks needs to be based on a suitable volume, for example 114 L (30 USG) per capita per day of liquid waste and may need to be approved by the appropriate authority of the country of registration.

For ships where the normal wastewater flow to be treated is quite large, exceeding 4 750 L (1 250 USG) per day, treatment must be designed to produce a suitable quality effluent, such as biochemical oxygen demand (BOD) of 50 mg/L (ppm) or less, a suspended solids content of 150 mg/L (ppm) or less, and a coliform count of 1 000 or less per 100 ml.

Excess sludge must be stored for appropriate disposal to land-based facilities or when on the high seas. For ships with a daily flow of wastewater to be treated that is quite small, less than 4 750 L (1 250 USG), treatment may be limited to passing the wastes through grinders, followed by disinfection to produce an effluent with a coliform count of 1 000 or less per 100 ml.

Chlorination, or an equally effective method of disinfection, may need to be installed, as recommended by the manufacturer, to produce an effluent meeting the coliform requirements set by the relevant authorities.

6.2.2 Guideline 5.2: Garbage waste management

Guideline 5.2—Garbage waste should be safely treated and disposed of.

Indicators for Guideline 5.2

1. Garbage is safely stored in appropriately designed facilities.
2. Excess sludge is stored safely prior to appropriate disposal.

Guidance notes for Guideline 5.2

The management of pharmaceutical wastes produced on board must be carried out appropriately in order to prevent harm to the environment and human health. Specific considerations for pharmaceutical wastes include avoidance of disposing of non-biodegradable products, or products that might harm bacteria involved in wastewater treatment, into the sewage system and avoiding burning pharmaceuticals at low temperatures or in open containers.

1. Facilities for waste storage

To prevent corrosion, the interiors of food and garbage lifts may need to be constructed of stainless steel

and meet the same standards required for the storage, preparation and service of food. Decks need to be constructed of a durable, non-absorbent, non-corroding material and have a suitable internal cove, of at least 10 mm (0.4 in) along all sides. Bulkhead-mounted air vents must be positioned in the upper portion of the panels or in the deckhead. To help with cleaning and removal of spills, a drain at the bottom of all lift shafts must be provided including the provision of platform lifts and dumbwaiters.

If used to transport waste, the interiors of dumbwaiters must be readily cleanable and constructed of stainless steel or similar and meet the same standards of other food service areas. The bottom of the dumbwaiter should include a suitable cover, such as a 10 mm (0.4 in) radius.

Garbage chutes, if installed, need to be constructed of stainless steel or similar, and have an automatic cleaning system.

In waste management equipment wash rooms, bulkheads, deckheads, and decks need to be constructed to meet the same standards required for the storage, preparation and service of food. A bulkhead-mounted pressure washing system could be provided with a deck sink and drain. An enclosed automatic equipment washing machine or room may be used in place of the pressure washing system and deck sink. Adequate ventilation is required for extraction of steam and heat.

The garbage storage room should be well-ventilated and the temperature and humidity controlled. A sealed, refrigerated space must be used for storing wet garbage. The space needs to meet the same criteria utilized for cold storage facilities for food. The room must be constructed of adequate size to hold unprocessed waste for the longest expected period when off-loading of waste is not possible and must be separated from all food preparation and storage areas.

In all the garbage holding and processing facilities there needs to be easily accessible hand washing stations with potable hot and cold water, hose connections, and sufficient number of deck drains to prevent any pooling of water. The sorting tables in garbage processing areas must be constructed from stainless steel or similar and have coved corners and rounded edges. Deck coaming, if provided, needs to be adequate, at least 8 cm (3.1 in) and coved. If the tables have drains, they should be directed to the deck drain, which requires a strainer. A storage locker must be provided for cleaning materials to keep them away from foods. Adequate lighting, at least 220 lux, is required at work surface levels and light fixtures need to be recessed or fitted with stainless steel or similar guards to prevent breakage.

To facilitate storage, tops and bottoms must be removed from all empty metal containers, or containers with metal ends, and the remaining parts flattened. Containers of paper, wood, plastic, and similar materials should also be flattened for convenient space saving storage. Dry refuse must be stored in tightly covered bins, or in closed compartments, protected against weather, wash, and the entry of rodents and vermin. The containers must be thoroughly cleaned after emptying and treated with insecticides or pesticides, if necessary, to discourage harbourage of rodents and vermin.

2. Excess sludge

Excess sludge is typically stored for appropriate disposal to land based facilities or when on the high seas.

6.2.3 Guideline 5.3: Healthcare and pharmaceutical waste management

Guideline 5.3—Health care and pharmaceutical waste should be safely treated and disposed of.

Indicators for Guideline 5.3

1. Healthcare and pharmaceutical waste is safely treated and disposed of.

Guidance notes for Guideline 5.3

Note the WHO International Ships Medical Guide and note that there some country medical guides too.

1. Treatment and disposal of healthcare and pharmaceutical waste.

All ships should be equipped with facilities for treating and/or safely storing healthcare wastes. Healthcare waste is any waste generated during patient diagnosis, treatment or immunization. Healthcare waste is of two categories: infectious and non infectious. Infectious healthcare waste is liquid or solid waste that contains pathogens in sufficient numbers and with sufficient virulence to cause infectious disease in susceptible hosts exposed to the waste. Non-infectious healthcare waste includes disposable healthcare supplies and materials that do not fall into the category of infectious healthcare waste.

Infectious waste must be safely stored or sterilized, e.g. by steam, and suitably packaged for ultimate disposal ashore. Healthcare waste should be clearly labelled. Ships properly equipped may incinerate paper and cloth based healthcare waste but not plastic and wet materials. Sharps must be collected in plastic autoclavable sharps containers and retained on board for ultimate disposal ashore. Unused sharps must be disposed of ashore in the same manner as healthcare waste.

Liquid healthcare wastes may be disposed of by discharging them into the sewage system. Non-infectious healthcare waste may be disposed of as garbage if they do not require steam sterilizing or special handling. Staff dealing with health care wastes must be immunized against hepatitis B virus.

7 VECTOR AND RESERVOIR CONTROL

7.1 Background

This chapter deals with the management of disease vectors and their reservoirs on board ship.

The IHR (2005) state that: “Conveyance operators should permanently keep conveyances for which they are responsible free of sources of infection or contamination, including vectors and reservoirs. Every conveyance leaving an area where vector control is recommended by WHO should be disinfected and kept free of vectors”. When there are methods and materials advised by WHO, these should be employed. States should accept disinfection applied by other States if methods and materials advised by WHO have been applied. The presence of vectors on board conveyances and the control methods used to eradicate them shall be included on the Ship Sanitation Control Certificate (Articles 22 & 24 and Annexes 3, 4 & 5).

Vector control in and around ports is also part of the IHR (2005). State Parties should ensure that port facilities are kept in a safe and sanitary condition and free from sources of infection and contamination, including vectors and reservoirs. Vector control measures should be extended to a minimum distance of 400 metres from passenger terminals and operational areas (or more if vectors with a greater range are present, as documented in specific guidelines).

7.1.1 Health risks associated with vectors on ship

The control of disease vectors such as insects and rodents is necessary for the maintenance of health on board ships. Mosquitoes, rats, mice, cockroaches, flies, lice and rat fleas are all capable of transmitting disease.

Rodents are well established at port areas and are considered vectors for many diseases. Plague, murine typhus, salmonellosis, trichinosis, leptospirosis and rat bite fever are known to be spread by rodents.

Malaria is transmitted to humans by mosquito vectors. If not properly controlled, such vectors could breed and be carried by ships. Infection with malaria during a voyage represents a serious risk to health and life of crew and passengers. On board, the chances for early diagnosis and proper treatment are limited. Persons and vectors on board can in turn spread disease to ports (e.g. Delmont 1994).

7.1.2 Standards

Article 20 of IHR directs health authorities to ensure that ports have the “capacity” to inspect ships and then to issue either “Ship Sanitation Control Certificates” to direct disinfection or decontamination of the ship, including the control of vectors, or “Ship Sanitation Control Exemption Certificates” if contamination is not found.

Annex 1 of IHR describes what constitutes this “capacity” and notes that this includes the capacity to decontaminate ships.

Annex 4 of IHR describes the process of issuance of such “certificates” and states that the presence of vectors, not necessarily evidence of disease *per se*, is sufficient basis for the issuance of the Control Certificate to decontaminate the ship of those vectors.

Annex 5 of IHR describes the controls for vector-borne disease and provides health authorities with the right to control vectors found.

7.2 Guidelines

This section provides user-targeted information and guidance, identifying responsibilities and providing examples of practices that can control risks. Two specific **Guidelines** (situations to aim for and maintain) are presented, each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action).

Ports receive and manage goods and people from all over the world. Therefore, ports are exposed to the risk of vectors from any part of their country or any other port in the world. In addition, the activities undertaken at ports, such as handling foodstuffs, attracts many species of vermin. Once on board ship, being relatively isolated from medical facilities makes diagnosis and treatment of disease more difficult and potentially increases the risk of serious harm. The relatively crowded nature of ships facilitates the spread of disease and ensures a concentration of foodstuffs and hosts for vectors.

Outbreaks associated with the presence of vectors on board are usually linked to both inadequate control and sanitation on board and to insufficient attention to preventing contamination in the first place. The failure of initial prevention leads to contamination which is then exacerbated by failed ongoing control.

A preventive approach using good design that minimises opportunity for vector penetration, hiding and proliferation is the foundation of any good vector control strategy. Multiple barriers should be actively maintained including:

- screening out vectors using all reasonable means;
- controlling vectors on board;
- eliminating habitats suitable for vector survival and breeding, where practicable; and
- reducing the opportunity for exposure of passengers and crew to vector-related infectious agents.

One or more of the following control measures may be employed:

- Regular inspection of ship spaces, particularly where infestation is most likely to occur, such as food storage, food handling and refuse disposal spaces.
- Elimination of pest hiding places and point of accumulation in which trash, food particles, or dirt may accumulate.
- Frequent cleaning of living quarters and spaces where food is stored, prepared, or served or in which dishes and utensils are washed and stored.
- Proper storage and disposal of food refuse and rubbish (see Chapter 3).
- Elimination of habitat for insect larvae ideally through design or, if unavoidable, through maintenance, such as preventing the formation of standing water in lifeboats.
- Use of screens on all structural openings to the outer air during seasons when insects are prevalent.
- The application of suitable insecticides.

As vectors such as rodents, vermin and flying insects may have access to ships when in port, control measures for the suppression of vermin and insect infestation are necessary. These control measures must be carried out under the direction of a ship's officer, charged with this responsibility and frequently inspected.

7.2.1 Guideline 6.1: Insect vector control

Guideline 6.1—Insect vectors should be controlled.

Indicators for Guideline 6.1

1. Insect-proof screens are used to prevent insect penetration.
2. Insecticides are used to control vector densities in air spaces and on surfaces.
3. Ship inspection and vector surveillance

Guidance notes for Guideline 6.1

1. Screens

Sleeping quarters, mess rooms and dining rooms, indoor recreational areas, as well as all food spaces, must be effectively screened when ships are in areas where flies and mosquitoes are prevalent. Screening of sufficient hole tightness, no more than 1.6 mm spacing, is recommended with screens on all outside openings. Screen doors should open outwards and be self-closing, and the screening must be protected by heavy wire netting or other means to protect it from damage, which may include the use of metal kick plates.

Ships holding water must be screened from insects and inspected frequently to check for, and eliminate, mosquito breeding. Refuse stores must be screened and inspected frequently to check for, and eliminate, the breeding of flies or other vermin.

Screens need to be kept in good repair. Bed nets, in good repair and properly placed, need to be used in sleeping quarters not provided with screens.

2. Insecticides

When leaving an area in which vectors are prevalent, and at regular intervals, residual and space sprays must be used for the control of flying insects that have entered the ship. Space sprays are released as a fog or fine mist and kill on contact. Residual sprays leave a deposit on surfaces where flying insects rest and where other insects crawl and will remain active for a considerable period of time. Crawling insects and vermin are best controlled by specific insecticides, properly applied to crawling, resting and hiding places.

As spray insecticides may contain substances toxic to humans, all surfaces that come in contact with food, all dishes and utensils, and food and drink need to be covered or removed during spraying operations.

Insecticides and rodenticides, and any poisonous substances, and equipment for their use must not be stored in or immediately adjacent to spaces used for the storage, handling, preparation and serving of food or drink. Further, such poisonous substances should not be stored near dishes and utensils, or tableware, linen and other equipment used for the handling and serving of food and drink. To prevent the accidental use of these poisons in foodstuffs, such hazards might be kept in coloured containers marked "POISON".

7.2.2 *Guideline 6.2: Rodent vector control*

Guideline 6.2—Rodent vectors should be controlled.

Indicators for Guideline 6.2

1. Rodent-proofing is installed and maintained.
2. Traps are used to control vector densities.
3. Regular pest inspections are undertaken.
4. Poisoned baits are used to control vector densities.
5. Hygienic practices are used to minimise rodent attractors.

Guidance notes for Guideline 6.2

1. Rat-proofing

Rats gain access to ships by various means including direct access by hawsers (mooring cables) and gangways. Others may be concealed in cargo, ship's stores and other materials taken onto the ship. However, the prevention of rat harbourage through appropriate construction and rat-proofing will ensure almost complete control of rodents on board.

Some ships may be difficult to rat-proof without major alterations. However, there are many rat-proofing measures that can be readily undertaken. These will materially reduce rat harbourage and will keep rat populations to a minimum after the ship has been deratted, provided that appropriate operational control measures on board ship are regularly followed.

Concealed spaces and structural pockets, openings that are too large, greater than 1.25 cm (0.5 in), leading to voids and food spaces, gaps around penetrating fixtures (e.g. pipes or ducts passing through bulkheads or decks) regardless of location, need to be obstructed with rat-proofing materials, and the insulation layer around pipes, where over a certain thickness, 1.25 cm (0.5 in) thick, needs to be protected against rat-gnawing.

Rat-proofing materials should be robust and damage-resistant. Such materials include sheet metal or alloy of suitable hardness and strength, wire mesh and hardware cloth.

Metal wire or sheet metal gauges must be of adequate strength and corrosion resistant. For example, aluminium should have a thickness by the Brown & Sharp gauge greater than the thickness specified by the US Standard for sheet iron because aluminium is not as strong. For example, 16-gauge aluminium (Brown & Sharpe) might replace 18-gauge sheet iron (US Standard). For grades of wire and hardware cloth, Washburn & Moen gauges are also used.

Certain non-rat-proof materials are satisfactory in rat-proof areas provided that the boundaries and various gnawing edges are flashed. Wood and asbestos composition materials are acceptable under conditions such as:

- Wood must be dry or seasoned, and free of warps, splits and knots. Plywood must be resin-bonded and water proof.
- Inorganic composition sheets and panels must be relatively strong and hard, with surfaces that are smooth and resistant to the gnawing of rats. A list of acceptable non-rat-proof materials may be obtained from national health administrations. If a new material is intended for use, the national health administration must be consulted in order to initiate approval procedures.
- Certain composition sheets and panels that do not meet the requirements in the bullet point above may be made acceptable by laminating with metal or facing on one side using suitable materials. All materials in this category are likely to be subject to health administration approval for inclusion in an acceptable non-rat-proof materials list.

Cements, putties, plastic sealing compounds, lead and other soft materials, or materials subject to breaking loose, are not advised in place of rat-proofing materials to close small openings. Firm, hard-setting materials used to close openings around cables within ferrules might need to be approved by the ship inspection officer. Fibreboards and plaster boards are generally not acceptable non-rat-proof materials. For approval, consult the relevant health administration.

Non-rat-proof sheathing need not be rat-proofed when placed flush against, or within 2 cm (0.8 in) of steel plate, or when placed flush against rat-proofing material over insulation. Overlapping joints are not necessary for sheathing.

Effective rat-proofing collars at suitable distances from the ship, and able to withstand wind action, should be fitted to any hawsers (cables for mooring or towing the ship) that connect the ship to the shore.

2. Trapping

The master of the ship can delegate one person to be responsible for the vector control programme. Traps must be set after leaving any port where rats might have come on board either directly from the dock or with cargo or stores. If all traps are still empty after a period of two days, they can be taken up. If rats are caught, the traps in that area must be reset until no more rats are caught. A record of where the traps were set, the dates and results must be entered in the ship's log and a copy available for the port health inspector.

3. Inspections

Rats leave droppings, gnawing damage and grease marks, which provide a ready indicator of infestation. Regular inspection of the ship to look for such evidence will show whether rats have gained access to the ship. Inspection should focus particularly on spaces where food is stored and prepared and where refuse is collected and disposed of, as well as the cargo hold while in port.

All rat-proofing needs to be kept in good repair, inspected and maintained regularly. Pest infestations must be dealt with immediately and without adversely affecting food safety or suitability. Treatment with chemical, physical or biological agents must be carried out without posing a threat to the safety or suitability of food.

4. Baiting

Most rodenticides may be very toxic and poisonous to man. Caution must be used in their application, with instructions for their use carefully followed. The containers must be marked "POISON" and stored away from food preparation and storage areas; they must be coloured to prevent accidental use in food preparation. Check that the baits have been consumed and are correctly placed.

5. Hygiene

Rats pose a major threat to the safety and suitability of food. Rodent infestations can occur where there are breeding sites and a supply of food. Good hygiene practices should be employed to avoid creating an environment conducive to rodents. Good sanitation, inspection of incoming materials and good monitoring should minimize the likelihood of infestation and thereby limit the need for pesticides.

8 CONTROLLING INFECTIOUS DISEASE AGENTS IN THE ENVIRONMENT

8.1 Background

This chapter deals with the management of persistent infectious agents on board ship.

8.1.1 Health risks associated with persistent infectious agents on ship

There have been a number of outbreaks of acute infectious gastrointestinal illnesses (AGI), such as those caused by Norovirus (e.g. CDC 2002), and acute respiratory illnesses (ARI), such as influenza (e.g. Brotherton et al., 2003), on ships caused by communicable infectious agents. For example, in 2002 the US Centres for Disease Control detected 21 outbreaks (in this case defined as *probable Norovirus infections causing illness in > 3% of the ship population*) on board ships arriving at US ports (CDC 2002). In general, diseases arising from communicable infectious agents result from infection of the gastrointestinal system (digestive tract, intestines, stomach) and cause acute symptoms such as nausea vomiting and diarrhoea. Respiratory infections can also arise and can cause acute symptoms such as fever, myalgia, weakness, sore throat, cold and cough. Although often self-limiting or even asymptomatic, deaths can arise, particularly in sensitive populations. In the confines of a ship environment these diseases can spread rapidly to affect significant proportions of the total ship population. These same diseases are highly prevalent on land, making it difficult to avoid some infected persons coming aboard.

The subject of this chapter are the infectious agents that have the ability to persist in air, water, vomitus, sputum and on surfaces for long enough that indirect transfer from one person to another can readily occur and result in an outbreak.

Many infectious agents can be spread via environmental surfaces and even via the air, including some protozoa, bacteria and viruses. However, to cause a detectable and significant outbreak on board the agents need to be highly infectious and able to rapidly complete their incubation and begin replicating in their new infected host. For this reason, the environmentally persistent agents that cause AGI and ARI outbreaks on board ships are generally viruses. Our knowledge of these viruses and their taxonomy is rapidly evolving. However, in general, the risk factors and control measures to be applied on board are the same regardless of the taxonomic classification of the infectious agent.

An infected person might, for example, be shedding an infectious agent *via* their faeces or vomitus. After bottom-wiping, nappy-changing or cleaning them, or their carer, might carry some of this material on their hands, unless thoroughly washed, leaving it on surfaces or in food or water that they touch around the ship. When another person touches those surfaces or consumes the food or water they might pick up the infectious agent, which can then be ingested when putting fingers in the mouth or through ingestion of contaminated food or water.

Infectious agents can also be spread via the air, e.g. due to coughing and sneezing leading to exhaling of pathogens from the respiratory tract.

Waterborne and foodborne transmission of agents may also occur and this is considered in Chapters 2 and 3 respectively, with particular discussion of the risks associated with *Legionella sp.*

This Chapter considers two types of pathogens. Those infectious agents that cause AGI typically spread *via* environmental surfaces, such as door handles, and those transmitted via the air. Those infectious agents that cause ARI are more typically spread via the air.

Acute infectious gastrointestinal illnesses

Persistent infectious agents causing AGI are typically viruses belonging to the Calicivirus, Astrovirus and Reovirus families. These viruses are commonly associated with diarrhoea, with the Calicivirus family including the genus most commonly associated with ship-borne outbreaks: Norovirus (NoV) (which has also been known as Norwalk-like virus (NLV) and small round structured virus (SRSV)).

Because of the similarity between symptoms and control measures, and, to illustrate the risk factors and control measures to be applied on board, NoV will be used as a typical cause of AGI and Influenza viruses as a typical cause of ARI. In general, NoV is the more infectious, more resistant to disinfection and difficult to control of these two types of virus and will form the primary focus of this chapter. For the most part, the controls in place to prevent NoV spread on board will help reduce the spread of other, less robust pathogens among the persistent infectious agents.

NoV is considered the leading cause of adult gastroenteritis outbreaks worldwide and is thought to be second only to Rotavirus in terms of all causes of gastroenteritis. Recent improvements in diagnostics and surveillance are likely to reveal more outbreaks on board ships. The probable role of international travellers as vectors was revealed by the similarity of strains between outbreaks across the world (White et al., 2003).

NoV can be transmitted by the aerosols liberated by projectile vomiting and, therefore, by airborne transmission (Marks et al., 2001) as well as *via* ingestion, (both directly or indirectly via a surface) of infected vomit and faeces. Environmental surfaces can become contaminated readily and remain contaminated for some time (Cheesbrough et al., 2000).

An outbreak can spread rapidly throughout a ship because NoV has an incubation period of just 12 to 48 hr and the proportion of those exposed that fall ill can be high (often above 50%) in all age groups (CDC 2002). Symptoms often start with sudden onset of projectile vomiting and/or diarrhoea. There may be fever, myalgia, abdominal cramps and malaise. Recovery occurs in 12 to 60 hr in most cases and severe illness or mortality is rare, particularly if oral rehydration treatment is applied.

Because the infectious agents are persistent, outbreaks may continue and attack passengers and crew on successive voyages. Cohorts of new crew and passengers are introduced to the ship on a regular basis so it is important to sanitise the ship after an outbreak.

Shedding rates for Noroviruses have been found to peak at over 10^6 virions per g faeces, dropping to around 1 000 virions per g faeces three weeks from the cessation of symptoms in around 50% of cases and remaining detectable for up to 7 weeks following the peak of infection (Tu et al., 2008). Therefore, even if ships are disinfected, bridging between groups may occur *via* a reservoir within infected persons. Another important implication of this prolonged shedding period, noting that it is often asymptomatic, is that some passengers and crew are likely to bring these persistent infectious agents on board with them regardless of what the crew does. It should be assumed that there are unrecognised infected individuals on board even in the absence of a detectable outbreak, and infection control precautions should be implemented continuously, not just after the outbreak has taken hold.

Acute respiratory illnesses (ARI),

Persistent infectious agents causing ARI are typically viruses belonging to the Rhinovirus, Adenovirus, Influenza virus and Coronavirus families. These viruses are commonly associated with symptoms such as cold and cough and some cause broader symptoms resulting in greater morbidity, such as fever. Influenza viruses are the family that typically cause the most severe symptoms among the more commonly identified causes of outbreaks. Influenza viruses are an ongoing and common problem for ships due to the difficulty in containing their spread, even among partially vaccinated populations (Brotherton et al., 2003).

Severe acute respiratory syndrome (SARS, (WHO 2004c)) has been noted as a disease that might be spread by travellers. This disease, caused by a Coronavirus, has symptoms that are typically different from the gastrointestinal viruses described above and is associated with respiratory tract infection and flu-like symptoms. However, although initially presenting rather like influenza, complications can include severe pneumonia and respiratory system failure which can be fatal. The risks from the person-to-person spread of SARS appear to be reduced by the same types of control measures applied for NoV, Influenza virus and similar agents.

In accordance with Article 37 of the World Health Organization (WHO) International Health Regulations 2005, ships entering port may be required to report to health authorities on the health conditions on board during the voyage and the health status of passengers and crew. For this purpose a Maritime Declaration of Health must be completed by the ships Master and countersigned by the ship's surgeon if one is carried, and delivered to health officials after arrival.

8.2 Guidelines

This section provides user-targeted information and guidance, identifying responsibilities and providing examples of practices that should control risks. Two specific **Guidelines** (situations to aim for and maintain) are presented, each of which is accompanied by a set of **Indicators** (measures for whether the guidelines are met) and **Guidance notes** (advice on applying the guidelines and indicators in practice, highlighting the most important aspects that need to be considered when setting priorities for action). The first guideline is preventive and activity-related and the second is reactive and patient-related.

Risk factors for infection from communicable infectious agents are generally those that involve being in close proximity to an infected person, including (based on de Wat et al., 2003):

- having another infected person in the same family or group;
- coming into contact with an infected person;
- poor food and water handling hygiene;
- the significance of contact with other infected persons increases where the infected person is a young child;
- contact with both faeces and vomit appear to be equally important as one another; and
- being in close proximity to a person that is infected and coughing or sneezing.

Ships present a particularly high risk for extensive outbreaks for several reasons. Many outbreaks on land have been associated with situations in which many people are in close proximity to other infected persons for a period of time, such as parties, restaurants, schools and dormitories. These high-risk situations can all be present on a ship. Cabins often include people living in close proximity, often with children, that might otherwise be more separated.

The previous chapters in this Guideline emphasise prevention at source above all other control strategies. However, persistent infectious agents are typically so prevalent in the population, often without symptoms being evident, that it is not realistic to try to exclude infected individuals coming on board. The focus of the control strategy for persistent infectious agents should be on taking all reasonable precautions to prevent transmission at all times – the working assumption should be that persons are infected. It is worth noting, however, that symptomatic individuals are typically far more infectious than those that are asymptomatic, and there is value in taking extra precautions relating to such individuals, seeking to minimise the possibility of patients contaminating others on board. Extended outbreaks may occur when there is inadequate control of possible infection pathways on board.

Reliance should not be placed on any single control strategy, and multiple barriers should be actively maintained.

8.2.1 Guideline 7.1: Transmission routes

Guideline 7.1—Transmission routes on board ship should be minimised.

Indicators for Guideline 7.1

1. Good personal hygiene practices are promoted on board and required by crew and staff.
2. Maintaining stringent food and water hygiene on board.
3. Maintaining stringent hygiene practices, with regard to cleaning and waste management on board.

Guidance notes for Guideline 7.1

1. Personal hygiene

Promoting and adopting good personal hygiene on board can significantly reduce the spread of persistent infectious agents. Examples of activities that should be promoted include:

- providing sufficient and ready access to hand-washing and sanitizing facilities at eateries, toilets, childcare facilities, healthcare facilities and entry points and through keeping these facilities highly visible and using signage;
- providing non-contact hand-washing and sanitizing facilities, e.g. taps and soap and sanitizer delivery systems that do not require hand contact to operate;
- avoid putting fingers in or near the mouth unless first washed;
- avoid placing objects that may have been touched into the mouth;
- providing guidance on proper hand-washing and sanitizing; and
- covering nose and mouth with tissues when coughing or sneezing, which is then discarded.

2. Food and water hygiene

Promoting and adopting good food and water hygiene on board can significantly reduce the spread of persistent infectious agents. Examples of activities that should be promoted include:

- maintaining stringent food and water handling hygiene, as discussed in Chapters 2 and 3 of this Guide;
- design self-service facilities to minimise infectious agent transmission; supervise these facilities closely and prevent children from using them. Consider eliminating self-serve eating facilities during large outbreaks;
- limit the need for indirect contact with others, such as avoiding the need for the sharing of drink containers and eating utensils;
- provide separate serving utensils if dishes are to be shared to avoid people serving themselves by hand or using utensils that have been placed in their mouths;
- providing cutlery and appropriate seating facilities to minimise the need to handle food whilst eating, and serving food of a type and packaged to minimise the need for handling; and
- if food handling is inevitable as part of food consumption, provide hand sanitizers along with the food.

3. Good hygiene practices

Adopting good hygiene practices should help to reduce the spread of persistent infectious agents on board. Examples of activities that should be promoted include:

- cleaning and sanitising items both between and during voyages, this should include any environmental surface that might be touched by one infected person and lead to indirect transmission to another (toilet and tap operating handles, eating and drinking utensils, door handles, remote control devices, switches on lights, radios and air conditioning units, chair, table and bedding surfaces and carpets);
- providing good ventilation;
- constructing surfaces from non-absorbant materials that are easily cleaned and sanitised;
- providing separate areas for children and adults;
- requiring the use of underwear or towels in saunas and other communal areas where clothing can otherwise be removed;
- rapidly cleaning up and sanitising any faeces or vomit spilt on ship.

8.2.2 Guideline 7.2: Air quality

Guideline 7.2—Maintain good air quality to reduce risk of environmental disease transmission.

Indicators for Guideline 7.2

1. Air quality should be maintained to prevent airborne disease transmission.

Guidance notes for Guideline 7.2

To help protect air quality on board, it is important to keep air circulating and, as far as practicable, free from hazardous agents. Intake air openings should be maintained in clean and operational condition. Air filters should be kept in sanitary condition. Non-disposable (permanent) filters should be cleaned as recommended by the manufacturer, typically monthly. Disposable filters should be changed in accordance with the manufacturer's specification, typically three-monthly.

Air conditioning rooms must be maintained in clean condition. Objects, chemicals, products and utensils should not be stocked or stored in these rooms in order to avoid dispersion of biological or chemical hazards. Air conditioning rooms should not present any leakage on condensing and cooling systems. Cleaning and disinfection procedures in the air conditioning system should be made only with specific chemicals indicated for the specific system (non-toxic, biodegradable, etc.). Ship operators should

monitor and record the cleaning and maintenance procedures for air conditioning systems.

8.2.3 Guideline 7.3: Cases and outbreaks

Guideline 7.3—Cases and outbreaks should be responded to effectively.

Indicators for Guideline 7.3

1. Procedures, equipment and facilities are in place to manage symptomatic individuals to minimise further disease spread.
2. Procedures, equipment and facilities are in place to respond to outbreaks with enhanced control measures.

Guidance notes for Guideline 7.3

1. Manage symptomatic individuals

The scope of this guide is as a 'sanitation' guide. Refer to the WHO International Medical Guide for Ships (WHO, 2007a), and seek medical advice from the next port for case by case management for individuals.

Adopting targeted and additional controls around symptomatic individuals is justified given that they are likely to be highly infectious. Examples of activities that should be included in procedures include:

- put in place systems to provide the earliest possible detection of disease symptoms;
- advising, or even requiring, symptomatic individuals to minimise contact with others;
- requesting that symptomatic individuals do not board the ship;
- wearing suitable masks and gloves whilst in close contact with symptomatic individuals;
- providing patients with advice on minimising the risk of spreading their infection to others where they cannot be isolated, such as limiting any direct contact with others, even during greetings, such as the shaking of hands and kissing, remaining in cabins as much as possible to minimise contact with others and not take part in food handling duties or other duties that may readily lead to transmission of infection;
- vaccinating crew that may come into contact with infected individuals, where practicable; and
- using antiviral therapies to help suppress infection and shedding rates, where available.

2. Respond to outbreaks

Enhanced responses to outbreaks should reduce their severity and duration and help to prevent outbreaks affecting subsequent travellers. Examples of activities that should be included in procedures include:

- Seek to identify the source of the outbreak. If the characteristic of an outbreak suggests a point source, the relevant control measures need to be re-checked and rigorously enforced and epidemiological investigations should be undertaken to identify or exclude a food or water source. Since food and waterborne outbreaks have occurred on ships, kitchen hygiene practices and water safety management need to be reviewed and monitored.
- Advise symptomatic passengers or crew to stay in cabins. Excretion and exhalation of virus can begin shortly before the onset of symptoms and can continue for up to several weeks, although the maximum shedding typically occurs 24 to 72 hours after symptoms begin. The appropriate duration of confinement should be based on specific medical advice in accordance with the probable cause of disease.
- Cleaning staff and crew are required to undertake hand washing after contact with affected passengers or crew and objects, before handling food or drink and on leaving an affected area or cabin.
- The wearing of suitable masks by crew and carers is required to protect those that come into contact with infected individuals.

- Prompt cleaning and disinfection will take place in areas contaminated by vomit and faeces. Cleaning staff must wear gloves and aprons. Although there is evidence that airborne transmission is possible, the wearing of masks is generally not essential unless spattering or aerosolisation is anticipated.
- Embarking and disembarking passengers should be separated, if possible. If an outbreak has occurred on board, embarkation of new passengers should be delayed until the ship has been thoroughly cleaned and disinfected. The appropriate duration of separation should be based on specific medical advice in accordance with the specific nature of the disease.

Prolonged outbreaks on ships suggest that some infectious agents, such as Norovirus, can be harboured in the ship environment. During an outbreak there is a need for a comprehensive and responsive cleaning and disinfection programme during and at the end of an outbreak.

Particular attention must be given to cleaning objects that are frequently handled such as taps, door handles, toilets or bath rails. For infectious agents causing AGI, the timing of the terminal cleaning process should be at least 72 hr post resolution of the last case. This takes into account the period of maximal infectivity (48 hr) plus the typical incubation period (24 hr) for the newly infected individuals. Affected areas should be cleaned and disinfected.

Contaminated linen and bed curtains must be placed carefully into laundry bags appropriate to guidelines for infected linen (such as soluble alginate bags with a colour coded outer bag) without generating further aerosols. Contaminated pillows should be laundered as infected linen unless they are covered with an impermeable cover in which case they must be disinfected.

Carpets and soft furnishing are particularly difficult to disinfect. Hypochlorite is not generally recommended as prolonged contact is required and many such items are not bleach resistant. Steam cleaning may be used for carpets and soft furnishings, provided they are heat tolerant (some carpets are “bonded” to the underlying floor with heat sensitive materials). However, this needs to be undertaken thoroughly as a temperature of at least 60°C is needed to achieve disinfection and in practice, tests have shown that such high temperatures are often not reached in carpets during steam cleaning. Vacuum cleaning carpets and buffing floors have the potential to re-circulate viruses and are not recommended.

Contaminated hard surfaces should be washed, with detergent and hot water, using a disposable cloth, then disinfected with a suitable disinfecting solution. Disposable cloths must be disposed of safely by handling so as not to contaminate other persons. Non-disposable mop heads and cleaning cloths must be laundered as contaminated linen on a hot wash.

9 REFERENCES

- Bartram J, Corrales L, Davison A, Deere D, Drury D, Gordon B, Howard G, Rinehold A, Stevens M. (2009) Water safety plan manual: step-by-step risk management for drinking-water suppliers. World Health Organization. Geneva.
- Brotherton JML, Delphech VC, Gilbert GL, Hatzi S, Paraskevopoulos PD, Mcanulty J. M. (2003) A large outbreak of influenza A and B on a cruise ship causing widespread morbidity. *Epidemiology and Infection* 130(2);263-271
- BS EN ISO 19011 (2002) Guidelines for Quality and Environmental Management Systems Auditing. International Organization for Standardization.
- CAC (1995) Codex Alimentarius: Vol. 1B - General requirements (food hygiene). Codex Alimentarius Commission. <http://www.codexalimentarius.net/>
- CAC (1997a) Codex Alimentarius: Supplement to volume 1B - General requirements (Food hygiene) Second Edition. Codex Alimentarius Commission. <http://www.codexalimentarius.net/>
- CAC (1997b) Codex Alimentarius: Food Hygiene- Basic Texts - General Principles of Food Hygiene, HACCP Guidelines, and Guidelines for the Establishment of Microbiological Criteria for Foods. Codex Alimentarius Commission. <http://www.codexalimentarius.net/>
- CAC (1999) Codex Alimentarius: Vol. 1A - General requirements. 2nd edition. Revised. Codex Alimentarius Commission. <http://www.codexalimentarius.net/>
- CAC (2003) CAC/RCP1-1969 (Rev.4-2003), Recommended International Code of Practice— General Principles of Food Hygiene; incorporates Hazard Analysis and Critical Control Point (HACCP) system and guidelines for its application. Codex Alimentarius Commission. <http://www.codexalimentarius.net/>
- CDC (1996) Lake-associated outbreak of *Escherichia coli* O157:H7 - Illinois, 1995. *MMWR* 45(21);437-9
- CDC (2000) *Pseudomonas* dermatitis/folliculitis associated with pools and hot tubs - Colorado and Maine, 1999-2000. *MMWR* 49(48);1087-1091
- CDC (2001a) Protracted outbreaks of cryptosporidiosis associated with swimming pool use - Ohio and Nebraska, 2000. *MMWR* 50(20);406-410
- CDC (2001b) Shigellosis outbreak associated with an unchlorinated fill-and-drain-wading pool - Iowa, 2001. *MMWR* 50(37); 797-800.
- CDC (1994a). Outbreak of pneumonia associated with a cruise ship, 1994. *MMWR*; 43:521.
- CDC (1994b). Update: Outbreak of Legionnaires' Disease Associated with a Cruise Ship, *MMWR*; 43:574.
- CDC (1997) Final recommendation to minimise transmission of legionnaires disease from Whirlpool Spas on cruise ship.
- CDC (1986). Epidemiologic Notes and Reports Gastroenteritis Outbreaks on Two Caribbean Cruise Ships, *MMWR*; 35:383.
- CDC (2002). Outbreaks of Gastroenteritis Associated with Noroviruses on Cruise Ships - United States, *MMWR*; 51:1112.
- Cheesbrough JS, Green J, Gallimore CI, Wright PA, Brown DWG. (2000) Widespread environmental contamination with Norwalk-like viruses (NLV) detected in a prolonged hotel outbreak of gastroenteritis *Epidemiology and Infection*, 125 (1): 93-98
- de Wit MAS, Koopmans MPG and van Duynhoven YTHP. 2003. Risk factors for norovirus, Sapporo-like virus, and group A rotavirus gastroenteritis. *Emerg Infect Dis* [serial online] 2003 Dec [cited Dec 2004]. Available from: URL: <http://www.cdc.gov/ncidod/EID/vol9no12/02-0076.htm>
- Davison A, Howard G, Stevens M, Callan P, Kirby R, Deere D, Bartram J. (2005). Water Safety Plans. Supporting monograph to the Guidelines for Drinking-water Quality, Protection of the Human Environment, Water, Sanitation and Health. Geneva:World Health Organization. WHO/SDE/WSH/02.09.
- Delmont J, Brouqui P, Poullin P, Bourgeade A. (1994) Harbour-acquired *Plasmodium falciparum* malaria. *Lancet*. Jul 30; 344(8918):330-1
- Falkinham JO (2003) Mycobacterial Aerosols and Respiratory Disease. *Emerg Infect Dis*, July 2003.
- FAO/WHO (1997) Hazard Analysis and Critical Control Point (HACCP) System and Guidelines for its Application. Food and Agriculture Organization/World Health Organization.
- FAO/WHO (2001). *General standard for bottled/package drinking waters (other than natural mineral waters)*. Rome, Food and Agriculture Organization of the United Nations; Geneva, World Health Organization; Codex Alimentarius Commission (CODEX STAN 227-2001; http://www.codexalimentarius.net/web/more_info.jsp?id_sta=369).
- Gustafson TL, Band JD, Hutcheson RH and Schaffner Jr W (1983) *Pseudomonas* folliculitis: an outbreak and review. *Rev Infect Dis* 5:1-8.

- ILO (1976) The Merchant Shipping (Minimum Standards) Convention No. 147 (and its Protocol of 1996, supplemented by Recommendation No. 155). International Labour Organization. <http://www.ilo.org/public/english/standards/norm/whatare/standards/marit2.htm>
- IMO (2000) Guidelines for Ensuring the Adequacy of Port Waste Reception Facilities, IMO, London, 2000.
- ISO 15748-1:2002 – Ships and marine technology – Potable water supply on ships and marine structures – Part 1: Planning and design. <http://www.iso.org/iso/en/ISOOnline.frontpage>
- ISO 15748-2:2002 – Ships and marine technology – Potable water supply on ships and marine structures – Part 2: Method of calculation. <http://www.iso.org/iso/en/ISOOnline.frontpage>
- ISO 22000:2005 – Food safety management systems – requirements for any organization in the food chain. <http://www.iso.org/iso/en/ISOOnline.frontpage>
- Jernigan DB, Hofmann J, Cetron MS, Genese CA, Nuorti JP, Fields BS, Benson RF, Carter RJ, Edelstein PH, Guerrero IC, Paul SM, Lipman HB, Breiman R. (1996) Outbreak of Legionnaires' disease among cruise ship passengers exposed to a contaminated whirlpool spa. *Lancet*. 347(9000):494-9.
- Lemmon, JM, McAnulty, JM and Bawden-Smith J (1996) Outbreak of cryptosporidiosis linked to an indoor swimming pool. *Medical J Australia* 165:613
- Judy F. Lew¹, David L. Swerdlow², Mario E. Dance³, Patricia M. Griffin², Cheryl A. Bopp², Michael J. Gillenwater⁴, Tony Mercatante⁴ and Roger I. Glass¹
- Lew, J.K., Swerdlow, D.L., Dance, M.E., Griffin, P.M., Bopp, C.A., Gillenwater, M.J., Mercatante, T., and Glass R.I., (1991) An Outbreak of Shigellosis aboard a Cruise Ship caused by a Multiple-antibiotic-resistant Strain of *Shigella flexneri* *American Journal of Epidemiology* Vol. 134, No. 4: 413-420
- Lloyds Register (2009) Lloyd's Register – Fairplay World Fleet Statistics, Lloyds Register – Fairplay Ltd.
- Marks, P.J., Vipond, I.B., Carlisle, D., Deakin, D., Fey, R.E. and Caul, E .O. (2000) Evidence for airborne transmission of Norwalk-like virus (NLV) in a hotel restaurant. *Epidemiology and Infection*; 124:481-487
- MARPOL 73/78. International Convention for the Prevention of Pollution from Ships, 1973, as modified by the Protocol of 1978 relating thereto (MARPOL 73/78) as amended. Reference from: <http://www.imo.org/home.asp>
- Mucklow, R. (1997). Where Did HACCP Come From? In Heads Up for HACCP. National Meat Association. www.nmaonline.org/files/headsup12-1.htm, November 3, 2004.
- NACMCF (1997). Hazard Analysis and Critical Control Point Principles and Application Guidelines. National Advisory Committee on Microbiological Criteria for Foods. <http://www.cfsan.fda.gov/~comm/nacmcfp.html>
- NASA (National Aeronautics and Space Administration). 1991. A Dividend in Food Safety. Spinoff 1991, NASA Technical Report ID 20020086314.
- Pastoris MC, Monaco RL, Goldoni P, Mentore B, Balestra G, Ciceroni L, Visca. (1999) Legionnaire's disease on a cruise ship linked to the water supply system: clinical and public health implications. *Clinical Infectious Diseases*, 28, 33-38.
- Ratnam S, Hogan K, March SB and Butler RW (1986) Whirlpool associated folliculitis caused by *Pseudomonas aeruginosa*: report of an outbreak and review. *J Clin Microbiol* 23:655-9.
- Resolution A.878(20)-IMO. Guidelines for Control and Management of Ballast Water from Ships to Minimize the Transference of Harmful Aquatic Organisms and Pathogenic Agents 1999.
- Rooney, R.M., Bartram, J.K., Cramer, E.H., Mantha, S., Nichols, G., Suraj, R., and Todd, E.C. (2004) A review of outbreaks of waterborne disease associated with ships: evidence for risk management. *Public Health Rep* 119:435-442.
- Rowbotham TJ (1998) Legionellosis associated with ships: 1977 to 1997. *Communicable disease and public health*. 1(3) September 1998.
- Temeshnikova ND, Brudny PA, Marakusha BI, Tartaknsvkii IS and Prosorovskii SV. (1996) The presence of *Legionella* spp in the water system of ships. In Proceedings of the 11th meeting of the European Working Group on Legionella Infections. Norway, June 1996.
- Tu ETV, Bull RA, Kim MJ, McIver CJ, Heron L, Rawlinson WD, White PA. 2008. Norovirus excretion in an aged-care setting. *Journal of Clinical Microbiology*. 46:2119-2121.
- White, P., Hansman, G., Li, A., Dable, J., Isaacs, M., Ferson, M., McIver, C.J. and Rawlinson, W.D. (2002) Norwalk-like virus 95/96-US strain is a major cause of gastroenteritis outbreaks in Australia. *Journal of Medical Virology*, 68 (1): 113-118
- WHO (2004a) Guidelines for Drinking Water Quality – 3rd Edition. Geneva, World Health Organization.
- WHO (2004b) Guidelines for Safe Recreational Water Environments - Volume 2 Swimming Pools and Similar Recreational Water Environments. Geneva, World Health Organization.
- WHO (2004c) Severe Acute Respiratory Syndrome (SARS). <http://www.who.int/csr/sars/en/>

- WHO (2005) Revision of the International Health Regulations. World Health Assembly 58.3 Agenda item 13.1, 23 May 2005.
- WHO (2007a) International medical guide for ships. 3rd ed. Geneva, World Health Organization.
- WHO (2007b) *Legionella* and the prevention of legionellosis. Geneva, World Health Organization.

10 Annex A: Examples of hazards, control measures, monitoring procedures and corrective actions for the ship water supply system

10.1 Source water

Hazard/hazardous event	Control measure	Monitoring procedures	Corrective action
Contaminated source water	Routine checks on source water quality	Monitor turbidity and microbial indicators	Filtration and disinfection or use alternative source
Defective filters	Routine inspections and maintenance Regular backwashing and cleaning of filters	Monitor filter performance using turbidity	Repair or replace defective filters
Contaminated hoses	Regular cleaning and disinfection Regular repair and maintenance Proper storage and labelling	Routine inspections	Repair or replacement Cleaning and disinfection
Contaminated hydrants	Regular cleaning and disinfection Regular repair and maintenance	Routine inspections	Repair or replacement Cleaning and disinfection
Cross-connections with non-potable water at bunkering	Correct design and plumbing Correct labelling No connection with non-potable water	Routine inspections	Install new plumbing Isolate part of system Rechlorination, flush
Defective backflow preventers at bunkering	No defects that allow ingress of contaminated water	Routine inspections, repair and maintenance	Repair or replace

10.2 Storage

Hazard/hazardous event	Control measure	Monitoring procedures	Corrective action
Sediment at bottom of storage tanks	Routine cleaning (e.g. every 6 months)	Routine inspections, documentation	Procedure for cleaning storage tanks
Damage to wire mesh in overflow/vent pipe	Routine inspection, repair and maintenance	Routine sanitary inspections	Replace or repair
Cross-connections between potable water storage tank and non-potable water storage	Cross-connection control programme	Routine inspections, repair and maintenance	Repair or replace

Hazard/hazardous event	Control measure	Monitoring procedures	Corrective action
tank or pipe			
Defects in potable water storage tanks	Routine sanitary inspection	Routine inspections, repair and maintenance	Repair or replace

10.3 Distribution system

Hazard	Control measure	Monitoring procedures	Corrective action
Cross-connections with non-potable water	Prevent cross-connections Procedures for inspection, repair and maintenance Correct identification of pipes and tanks	Routine inspections	Break cross-connection
Defective pipes, leaks	Procedures for inspection, repair and maintenance	Routine inspections	Repair pipes
Defective backflow preventers at outlets throughout distribution system	No defects that would allow ingress of contaminated water	Routine inspections Testing of preventers	Repair or replace
Contamination during repair and maintenance of tanks and pipes	No defects that would allow ingress into potable water tanks/pipes Procedures for hygienic repair and maintenance Procedures for cleaning and disinfecting	Inspection of job Water sampling (microbiological analysis)	Train staff Written procedures Disinfect fracture area and fitting
Leaking pipes/tanks	Prevent leakage System maintenance and renewal	Routine inspections Pressure and flow monitoring	Repair
Toxic substances in pipe materials	No toxic substances Specifications for pipe materials	Check specifications for pipes and materials Check specification certificates	Replace pipes if specification is not correct
Insufficient residual disinfection	Adequate to prevent regrowth (e.g. maintaining free chlorine residual above 0.2 mg/L (ppm))	Online monitoring of residual, pH and temperature Routine sampling	Investigate cause and rectify

11 Annex B. Example of a training checklist from the UK Industry Guide to Good Hygiene Practice: Catering Guide – Ships:

This example provides a checklist called the “Food Hygiene Supervision and Instruction and/or Training” on the Essentials of Food Hygiene which forms the basis of the following training outline.

All crew should be properly supervised and instructed to ensure they work hygienically. A greater degree of supervision may be needed for:

- new crew awaiting formal training;
- crew handling high risk foods;
- less experienced crew; and
- crew whose first language is not the same as that spoken by others on the ship and/or crew with learning or literacy difficulties.

When a ship’s operation or part of the operation employs only one or two people, supervision may not be practical. In such cases, training and levels of competence must be sufficient to allow work to be unsupervised.

All food handlers should, before starting work for the first time, receive written or verbal instruction in the essentials of food hygiene, viz:

- keep yourself clean and wear clean clothing;
- keep hair and beards trimmed and covered;
- always wash your hands thoroughly: before handling food or starting work, after using the toilet, handling raw foods or waste, after every break, after blowing your nose, eating, drinking or smoking.
- tell your supervisor, before commencing work, of any skin, nose, throat, stomach or bowel trouble, fever or infected wound;
- ensure cuts and sores are covered with a waterproof, high visibility dressing;
- avoid unnecessary handling of food;
- do not smoke, eat or drink in a food room, and never cough or sneeze over food;
- if you see something wrong, tell your supervisor;
- do not prepare food too far in advance of service;
- keep perishable food either refrigerated or piping hot;
- keep the preparation of raw and cooked food strictly separate;
- when reheating food ensure it gets sufficiently hot throughout;
- clean as you go. Keep all equipment and surfaces clean. Follow the cleaning programmes; and
- follow all food safety instructions in any of the ship’s operational manuals or on food packaging or from your supervisor.

As some of the above points may not be relevant to all ships and operations, they should be amended accordingly to suit the operation.

All relevant crew should have Hygiene Awareness Instruction. The topics covered should be appropriate to the job of the individual and may include:

- the ship operator’s policy with priority given to food hygiene and safety;
- harmful bacteria;
- personal health and hygiene stressing the need for high personal standards, reporting illness, etc;
- cross-contamination causes and prevention;
- food storage protection, temperature control;
- waste disposal, cleaning, sanitation and disinfection materials, methods and storage;

- 'foreign body' hazards and potential contamination; and
- awareness of pests liable to be encountered on board and relevant action to be taken.

In addition, crew must be told how to do their particularly job hygienically. In particular, they should be instructed on any control or monitoring points of the HACCP plan.

The depth, breadth and duration of training will be dependent upon the particular job role and the degree of risk involved in the activity.

The first level of training aims to give a level of understanding on the basic principles of food hygiene and the course may be of about 6 hours duration. The following topics should be covered:

- food poisoning micro-organisms types and sources;
- simple microbiology, toxins, spores, growth and destruction;
- food operation areas and equipment;
- common food hazards: physical, chemical and microbiological;
- personal hygiene: basic rules and responsibilities;
- preventing food contamination and spoilage;
- food poisoning, symptoms and causes;
- cleaning and disinfection/sterilization;
- [awareness of relevant regulations and requirements];
- pest awareness; and
- effective temperature control of food, e.g. chilled or frozen storage, thawing, cooking, cooling, reheating and holding.

12 Annex C: Example of recommended procedures for Inspection and Issuance of Ship Sanitation Certificate (from Peoples Republic of China)

Entry-Exit Inspection and Quarantine of P.R.C.

No.

Recording Form for Sanitation Inspection over Ships

Name of ship _____ Flag

Registration / IMO number _____/

Time/date of inspection _____ Place of inspection

Agent _____ Inspector

13 Annex D: Example of recording form for port health officer to inspect the areas according to the IHR (2005) (from Peoples Republic of China)

Items inspected	Requirements	Results	Evidence found
Crew and Passengers	1. All crew and passengers are in good health. No infected cases, suspects or food-borne diseases are reported. ▲	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. All crew possess valid health certificates. Crew and passengers from yellow fever infected area possess valid yellow fever vaccination certificates.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	3. Cooks and serving staff display good personal hygiene and are knowledgeable about safe food holding and preparation methods.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Galley	1. There is a whole schedule for daily cleaning and maintenance or a sanitation management code in operation, which is posted up at crucial places where food contamination might occur.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. All inner walls and floors are clean and free from grease or still water.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	3. There are well-developed facilities against dust, insects and rats. There is no evidence of rodent infestation, and insect infestation is under control. ▲	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	4. There are food-handling areas restricted for this purpose only and separated from other public areas or passages.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	5. Culinary utensils, furniture, and facilities for food producing, processing, and storage are kept clean.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	6. Raw and cooked food are separately processed and stored, and placed in good order to prevent cross-contamination.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	7. There are dedicated hand-washing facilities and cleanser accessible to the galley staff.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	8. Exhaust ventilation equipment is adequately provided and works normally.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	9. There are dedicated garbage/waste bins	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	10. Food served at service area and cafeteria is protected from contamination with appropriate exhibiting covers or other effective methods, and hold at reasonable temperature. Public utensils are provided and placed according to service flow.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Pantry and Stores	1. All Food is obtained from reliable sources and is clean, without impurity or adulteration and within expiration dates. All food is stored by sort and kept on shell.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. Storerooms are clean and kept away from pollution source. There are no poisonous or harmful substances inside.	Yes <input type="checkbox"/> No <input type="checkbox"/>	

Items inspected	Requirements	Results	Evidence found
	3. There is no evidence of rodent infestation, and insect infestation is under control. ▲	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	4. Food to be held hot is placed in a hot-holding apparatus already at a temperature of at least 62.8°C (145°F) and maintained at that temperature until required.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	5. All perishable food or drink is kept at or below 4°C (40°F).	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	6. Fruits and vegetables are stored in cool rooms.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	7. Meat and fish are maintained at 0 to 3°C (32 to 37°F)	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	8. Milk and milk products are maintained at 4°C (40°F)	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	9. Frozen foods are kept below -12°C (10°F).	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Potable water	1. Potable water is self-made or obtained from approved water providers of port.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. Potable water tanks are located in reasonable areas where they will not be affected by dirt, insects, rodents or other contamination or excessive heat.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	3. Potable water tanks have an inspection cover for easy inspection and access for cleaning or maintenance, and are fitted with an independent drainage system.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	4. All tanks, hoses, valves and equipment for handling potable water should be exclusively for this purpose and clearly labeled.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	5. Potable water systems incorporate a halogenation/chlorination system or other means of disinfection and decontamination.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	6. "Backflow" prevention is installed.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	7. Water quality is verified regularly, and water quality test reports from the port supply should be requested.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	8. Regular cleaning and maintenance is implemented.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Cabins and Decks	1. Tidy, cozy and well ventilated	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. There is no evidence of rodent infestation and insect infestation and it is	Yes <input type="checkbox"/>	

Items inspected	Requirements	Results	Evidence found
	under control.	No <input type="checkbox"/>	
	3. Effective rat-proof facilities are used on the mooring ropes and gangboards while the ship anchors at ports	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Medical facilities	1. Crew members in charge of health onboard are medically trained and qualified.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. There are adequate valid medicine and medical devices. Records of medicine consumption and supplement are maintained and kept perfectly.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	3. There is a dedicated place for medical examination/treatment, which shall be isolated from regular areas and free from rodent, insects or other pollution sources.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	4. Facilities for medical examination or treatment are properly maintained	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	5. Medical operational manuals or procedures responding to public health emergencies are established, and medical log is perfectly maintained and kept.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Holds(cargo)	1. There is no evidence of rodent infestation and insect infestation is under control. ▲	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. No evidence of nuclear, biological, or chemical hazards and other contamination. ▲	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Garbage, solid and medical waste and human excreta	1. A system of waste disposal and transportation is established and documented.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. Covered containers or dedicated place shall be provided to hold garbage, solid and medical waste, and shall be legibly labeled.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	3. Collection and transportation of garbage, food remainder, solid and medical waste shall be documented or certified.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	4. Garbage, food remainder, and solid waste shall undergo harmless treatment before discharge and transportation. Biological and medical waste shall be disposed correctly.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	5. Storage and discharge of human excreta shall accord with relevant regulations.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Engine room	1. There is no evidence of rodent infestation and insect infestation is under control. ▲	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. Engine casings and insulation are free from rodents, insects and their host's infestation.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Ballast water	1. A comprehensive ballast water management plan is established and satisfactorily complied with.	Yes <input type="checkbox"/> No <input type="checkbox"/>	

Items inspected	Requirements	Results	Evidence found
	2. Ballast tanks valves are set in "off" position.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	3. No evidence of illegal discharge of ballast water without permission or risk assessment by quarantine authorities.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Standing water	1. No standing water is found in areas such as lifeboat covers, scuppers, awnings, bilges, air treatment plants, tires and waste containers.	Yes <input type="checkbox"/> No <input type="checkbox"/>	
	2. No insect is found in standing water	Yes <input type="checkbox"/> No <input type="checkbox"/>	
Other provisions	In case of large ships, inspection shall be implemented according to the WHO Interim Technical Advice for Inspection and Issuance of Ship Sanitation Certificates	Qualified <input type="checkbox"/> Disqualified <input type="checkbox"/>	
<input type="checkbox"/> Issue a Sanitation Control Exemption Certificate <input type="checkbox"/> Issue a Sanitation Control Certificate			
<input type="checkbox"/> Recommendations <input type="checkbox"/> Sanitation control measures			
Notice: 1.Items remarked with ▲ are key requirements. Ships that fail to comply with them shall undergo sanitary control measures. 2.The conclusion is only responsible for this inspection.			
Inspectors		Inspecting Date	
Signature of accompanying personnel		Ship's Stamp	

14 Annex E: Example of evidence recording form for capturing detailed information during Inspection and Issuance of Ship Sanitation Certificate (from Peoples Republic of China)

Name of Ship: _____

Inspection date: _____

Areas inspected	Evidence found	Control measures applied or Comments regarding conditions found

Signature of Inspecting Officer: